

**STATE OF LOUISIANA
DEPARTMENT OF TRANSPORTATION AND
DEVELOPMENT**

CONSTRUCTION PROPOSAL



**STATE PROJECT NO. 838-03-0023
WOODLAND HWY. IMPROVEMENTS
(LA 23 to PLANTERS CANAL) – PHASE 1
ROUTE LA 406
PLAQUEMINES PARISH**



Edwin Lantzer
5 NOVEMBER 2008

STATE PROJECT NO. 838-03-0023
TABLE OF CONTENTS

	Page No.
Title Sheet.....	A-1
Table of Contents	B-1
Notice to Contractors.....	C-1 thru C-2
Special Provisions	D-1 thru D-14
Supplemental Specifications:	
Supplemental Specifications for 2006 Standard Specifications (08/08)	E-1 thru E-33
Project Sign Detail	F-1
Plans (57 sheets).....	G-1 thru G-57
Construction Proposal Information:	
Title Sheet.....	H-1
Bid Bond.....	I-1
Schedule of Items.....	J-1 thru J-8
Construction Proposal Signature and Execution Form.....	K-1 thru K-2

NOTICE TO CONTRACTORS (10/08)

Electronic bids and electronic bid bonds for the following project will be downloaded by the Department of Transportation and Development (DOTD) on **Wednesday, December 10, 2008**. **Paper bids and paper bid bonds will not be accepted.** Electronic bids and electronic bid bonds must be submitted through www.bidx.com prior to the electronic bidding deadline. Beginning at 10:00 a.m., all bids will be downloaded and posted online at <http://www.dotd.la.gov/cgi-bin/construction.asp>. No bids are accepted after 10:00 a.m.

STATE PROJECT NO. 838-03-0023

DESCRIPTION: WOODLAND HWY. IMPROVEMENTS (LA 23 TO PLANTERS CANAL)
– PHASE 1

ROUTE: LA 406

PARISH: PLAQUEMINES

LENGTH: 1.590 miles.

TYPE: GRADING, DRAIN STRUCT, CLASS II BC, SURFACE PREPARATION,
SUPERPAVE ASPHALTIC CONCRETE PAVEMENT AND RELATED WORK.

LIMITS: State Project No. 838-03-0023: LOCATED ON RT LA 406 FROM ITS JCT WITH
RT LA 23 to ITS JCT WITH PLANTERS CANAL

ESTIMATED COST RANGE: \$1,000,000 to \$2,500,000

PROJECT ENGINEER: CAPOTE, NELSON; 900 Peters Rd., Harvey, LA 70058, (504) 361-6495.

PROJECT MANAGER: BRANTON, JENNIFER.

Bids must be prepared and submitted in accordance with Section 102 of the 2006 Louisiana Standard Specifications for Roads and Bridges as amended by the project specifications, and must include all information required by the proposal.

NOTICE TO CONTRACTORS (CONTINUED)

Paper plans and/or proposals may be obtained in Room 101-A of the DOTD Headquarters Administration Building, 1201 Capitol Access Road in Baton Rouge, or by contacting the DOTD; Email: sharonknight@dotd.la.gov, Phone (225) 379-1111, FAX: (225) 379-1714, or by written requests sent to the Louisiana Department of Transportation and Development, Project Control Section, P. O. Box 94245, Baton Rouge, LA 70804-9245. Proposals will not be issued later than 24 hours prior to the time set for opening bids. All Addenda, Amendments, Letters of Clarification, and Withdrawal Notices will be posted online. **Paper notices will not be distributed.** Construction proposal information may be accessed via the Internet at www.dotd.la.gov. From the home page, select ***Doing Business with DOTD*** from the left-hand menu, then select the appropriate letting date found under the ***Construction Letting Information*** pop-up menu. All project specific notices are posted under ***Construction Proposal Documents*** for this project. **It will be the responsibility of the bidder to check for updates.** If paper copies of the proposal are desired, the proposal cost is \$25.00. Paper copies of the plans are included in the proposal (no additional charge). The purchase price for paper plans and proposals is non-refundable. Additionally, plans and specifications may be seen at the Project Engineer's office or in Room 101-A of the DOTD's Headquarters Administration Building in Baton Rouge. Upon request, the Project Engineer will show the work.

All questions concerning the plans shall be submitted via the Electronic Plans Distribution Center known as **Falcon**. Questions submitted within 96 hours of the bid deadline may not be answered prior to bidding. Falcon may be accessed via the Internet at www.dotd.la.gov. From the home page, select ***Doing Business with DOTD*** from the left-hand menu, then select ***Construction Letting Information*** on the pop-up menu. On the Construction Letting Information page, select the link, ***DOTD's Plan Room***. Login to Falcon (or request an ID if a first-time user). Once logged in, you will have access to view Project Information, submit a question concerning the project, and view the plans. All submitted questions will be forwarded by email to the Project Manager and the Project Engineer for a response.

The U. S. Department of Transportation (DOT) operates a toll free "Hotline" Monday through Friday, 8:00 a.m. to 5:00 p.m., eastern time. Anyone with knowledge of possible bid rigging, bidder collusion, or other fraudulent activities should call 1-800-424-9071. All information will be treated confidentially and caller anonymity will be respected.

STATE PROJECT NO. 838-03-0023
SPECIAL PROVISIONS

GENERAL BIDDING REQUIREMENTS (08/06): The specifications, contract and bonds governing the construction of the work are the 2006 Edition of the Louisiana Standard Specifications for Roads and Bridges, together with any supplementary specifications and special provisions attached to this proposal.

Bids shall be prepared and submitted in accordance with Section 102 of the Standard Specifications.

The plans herein referred to are the plans approved and marked with the project number, route and Parish, together with all standard or special designs that may be included in such plans.

The bidder declares that the only parties interested in this proposal as principals are those named herein; that this proposal is made without collusion or combination of any kind with any other person, firm, association, or corporation, or any member or officer thereof; that careful examination has been made of the site of the proposed work, the plans, Standard Specifications, supplementary specifications and special provisions above mentioned, and the form of contract and payment, performance, and retainage bond; that the bidder agrees, if this proposal is accepted, to provide all necessary machinery, tools, apparatus and other means of construction and will do all work and furnish all material specified in the contract, in the manner and time therein prescribed and in accordance with the requirements therein set forth; and agrees to accept as full compensation therefore, the amount of the summation of the products of the quantities of work and material incorporated in the completed project, as determined by the engineer, multiplied by the respective unit prices herein bid.

It is understood by the bidder that the quantities given in this proposal are a fair approximation of the amount of work to be done and that the sum of the products of the approximate quantities multiplied by the respective unit prices bid shall constitute gross sum bid, which sum shall be used in comparison of bids and awarding of the contract.

The bidder further agrees to perform all extra and force account work that may be required on the basis provided in the specifications.

The bidder further agrees that within 15 calendar days after the contract has been transmitted to him, he will execute the contract and furnish the Department satisfactory surety bonds.

If this proposal is accepted and the bidder fails to execute the contract and furnish bonds as above provided, the proposal guaranty shall become the property of the Department; otherwise, said proposal guaranty will be returned to the bidder; all in accordance with Subsection 103.04.

MANDATORY ELECTRONIC BIDS AND ELECTRONIC BID BONDS SUBMISSION (10/08): This project requires mandatory electronic bidding. All Specifications, whether Standard, Supplemental or Special Provisions, are hereby amended to delete any references regarding paper bids and the ability to submit paper bid forms.

The contractor shall register online to be placed on the Louisiana Department of Transportation and Development (LA DOTD) prospective bidders list or for information only list.

Modifications to proposal documents will be posted on the Department's website at the following URL address: www.dotd.la.gov/cgi-bin/construction.asp.

LA DOTD shall not be responsible if the bidder cannot complete and submit a bid due to failure or incomplete delivery of the files submitted via the internet.

STATE PROJECT NO. 838-03-0023
SPECIAL PROVISIONS

SPECIAL NOTICE TO CONTRACTORS: The Notice to Proceed will not be issued for this project until the U.S. Army Corps of Engineers (Nationwide) permit and the Coastal Use Permit from the Louisiana Department of Natural Resources, Coastal Management Division has been attained.

MAINTENANCE OF TRAFFIC (08/06): Subsection 104.03 of the 2006 Standard Specifications is amended to include the following requirements.

The contractor shall provide for and maintain through and local traffic at all times and shall conduct his operations in such manner as to cause the least possible interference with traffic at junctions with roads, streets and driveways.

The contractor shall conduct his paving operations on one side of the roadway at a time. The side of the roadway, including shoulder, that is open to traffic shall be clear at all times.

When the plans show asphaltic concrete pavement layers to be placed in thicknesses of 2 inches (50 mm) or less, the contractor will be permitted to pave in one lane for a full day; the adjacent lane may be paved the following workday. When pavement layers are greater than 2 inches (50 mm) thickness, the contractor shall place approximately 1/2 of each day's production in one lane and the remainder in the adjacent lane.

At the end of each day's paving operations, temporary pavement markings shall be in place and proper signs and barricades displayed. During the period that all lanes are open to traffic, the contractor shall neither store material nor park equipment on roadway shoulders.

All asphaltic concrete pavement new construction, overlays, and shoulder surfacing operations open to traffic shall be conducted in accordance with the following requirements.

1. Shoulder Subgrade Preparation: Any required embankment widening shall be completed before placement of the asphaltic concrete overlay. All vegetation shall be removed from existing shoulders before beginning temporary or final shoulder construction.

2. Temporary Shoulder Construction: Temporary shoulder construction described herein shall be completed at the end of each day's operations for all asphaltic concrete courses except the final wearing course. There shall be no drop-off from the pavement edge to the shoulder. The contractor shall blade and shape existing shoulder material against, and approximately level with, the top of the pavement surfacing to form a temporary shoulder with a uniform slope from the pavement edge to the existing shoulder line, or to a point 10 feet (3 m) from the pavement edge. If existing shoulder materials are insufficient, the contractor shall furnish, place and shape additional shoulder surfacing materials to form the temporary shoulder. Existing and/or additional materials for temporary shoulders shall be to the satisfaction of the engineer. Compaction shall be by approved methods.

No direct payment will be made for constructing and subsequently reshaping temporary shoulders, except payment for additional materials under appropriate pay items.

NAVIGABLE WATERS AND WETLANDS: Subsection 107.09 of the Standard Specifications is amended to include the following.

In accordance with the provisions of this Subsection, the Department has submitted the required U.S. Army Corps of Engineers (Nationwide) permit.

The Department has submitted a Coastal Use Permit or other approval from the Louisiana Department of Natural Resources, Coastal Management Division, for all work within the Louisiana Coastal Zone.

STATE PROJECT NO. 838-03-0023
SPECIAL PROVISIONS

The Department anticipates that these permits will be attained by the time the contract is awarded to the successful bidder.

Bidders shall comply with the permit requirements. Bidders may obtain a copy of these permits, once secured, by contacting the Department's Environmental Section at (225) 379-1317.

ENVIRONMENTAL PROTECTION (08/06): Subsection 107.14 of the 2006 Standard Specifications is amended to include the following paragraphs at the end of this subsection.

The Notice of Intent (NOI) will be submitted by the Department to the Louisiana Department of Environmental Quality (LADEQ) prior to the project letting. The project engineer will complete and submit the Notice of Termination (NOT) to the LADEQ after final stabilization of the site, in accordance with the terms of the permit.

The use of erosion control features or methods other than those in the contract shall be as directed.

The Storm Water Pollution Prevention Plan shall be comprised of Section 204 of the standard specifications along with applicable supplemental specifications and special provisions, and Standard Plan EC-01, "Temporary Erosion Control Details."

SUBLETTING OF CONTRACT (01/83): In accordance with Subsection 108.01 of the Standard Specifications, the following items are designated as "Specialty Items":

- Item 704-03, Blocked Out Guard Rail
- Item 704-07-A, Guard Rail Bridge Attachments (Single Thrie Beam)
- Item 704-08-B, Guard Rail Transitions (Double Thrie Beam)
- Item 704-11-A, Guard Rail End Treatment (Flared)
- Item 729-16-C, Object Marker Assembly (Type 3)
- Item 731-02, Reflectorized Raised Pavement Markers
- Item 732-01-E, Plastic Pavement Striping (24" Width)
- Item 732-02-A, Plastic Pavement Striping (Solid Line) (4" Width)
- Item 732-03-A, Plastic Pavement Striping (Broken Line) (4" Width)
- Item 732-04-A, Plastic Pavement Legends and Symbols (Arrow)

PAYMENT ADJUSTMENT (03/07): Section 109, Measurement and Payment of the 2006 Standard Specifications and the supplemental specifications thereto, is amended to add the following.

This project is designated for payment adjustment for asphalt cements and fuels in accordance with Subsection 109.09 as follows.

109.09 PAYMENT ADJUSTMENT (ASPHALT CEMENTS AND FUELS).

(a) General: Payment for contract items indicated herein will be adjusted to compensate for cost differentials of Performance Graded (PG) asphalt cements, gasoline, and diesel fuel when such costs increase or decrease more than 5 percent from the Department's established base prices for these items. The base price indices for asphalt cements and fuels will be the monthly price indices in effect at the time bids are opened for the project. The base price indices for asphalt cements will be as stated in paragraph (b) below. The base price index for fuels will be as stated in paragraph (c) below.

STATE PROJECT NO. 838-03-0023
SPECIAL PROVISIONS

Payment adjustments will be made each monthly estimate period when a price index for this period varies more than 5 percent from its respective base price index. The monthly price indices to be used with each monthly estimate will be the price indices for the month in which the estimate period begins.

If the project is placed in default, payment adjustments will be based on the monthly price indices used for the last monthly estimate period prior to the project being placed in default, unless a monthly price index decreases in which case the lower monthly price index will be used.

If it is determined after completion of work on any eligible item that the total quantity paid to date must be adjusted to reflect more accurate quantity determinations, the Department will prorate the additional quantity to be added or subtracted over all previous estimate periods in which the item of work was performed in order to determine additional payment adjustments. If payment adjustments were made during any of these partial estimate periods, this added or subtracted quantity that has been prorated will likewise have payment adjustments calculated and included.

(b) Performance Graded (PG) Asphalt Cements: The base price index will be the monthly price index in effect at the time of bid opening as shown elsewhere herein. The monthly price indices will be the average, excluding the extreme outliers, of the unit prices for PG 64-22, the average, excluding the extreme outliers, of the unit prices for PG 70-22m, and the average, excluding the extreme outliers, of the unit prices for PG 76-22m. The monthly prices for each of these asphalt materials will be F.O.B. refinery or terminal as determined from the quoted prices effective on the first calendar day of each month from suppliers of these materials. Suppliers considered are those who have requested to participate in the liquid asphalt index determination and have supplied materials on DOTD projects within the past twelve months. These suppliers and materials shall be listed on the Department's Qualified Products List (QPL 41) and must be marketed in Louisiana.

Payment adjustments will be made in accordance with the following formulas:

If Monthly Price Index exceeds Base Price Index,

$$P_a = (A - 1.05B) \times C \times D \times (1.00 + T)$$

If Base Price Index exceeds Monthly Price Index,

$$P_a = (0.95B - A) \times C \times D \times (1.00 + T)$$

STATE PROJECT NO. 838-03-0023
SPECIAL PROVISIONS

Where:

- P_a = Price adjustment (increase or decrease) for asphalt cement.
A = Monthly Price Index for respective PG 64-22, PG 70-22m, or PG 76-22m in dollars per ton/megagram.
B = Base Price Index for respective PG 64-22, PG 70-22m, or PG 76-22m in dollars per ton/megagram.
C = Tons/megagrams of asphaltic concrete.
D = Percent of respective asphalt cement, per job mix formula, in decimals.
T = Louisiana sales tax percentage, in decimals.
(Note: Local tax is not considered)

The engineer will furnish the weights (mass) of asphaltic concrete placed during the monthly estimate period with the respective asphalt cement content, excluding the asphalt content in reclaimed asphaltic pavement (RAP) as per job mix formula. If the asphalt cement content changes during the estimate period, the respective weight (mass) of asphaltic concrete produced at each cement content will be reported.

Item 510-02, Pavement Widening, and all contract pay items under Sections 502 and 508, will be eligible for payment adjustments of asphalt materials. No payment adjustment will be made for other asphalt materials, including emulsions and cutbacks.

The base price indices for asphalt cements and fuels will be posted on the DOTD internet website before the 10th calendar day of each month at the following URL: www.dotd.louisiana.gov/lettings/lac_price_index/priceindices.asp.

(c) Fuels: The base price index for this project will be the monthly price index in effect when bids are opened for the project. The monthly price index will be the minimum price quotations for unleaded gasoline and No. 2 diesel fuel listed for the New Orleans area in *Platt's Oilgram and Price Report* effective on the first calendar day of each month.

Payment adjustment will be made in accordance with the following formulas:

If Monthly Price Index exceeds Base Price Index,

$$P_a = (A - 1.05B) \times Q \times F$$

If Base Price Index exceeds Monthly Price Index,

$$P_a = (0.95B - A) \times Q \times F$$

Where:

- P_a = Price adjustment.
A = Monthly Price Index in dollars per gallon/liter.
B = Base Price Index in dollars per gallon/liter.
Q = Pay Item Quantity (Pay Units).
F = Fuel Usage Factor Gal (L)/Pay Unit.

The following is a listing of contract pay items that are eligible for payment adjustment and the fuel usage factors that will be used in making such adjustment. Contract items that expand the items listed herein by use of letter designations are also eligible for fuel price adjustments; for example:

Item 601-01-G, Portland Cement Concrete Pavement 8 inches (200 mm) thick.

STATE PROJECT NO. 838-03-0023
SPECIAL PROVISIONS

**ELIGIBLE CONTRACT PAY ITEMS & FUEL USAGE FACTORS FOR FUEL
PAYMENT ADJUSTMENT**

ITEM NO.	PAY ITEM	UNITS	MIN. ORIGINAL CONTRACT QUANTITY FOR PAY ADJUSTMENT	FUEL USAGE FACTORS	
				Diesel ²	Gasoline
203-01 ¹	General Excavation	gal/cu yd	10,000 cu yd	0.29	0.15
203-02	Drainage Excavation	gal/cu yd	10,000 cu yd	0.29	0.15
203-03 ¹	Embankment	gal/cu yd	10,000 cu yd	0.29	0.15
203-04	Nonplastic Embankment	gal/cu yd	10,000 cu yd	0.29	0.15
203-07	Borrow (Vehicular Measurement)	gal/cu yd	10,000 cu yd	0.29	0.15
301-01	Class I Base Course	gal/cu yd	3,000 cu yd	0.88	0.57
301-02	Class I Base Course (" Thick)	gal/sq yd	50,000 sq yd	0.04	0.03
302-01	Class II Base Course	gal/cu yd	3,000 cu yd	0.88	0.57
302-02	Class II Base Course (" Thick)	gal/sq yd	50,000 sq yd	0.04	0.03
303-01	In-Place Cement Stabilized Base Course	gal/sq yd	50,000 sq yd	0.04	0.03
304-02	Lime Treatment (Type B)	gal/sq yd	50,000 sq yd	0.04	0.03
304-03	Lime Treatment (Type C)	gal/sq yd	50,000 sq yd	0.04	0.03
304-04	Lime Treatment (Type D)	gal/sq yd	50,000 sq yd	0.04	0.03
305-01	Subgrade Layer (" Thick)	gal/sq yd	50,000 sq yd	0.04	0.03
308-01	In-Place Cement Treated Base Course	gal/sq yd	50,000 sq yd	0.04	0.03
401-01	Aggregate Surface Course (Net Section)	gal/cu yd	3,000 cu yd	0.88	0.57
401-02	Aggregate Surface Course (Adjusted Vehicular Measurement)	gal/cu yd	3,000 cu yd	0.88	0.57
502-01	Superpave Asphaltic Concrete	gal/ton	1000 ton	2.40 ³	0.2
502-02	Superpave Asphaltic Concrete	gal/cu yd	500 cu yd	4.80 ⁴	0.4
502-03	Superpave Asphaltic Concrete (" Thick)	gal/sq yd	10,000 sq yd	0.13 ^{5,6}	0.01 ⁶
508-01	Asphaltic Concrete (SMA)	gal/ton	1000 ton	2.40 ³	0.2
510-02	Pavement Widening	gal/sq yd	3,000 sq yd	0.86	0.24
601-01	Portland Cement Concrete Pavement (" Thick)	gal/sq yd	15,000 sq yd	0.11	0.15

1 If project has both 203-01 & 203-03, only the item with larger quantity is eligible.

2 For fuel adjustment purposes, the term "diesel" shall represent No. 2 or No. 4 fuel oils or any of the liquified petroleum gases, such as propane or butane.

3 If natural gas or coal is used instead of diesel for aggregate drying and heating the fuel usage factor shall be 1.67 gal/ton.

4 If natural gas or coal is used instead of diesel for aggregate drying and heating the fuel usage factor shall be 13.34 gal/cu yd.

5 If natural gas or coal is used instead of diesel for aggregate drying and heating the fuel usage factor shall be 0.09 gal/sq yd.

6 Per inch of thickness.

STATE PROJECT NO. 838-03-0023
SPECIAL PROVISIONS

**ELIGIBLE CONTRACT PAY ITEMS & FUEL USAGE FACTORS FOR FUEL
PAYMENT ADJUSTMENT (METRIC)**

ITEM NO.	PAY ITEM	UNITS	MIN. ORIGINAL CONTRACT QUANTITY FOR PAY ADJUSTMENT	FUEL USAGE FACTORS	
				Diesel ²	Gasoline
203-01 ¹	General Excavation	l/m ³	7,600 m ³	1.44	0.74
203-02	Drainage Excavation	l/m ³	7,600 m ³	1.44	0.74
203-03 ¹	Embankment	l/m ³	7,600 m ³	1.44	0.74
203-04	Nonplastic Embankment	l/m ³	7,600 m ³	1.44	0.74
203-07	Borrow (Vehicular Measurement)	l/m ³	7,600 m ³	1.44	0.74
301-01	Class I Base Course	l/m ³	2,300 m ³	4.36	2.82
301-02	Class I Base Course (mm Thick)	l/m ²	41,800 m ²	0.18	0.14
302-01	Class II Base Course	l/m ³	2,300 m ³	4.36	2.82
302-02	Class II Base Course (mm Thick)	l/m ²	41,800 m ²	0.18	0.14
303-01	In-Place Cement Stabilized Base Course	l/m ²	41,800 m ²	0.18	0.14
304-02	Lime Treatment (Type B)	l/m ²	41,800 m ²	0.18	0.14
304-03	Lime Treatment (Type C)	l/m ²	41,800 m ²	0.18	0.14
304-04	Lime Treatment (Type D)	l/m ²	41,800 m ²	0.18	0.14
305-01	Subgrade Layer (mm Thick)	l/m ²	41,800 m ²	0.18	0.14
308-01	In-Place Cement Stabilized Base Course	l/m ²	41,800 m ²	0.18	0.14
401-01	Aggregate Surface Course (Net Section)	l/m ³	2,300 m ³	4.36	2.82
401-02	Aggregate Surface Course (Adjusted Vehicular Measurement)	l/m ³	2,300 m ³	4.36	2.82
502-01	Superpave Asphaltic Concrete	l/Mg	900 Mg	10.01 ³	0.83
502-02	Superpave Asphaltic Concrete	l/m ³	400 m ³	23.77 ⁴	1.98
502-03	Superpave Asphaltic Concrete (mm Thick)	l/m ²	8,400 m ²	0.59 ^{5,6}	0.45 ⁶
508-01	Asphaltic Concrete (SMA)	l/Mg	900 Mg	10.01 ³	0.83
510-02	Pavement Widening	l/m ²	2,500 m ²	3.89	1.09
601-01	Portland Cement Concrete Pavement (mm Thick)	l/m ²	12,500 m ²	0.5	0.68

- 1 If project has both 203-01 & 203-03, only the item with larger quantity is eligible.
- 2 For fuel adjustment purposes, the term "diesel" shall represent No. 2 or No. 4 fuel oils or any of the liquified petroleum gases, such as propane or butane.
- 3 If natural gas or coal is used instead of diesel for aggregate drying and heating the fuel usage factor shall be 6.97 l/mg.
- 4 If natural gas or coal is used instead of diesel for aggregate drying and heating the fuel usage factor shall be 16.53 l/m³.
- 5 If natural gas or coal is used instead of diesel for aggregate drying and heating the fuel usage factor shall be 0.41 l/m².
- 6 Per mm of thickness.

STATE PROJECT NO. 838-03-0023
SPECIAL PROVISIONS

TEMPORARY TRAFFIC CONTROL (09/08): Section 713 of the 2006 Standard Specifications and the Supplemental Specifications is amended as follows:

Subsection 713.04, Temporary Signs and Barricades, is amended to include the following:

(d) Project Signs: The contractor shall furnish, install, and maintain "project signs" in accordance with the following requirements.

Project signs shall conform to the requirements of Section 713 and the project sign detail(s) contained elsewhere herein. Shop drawings will be furnished to the successful bidder by contacting the Department's Traffic Services Sign Shop at (225) 935-0121 or 935-0142.

Project signs shall be required at the beginning and end of the project and shall follow sign G-20-1, "Road Work Next 'X' Miles", or as directed by the engineer.

Immediately following final project inspection and prior to final acceptance, the Contractor shall furnish and install an additional project sign, indicating project completion, over the initial "project signs" as described in the project sign detail(s) herein. Following project final acceptance, project signs shall remain for a minimum of sixty days. The Contractor will not be responsible for project signs after the project has been accepted by the Department.

Payment for all project signs within this subsection shall include all labor, materials, tools, and equipment required to complete the work and shall be included in the contract unit price for Item 713-01 Temporary Signs and Barricades.

PLASTIC PAVEMENT MARKINGS (09/07): Section 732 of the 2006 Standard Specifications and the supplemental specifications thereto, is amended as follows.

Subsection 732.03, Construction Requirements for Plastic Pavement Marking Material. Heading (a) is amended as follows.

The first paragraph is deleted and the following substituted.

(a) Equipment for Standard (Flat) Thermoplastic Marking Material: The application equipment shall consist of an extrusion die or a ribbon gun that simultaneously deposits and shapes lines at a thickness of 90 mils (2.3 mm) or greater on the pavement surface. When restriping onto existing thermoplastic markings, only a ribbon gun shall be used. Finished markings shall be continuous and uniform in shape, and have clear and sharp dimensions. Applicators shall be capable of producing various widths of traffic markings. Applicators shall produce sharply defined lines and provide means for cleanly cutting off stripe ends and applying broken lines. The ribbon extrusion die or shaping die shall not be more than 2 inches (50 mm) above the roadway surface during application. A spray application will only be allowed when applying 40 mil (1.0 mm) thermoplastic.

Heading (e) is deleted and the following substituted.

(e) Application of Surface Primer: A single component surface primer will be required prior to placement of preformed plastic markings over an existing painted stripe, over oxidized asphalt, or when striping over existing thermoplastic on portland cement concrete surfaces unless otherwise directed by the engineer. A two component epoxy primer sealer will be required prior to placement of thermoplastic materials on portland cement concrete surfaces unless otherwise directed by the engineer.

STATE PROJECT NO. 838-03-0023
SPECIAL PROVISIONS

ASPHALT MATERIALS AND ADDITIVES (04/08): Section 1002 of the 2006 Standard Specifications and the supplemental specifications thereto is amended as follows.

Subsection 1002.02, Asphalt Material Additives is amended as follows.

Table 1002-1, Performance Graded Asphalt Cements is deleted and the following substituted.

STATE PROJECT NO. 838-03-0023
SPECIAL PROVISIONS

Table 1002-1
Performance Graded Asphalt Cements

Property	AASHTO Test Method	PG82-22rm ⁶	PG76-22m	PG70-22m	PG64-22	PG58-28
		Spec.	Spec.	Spec.	Spec.	Spec.
Tests on Original Binder:						
Rotational Viscosity @ 135°C, Pa·s ¹	T 316	3.0	3.0	3.0	3.0	3.0
Dynamic Shear, 10 rad/s, G*/Sin Delta, kPa	T 315	1.00+ @ 82°C	1.00+ @ 76°C	1.00+ @ 70°C	1.30+ @ 64°C	1.00+ @ 58°C
Flash Point, °C	T 48	232+	232+	232+	232+	232+
Solubility, % ²	T 44	N/A	99.0+	99.0+	99.0+	99.0+
Separation of Polymer, 163°C, 48 hours, degree C difference in R & B from top to bottom ⁵	ASTM D 7173 AASHTO T 53	---	2-	2-	---	---
Force Ductility Ratio (f ₂ /f ₁ , 4°C, 5 cm/min., f ₂ @ 30 cm elongation) ³	T 300	---	0.30+	---	---	---
Force Ductility, (4°C, 5 cm/min, 30 cm elongation, kg) ³	T 300	---	---	0.23+	---	---
Tests on Rolling Thin Film Oven Residue:	T 240					
Mass loss, %	T 240	1.00-	1.00-	1.00-	1.00-	1.00-
Dynamic Shear, 10 rad/s, G*/Sin Delta, kPa	T 315	2.20+ @ 82°C	2.20+ @76°C	2.20+ @ 70°C	2.20+ @ 64°C	2.20+ @ 58°C
Elastic Recovery, 25°C, 10 cm elongation, % ⁴	T 301	60+	60+	40+	---	---
Ductility, 25°C, 5 cm/min, cm	T 51	---	---	---	100+	---
Tests on Pressure Aging Vessel Residue:	R 28					
Dynamic Shear, @ 25°C, 10 rad/s, G* Sin Delta, kPa	T 315	5000-	5000-	5000-	5000-	5000- @ 19°C
Bending Beam Creep Stiffness, S, MPa @ -12°C.	T 313	300-	300-	300-	300-	300- @ -18°C
Bending Beam Creep Slope, m value,@ -12°C	T 313	0.300+	0.300+	0.300+	0.300+	0.300+ @ -18°C

¹The rotational viscosity will be measured to determine product uniformity. The rotational viscosity measured by the supplier shall be noted on the Certificate of Delivery. A binder having a rotational viscosity of 3.0 Pa·s or less will typically have adequate mixing and pumping capabilities. Binders with rotational viscosity values higher than 3.0 Pa·s should be used with caution and only after consulting with the supplier as to any special handling procedures and guarantees of mixing and pumping capabilities.

STATE PROJECT NO. 838-03-0023
SPECIAL PROVISIONS

²Not all polymers are soluble in the specified solvents. If the polymer modified asphalt digested in the solvent will not pass the filter media, a sample of the base asphalt used in making the polymer modified asphalt should be tested for solubility. If the solubility of the base asphalt is at least 99.0%, the material will be considered as passing.

³AASHTO T 300 except the second peak (f₂) is defined as the stress at 30 cm elongation.

⁴AASHTO T 301 except elongation shall be 10 cm.

⁵Prepare samples per ASTM D 7173. Determine softening point of top and bottom per AASHTO T 53.

⁶The quality assurance plan for this product will require the contractors who use this material to submit written documentation of tank cleaning annually. Contractors must have tank mixers. Written certificates of analysis from the asphalt binder supplier confirming rubber source and size distribution of rubber used shall be furnished to the Materials Laboratory.

Add the following Table 1002-12, Anionic Trackless Tack Coat Grade NTSS-1HM.

Table 1002-12
Anionic Trackless Tack Coat Grade NTSS-1HM

Property	AASHTO Test Method	Specification Deviation	
		100% Pay	50% Pay or Remove ¹
Viscosity, Saybolt Furol @ 25°C, s	T 59	15 - 100	---
Storage Stability, 24 Hour, %	T 59	1.0-	---
Settlement, 5 Days, %	T 59	5.0-	---
Residue by Distillation, %	T 59	50+	49-
Oil Distillate, %	T 59	1.0-	---
Sieve Test ² , (Retained on the 850 µm), %	T 59	0.3-	---
Tests on Residue			
Penetration @ 25°C, 100g, 5s, dmm	T 49	20-	---
Softening Point, Ring and Ball, °C	T 53	65+	64-
Solubility, %	T 44	97.5+	---
DSR @ 25°C; G*Sin δ, 10 rad / s, kPa	T 315	1.0+	---

¹ At the option of Engineer.

² Sieve tests may be waived if no application problems are present in the field.

ITEM S-001, CLEANING EXISTING CULVERTS (16 TO 48 INCHES): This item consists of cleaning existing culverts of soil, debris and other materials to the invert elevation of the culvert in accordance with the following requirements.

Culverts at designated locations shall be cleaned by approved methods that will not damage the culverts. Any damage caused by the contractor's operations shall be satisfactorily repaired at no direct pay.

Removed soil, debris and other materials shall be disposed of in accordance with Subsection 202.02 or as otherwise approved in writing.

Cleaning existing culverts will be measured by the linear foot of crossing per location cleaned and accepted and shall include all material, tools, equipment, labor and incidentals and the performance of all work necessary to complete this item.

STATE PROJECT NO. 838-03-0023
SPECIAL PROVISIONS

Payment will be made at the contract unit price under:

Item S-001, Cleaning Existing Culverts (16 to 48 inches), per linear foot.

ITEM S-002, RELOCATION OF EXISTING LANDSCAPE LIGHTING: This item consists of relocating existing landscape lighting in accordance with the following requirements and section 730 of Louisiana Standard Specification.

Relocation of existing landscape lighting will be measured per each pole, which will include disconnection of the wiring at the source; the removal of underground wiring to the pole; the removal and storage of existing pole and luminaire; the complete removal of existing foundation and apron; the backfilling of existing foundation void; the re-installation of the existing pole and luminaire; the construction of a new foundation with apron; the installation of new ground rod, fused connectors, and the pole wiring. Any damage caused by the contractor's operations shall be satisfactorily repaired at no direct pay.

Removed soil, debris and other materials shall be disposed of in accordance with Subsection 202.02 or as otherwise approved in writing.

Relocation of Existing Landscape Lighting will be measured per each and accepted and shall include all material, tools, equipment, labor and incidentals and the performance of all work necessary to complete this item.

Payment will be made at the contract unit price under:

Item S-002, Relocation of Existing Landscape Lighting, per each.

ITEM S-003, FULL DEPTH SAW CUT OF EXISTING PAVEMENT: This item consists of saw cutting existing pavement and base materials at locations designated for patching and at driveways.

The saw cutting, which is to be performed by approved methods and under the direction of the engineer, shall be full depth.

Measurement for saw cutting pavement will be made by the linear foot along the saw cut. Payment will be made at the contract unit price per linear foot which includes all materials, labor, equipment and incidentals to complete the item.

Payment will be under:

Item S-003, Full Depth Saw Cut of Existing Pavement, per linear foot.

ITEM S-004, SURFACE PREPARATION (07/04): This item consists of preparing the existing surfaces for single lift overlays.

Surface tolerances on single-lift overlays over existing surfaces shall be in accordance with Section 502 of the Standard Specifications. The contractor has the option of leveling, grinding, cold planing certain areas, or cold planing the entire project in order to meet surface tolerances. The contractor shall not cold plane more than 1/2 inch (13 mm) (average) from the existing surface. The contractor may retain 100 percent of the reclaimed asphaltic pavement (RAP).

Payment will be made under:

Item S-004, Surface Preparation, per lump sum.

ITEM S-005, GEOTEXTILE FABRIC (04/01): This item consists of scarifying the existing ground and furnishing and installing geotextile fabric under the non-plastic embankment in accordance with the plans and the following requirements.

STATE PROJECT NO. 838-03-0023
SPECIAL PROVISIONS

The existing ground surface is to be scarified and compacted prior to installation of geotextile fabric as directed by project engineer.

Geotextile Fabric shall conform to Section 1019, Class D.

Geotextile Fabric shall comply with the construction requirements of Subsection 203.11 and the following.

Geotextile fabric shall be placed as a separator between the non-plastic embankment and the existing ground. The geotextile fabric shall be placed parallel to the centerline of the roadway. All adjacent rolls of geotextile fabric will be overlapped a minimum of 18 inches (450 mm), including the ends of the rolls. The top layer of the geotextile fabric will be overlapped in the direction of construction (previous roll on top) to prevent separation from aggregate placement.

Geotextile fabric will be measured by the square yard (sq m) of covered area in place (no direct pay for laps).

Payment will be made at the contract unit price under:

Item S-005, Geotextile Fabric, per square yard (sq m).

ITEM S-006, RUMBLE STRIPS (GROUND-IN)(04/01): This item consists of cutting 1/2 inch (13 mm) deep depressions into asphaltic concrete shoulders in accordance with plan details, this special provision, and as directed.

The cutting tool shall be equipped with a rotary type cutting head and a power unit. The cutting head shall have the cutting tips arranged in a pattern to provide a relatively smooth cut (approximately 1/16 inch (1.5 mm) between peaks and valleys). The cutting head shall be suspended independently from the power unit to allow the cutting head to self-align with the slope of the shoulder and any irregularities in the shoulder surface. The cutting tool shall be equipped with guides to provide a consistent alignment of each cut in relation to the roadway and to provide uniformity and consistency throughout the project.

The rumble strips shall be cut into the finished shoulders after the final wearing course has been placed.

Solid residue resulting from cutting operations shall be removed from pavement and shoulder surfaces by the contractor before such residue is blown by traffic or wind.

The contractor shall demonstrate to the project engineer the ability to achieve the desired surface inside each depression without tearing or snagging the asphalt prior to beginning the work.

Acceptance measurements will be performed by the Department on a random basis to ensure conformance with the specifications.

Rumble strips (ground-in) will be measured by the mile (km), plan quantity, constructed and accepted in accordance with these specifications. The plan quantity is based on the roadway length minus bridge lengths for each shoulder on which ground-in rumble strips are constructed.

Payment for rumble strips (ground-in) will be made at the contract unit price in accordance with Subsection 109.02.

Payment will be made under:

Item S-006, Rumble Strips (Ground-in), per mile (km).

STATE PROJECT NO. 838-03-0023
SPECIAL PROVISIONS

CONTRACT TIME (03/05): The entire contract shall be completed in all details and ready for final acceptance in accordance with Subsection 105.17(b) within **thirty (30) working days**.

Prior to assessment of contract time, the contractor will be allowed 30 calendar days from the date stipulated in the Notice to Proceed to commence with portions of the contract work including but not limited to assembly periods, preparatory work for materials fabrications such as test piles, or other activities which hinder progress in the beginning stages of construction. Prior to issuance of the Notice to Proceed, the Department will consider extending the assembly period upon written request from the contractor justifying the need for additional time.

The contractor shall be responsible for maintenance of traffic from the beginning of the assembly period. During the assembly period, the contractor will be allowed to do patching and other maintenance work necessary to maintain the roadway with no time charges when approved by the engineer.

If the contractor begins regular construction operations prior to expiration of the assembly period, the assessment of contract time will commence at the time construction operations are begun.

LOUISIANA
DEPARTMENT OF TRANSPORTATION AND DEVELOPMENT
SUPPLEMENTAL SPECIFICATIONS
(FOR 2006 STANDARD SPECIFICATIONS)

TABLE OF CONTENTS

PART I – GENERAL PROVISIONS

SECTION 101 – GENERAL INFORMATION, DEFINITIONS, AND TERMS	
Subsection 101.03 – Definitions.....	1
SECTION 102 – BIDDING REQUIREMENTS	
Subsection 102.09 – Proposal / Bid Guaranty	1
SECTION 107 – LEGAL RELATIONS AND RESPONSIBILITY TO PUBLIC	
Subsection 107.05 – Federal Aid Participation.....	2
SECTION 108 – PROSECUTION AND PROGRESS	
Subsection 108.04 – Prosecution of Work.....	2

PART II – EARTHWORK

SECTION 202 – REMOVING OR RELOCATING	
STRUCTURES AND OBSTRUCTIONS	
Subsection 202.06 – Plugging or Relocating Existing Water Wells	2

PART III – BASE COURSES

SECTION 302 – CLASS II BASE COURSE	
Subsection 302.05 – Mixing	2
SECTION 305 – SUBGRADE LAYER	
Subsection 305.06 – Payment.....	2
SECTION 307 – PERMEABLE BASES	
Subsection 307.02 – Materials.....	3
SECTION 308 – IN-PLACE CEMENT TREATED BASE COURSE	
All Subsections	3

PART V – ASPHALTIC PAVEMENTS

SECTION 502 – SUPERPAVE ASPHALTIC CONCRETE MIXTURES	
Subsection 502.02 – Materials.....	3
Subsection 502.14 – Lot Sizes.....	4
SECTION 508 – STONE MATRIX ASPHALT	
Subsection 508.01 – Description	5
Subsection 508.02 – Materials.....	5

PART VI – RIGID PAVEMENT

SECTION 602 – PORTLAND CEMENT CONCRETE PAVEMENT REHABILITATION

Subsection 602.17 – Payment	5
-----------------------------------	---

PART VII – INCIDENTAL CONSTRUCTION

SECTION 701 – CULVERTS AND STORM DRAINS

All Subsections	5
-----------------------	---

SECTION 704 – GUARD RAIL

Subsection 704.03 – General Construction Requirements	16
---	----

SECTION 706 – CONCRETE WALKS, DRIVES AND INCIDENTAL PAVING

All Subsections	16
-----------------------	----

SECTION 713 – TEMPORARY TRAFFIC CONTROL

Subsection 713.06 – Pavement Markings	18
---	----

SECTION 729 – TRAFFIC SIGNS AND DEVICES

Subsection 729.02 – Materials	19
-------------------------------------	----

Subsection 729.04 – Fabrication of Sign Panels and Markers	20
--	----

PART VIII – STRUCTURES

SECTION 804 – DRIVEN PILES

Subsection 804.08 – Construction Requirements	20
---	----

PART IX – PORTLAND CEMENT CONCRETE

SECTION 901 – PORTLAND CEMENT CONCRETE

Subsection 901.06 – Quality Control of Concrete	20
---	----

Subsection 901.08 – Composition of Concrete	20
---	----

PART X – MATERIALS

SECTION 1001 – HYDRAULIC CEMENT

Subsection 1001.01 – Portland Cement	21
--	----

SECTION 1003 – AGGREGATES

Subsection 1003.02 – Aggregates for Portland Cement Concrete and Mortar	21
---	----

SECTION 1005 – JOINT MATERIALS FOR PAVEMENTS AND STRUCTURES

Subsection 1005.04 – Combination Joint Former/Sealer	22
--	----

SECTION 1006 – CONCRETE AND PLASTIC PIPE

Subsection 1006.09 – Plastic Yard Drain Pipe	23
--	----

Supplemental Specifications - Table of Contents (08/08)

SECTION 1013 – METALS
Subsection 1013.09 – Steel Piles23

SECTION 1015 – SIGNS AND PAVEMENT MARKINGS
Subsection 1015.04 – Sign Panels23
Subsection 1015.05 – Reflective Sheeting.....24
Subsection 1015.11 – Preformed Plastic Pavement Marking Tape.....28

SECTION 1020 – TRAFFIC SIGNALS
Subsection 1020.01 – Traffic Signal Heads.....29
Subsection 1020.04 – Poles for Traffic Signal Systems30

**LOUISIANA
DEPARTMENT OF TRANSPORTATION AND DEVELOPMENT
SUPPLEMENTAL SPECIFICATIONS**

The 2006 Louisiana Standard Specifications for Roads and Bridges and supplemental specifications thereto are amended as follows.

PART I – GENERAL PROVISIONS

SECTION 101 – GENERAL INFORMATION, DEFINITIONS, AND TERMS:

Subsection 101.03 – Definitions (07/07), Pages 3 – 13).

Delete the definition for “Proposal/Bid Guaranty” and substitute the following.

Proposal / Bid Guaranty. The required security furnished with a bid. The only form of security acceptable is a Bid Bond.

SECTION 102 – BIDDING REQUIREMENTS:

Subsection 102.09 – Proposal / Bid Guaranty (07/07), Page 19.

Delete the contents of this subsection and substitute the following.

PROPOSAL/BID GUARANTY. Each bid shall be accompanied by a proposal/bid guaranty in an amount not less than five percent of the total bid amount when the bidder’s total bid amount as calculated by the Department in accordance with Subsection 103.01 is greater than \$50,000. No proposal/bid guaranty is required for projects when the bidder’s total bid amount as calculated by the Department is \$50,000 or less. The official total bid amount for projects that include alternates is the total of the bidder's base bid and all alternates bid on and accepted by the Department. The proposal/bid guaranty submitted by the bidder shall be a bid bond made payable to the contracting agency as specified on the bid bond form provided in the construction proposal. No other form of security will be accepted.

The bid bond shall be on the "Bid Bond" form provided in the construction proposal, on a form that is materially the same in all respects to the "Bid Bond" form provided, or on an electronic form that has received Department approval prior to submission. The bid bond shall be filled in completely, shall be signed by an authorized officer, owner or partner of the bidding entity, or each entity representing a joint venture; shall be signed by the surety's agent or attorney-in-fact; and shall be accompanied by a notarized document granting general power of attorney to the surety's signer. The bid bond shall not contain any provisions that limit the face amount of the bond.

The bid bond will be written by a surety or insurance company that is in good standing and currently licensed to write surety bonds in the State of Louisiana by the Louisiana Department of Insurance and also conform to the requirements of LSA-R.S. 48:253.

All signatures required on the bid bond may be original, mechanical reproductions, facsimiles or electronic. Electronic bonds issued in conjunction with electronic bids must have written Departmental approval prior to use. The Department will make a listing of approved electronic sureties providers on the Bidx.com site.

Supplemental Specifications (August 2008)
Page 2 of 30

SECTION 107 – LEGAL RELATIONS AND RESPONSIBILITY TO PUBLIC:

Subsection 107.05 – Federal Aid Participation (04/08), Pages 57 and 58.

Delete the second paragraph.

SECTION 108 – PROSECUTION AND PROGRESS:

Subsection 108.04 – Prosecution of Work (03/05) Pages 74 and 75.

Add the following sentence to the third paragraph of Heading (b).

Should the surety or the Department take over prosecution of the work, the contractor shall remain disqualified for a period of one year from the completion of the project, unless debarment proceedings are instituted.

When the Department of Transportation and Development is not the contracting agency on the project, the second paragraph under Heading (c) is deleted.

PART II – EARTHWORK

SECTION 202 – REMOVING OR RELOCATING STRUCTURES AND OBSTRUCTIONS:

Subsection 202.06 – Plugging or Relocating Existing Water Wells (03/04), Page 105.

Delete the first sentence and substitute the following.

All abandoned wells shall be plugged and sealed at the locations shown on the plans, or as directed by the engineer, in accordance with the “Water Well Rules, Regulations, and Standards, State of Louisiana.” This document is available at the Department of Transportation and Development, Water Resources Section, P. O. Box 94245, Baton Rouge, Louisiana 70804-9245. The Water Resource Section’s telephone number is (225) 274-4172.

PART III – BASE COURSES

SECTION 302 – CLASS II BASE COURSE:

Subsection 302.05 – Mixing (08/06), Pages 152 and 153.

Delete the first sentence of Subheading (b)(1), In-Place Mixing, and substitute the following.

In-place mixing shall conform to Heading (a)(1) except that the percentage of Type I portland cement required will be 6 percent by volume.

SECTION 305 – SUBGRADE LAYER:

Subsection 305.06 – Payment (01/08), Page 184.

Delete the contents of this subsection and substitute the following.

305.06 Payment. Payment for subgrade layer will be made at the contract unit price which includes lime, lime treatment, cement, cement treatment, water, stone, recycled portland cement concrete, crushed slag, blended calcium sulfate, asphaltic concrete, and asphalt curing membrane or prime coat, subject to the payment adjustment provisions of Section 1002 for specification deviations of asphalt materials and Subsection 303.11(a) for density deficiencies of cement treated materials. Adjustments in pay for increase or decrease in the percent cement ordered by the engineer will be in accordance with Subsection 303.13. Adjustments in pay for

increase or decrease in the percent lime ordered by the engineer will be based on the price of lime shown on paid invoices (total of all charges). The Materials and Testing Section will provide the payment adjustment percentage for properties of asphalt materials.

Payment for geotextile fabric will be included in the contract unit price for subgrade layer.

Payment will be made under:

Item No.	Pay Item	Pay Unit
305-01	Subgrade Layer _____ in (mm) Thick	Square Yard (Sq m)

SECTION 307 – PERMEABLE BASES:

Subsection 307.02 – Materials (09/07), Pages 187 and 188.

Delete the contents of Subheading (b), Asphalt, and substitute the following.

(b) Asphalt: The asphalt for asphalt treated permeable base shall be an approved polymer modified asphalt cement, PG 76-22m, or PG 82-22rm complying with Section 1002. The percentage of asphalt cement shall be 2.0 percent to 4.0 percent by weight (mass) of the total mixture. Asphalt cement content and mixing process shall be such that all aggregates are visibly coated. The mixture shall retain 90 percent coating when tested in accordance with DOTD TR 317.

A job mix formula shall be submitted and approved in accordance with Section 502.

SECTION 308 – IN-PLACE CEMENT TREATED BASE COURSE:

All Subsections within Section 308 – (07/07), Pages 191 – 198.

Whenever the reference to “DOTD TR-432, Method D” is used, it shall mean “DOTD TR-432”.

PART V – ASPHALTIC PAVEMENTS

SECTION 502 – SUPERPAVE ASPHALTIC CONCRETE MIXTURES:

Subsection 502.02 – Materials (08/06) (11/07), Pages 210 – 213.

Delete Table 502-2, Superpave Asphalt Cement Usage under Subheading (a) and substitute the following.

Supplemental Specifications (August 2008)**Page 4 of 30**

Table 502-2
Superpave Asphalt Cement Usage

Current Traffic Load Level	Mixture Type	Grade of Asphalt Cement
Level 1	Wearing Course	PG 70-22m
	Binder Course	PG 70-22m
	Base Course	PG 64-22
Level 2	Wearing Course	PG 76-22m
	Binder Course	PG 76-22m
Level A	Incidental Paving	PG 70-22m

Note: A PG 82-22 rm, Waste Tire Rubber Modified Asphalt, may be substituted for any other grade of asphalt cement.

Delete Table 502-3, Aggregate Friction Rating under Subheading (c)(1) and substitute the following.

Table 502-3
Aggregate Friction Rating

Friction Rating	Allowable Usage
I	All mixtures
II	All mixtures
III	All mixtures, except travel lane wearing courses with plan ADT greater than 7000 ¹
IV	All mixtures, except travel lane wearing courses ²

¹ When plan current average daily traffic (ADT) is greater than 7000, blending of Friction Rating III aggregates and Friction Rating I and/or II aggregates will be allowed for travel lane wearing courses at the following percentages. At least 30 percent by weight (mass) of the total aggregates shall have a Friction Rating of I, or at least 50 percent by weight (mass) of the total aggregate shall have a Friction Rating of II. The frictional aggregates used to obtain the required percentages shall not have more than 10 percent passing the No. 8 (2.36 mm) sieve.

² When the average daily traffic (ADT) is less than 2500, blending of Friction Rating IV aggregates with Friction Rating I and/or II aggregates will be allowed for travel lane wearing courses at the following percentages. At least 50 percent by weight (mass) of the total aggregate in the mixture shall have a Friction Rating of I or II. The frictional aggregates used to obtain the required percentages shall not have more than 10 percent passing the No. 8 (2.36 mm) sieve.

Subsection 502.14 – Lot Sizes (11/07), Pages 232 and 233.

Delete the first sentence of the first paragraph and substitute the following.

A lot is a segment of continuous production of asphaltic concrete mixture from the same job mix formula produced for the Department at a specific plant, delivered to a specific DOTD project.

SECTION 508 – STONE MATRIX ASPHALT:

Subsection 508.01 – Description (09/07), Page 274.

Delete this subsection and substitute the following.

508.01 DESCRIPTION. This work consists of furnishing and constructing Stone Matrix Asphalt (SMA) which is a plant mixed asphalt concrete wearing course for high traffic applications. This mixture is a rut resistant hot mix design with stone on stone contact. The mixture shall be composed of a PG 76-22m, or PG 82-22rm asphalt cement and a gap graded coarse aggregate structure. Mineral filler and/or fibers shall be used to control draindown. This work shall be in accordance with these specifications, plan details, and as directed. All requirements of Section 502 apply to Stone Matrix Asphalt, except as modified herein. All plant and paving equipment and processes must meet the requirements of Section 503.

Mixture used for shoulder may be Stone Matrix Asphalt or any mixture type shown in Table 502-5.

Subsection 508.02 – Materials (09/07), Page 274.

Delete the contents of subheading (a), Asphalt Cement and substitute the following.

(a) Asphalt Cement: Asphalt cement shall be PG 76-22m, or PG 82-22rm as listed on QPL 41 and complying with Section 1002.

PART VI – RIGID PAVEMENT

**SECTION 602 – PORTLAND CEMENT CONCRETE PAVEMENT
REHABILITATION:**

Subsection 602.17 – Payment (09/07), Pages 341 – 344.

Delete the last paragraph of Subheadings (d), Full Depth Corner Patching of Jointed Concrete Pavement, (e) Full Depth Patching of Jointed Concrete Pavement, and (g) Patching Continuously Reinforced Concrete Pavement, and substitute the following.

Payment for deteriorated base course removed as directed by the engineer and replaced with concrete will be made as follows: The value per inch (mm) thickness will be determined by dividing the contract unit price per square yard (sq m) by the plan thickness. Thickness of patches will be measured from the surface that exists at the time of patching. Payment for the additional thickness will be made at 50 percent of the value per inch (mm) thus determined.

PART VII – INCIDENTAL CONSTRUCTION

SECTION 701 – CULVERTS AND STORM DRAINS:

All Subsections within Section 701 (08/07), Pages 347 – 358.

Delete Section 701, Culverts and Storm Drains and substitute the following.

SECTION 701
CULVERTS AND STORM DRAINS

701.01 DESCRIPTION. This work consists of furnishing, installing, and cleaning pipe, pipe arch, storm drains and sewers, also referred to as culverts or conduit, in accordance with these specifications and in conformity with lines and grades shown on the plans or established.

701.02 MATERIALS. Materials shall comply with the following sections and subsections:

Usable Soil	203.06(a)
Selected Soil	203.06(b)
Plastic Soil Blanket	203.10
Mortar	702.02
Flowable Fill	710
Portland Cement Concrete	901
Reclaimed Asphaltic Pavement (RAP)	1003.01 & 1003.04(d)
Stone	1003.03(b)
Recycled Portland Cement Concrete	1003.03(c)
Granular Material	1003.07
Bedding Material	1003.08
Concrete Sewer Pipe	1006.02
Reinforced Concrete Pipe	1006.03
Reinforced Concrete Pipe Arch	1006.04
Gasket Materials	1006.06
Plastic Pipe	1006.07
Split Plastic Coupling Bands	1006.07(d)(4)
Plastic Yard Drain Pipe	1006.09
Bituminous Coated Corrugated Steel Pipe and Pipe Arch	1007.02
Structural Plate for Pipe, Pipe Arch and Arch	1007.04
Corrugated Aluminum Pipe and Pipe Arch	1007.05
Coupling Bands	1007.09
Reinforcing Steel	1009
Geotextile Fabric	1019

(a) Side Drain Pipe or Side Drain Pipe Arch: When the item for Side Drain Pipe or Side Drain Pipe Arch is included in the contract, the contractor has the option of furnishing reinforced concrete pipe or reinforced concrete pipe arch, corrugated metal pipe or corrugated metal pipe arch, or plastic pipe, as allowed by EDSM II.2.1.1 or unless otherwise specified.

(b) Cross Drain Pipe or Cross Drain Pipe Arch: When the item for Cross Drain Pipe or Cross Drain Pipe Arch is included in the contract, the contractor has the option of furnishing reinforced concrete pipe or reinforced concrete pipe arch, corrugated metal pipe or corrugated metal pipe arch, or plastic pipe, as allowed by EDSM II.2.1.1 or unless otherwise specified.

(c) Storm Drain Pipe or Storm Drain Pipe Arch: When the item for Storm Drain Pipe or Storm Drain Pipe Arch is included in the contract, the contractor has the option of furnishing reinforced concrete pipe or reinforced concrete pipe arch, or plastic pipe, as allowed by EDSM II.2.1.1 or unless otherwise specified.

(d) Yard Drain Pipe: When the item for Yard Drain Pipe is included in the contract, the contractor has the option of furnishing concrete sewer pipe, plastic yard drain pipe or plastic pipe in accordance with Section 1006 unless otherwise specified.

(e) Material Type Abbreviations:

(1) Reinforced Concrete Pipe:

RCP	Reinforced Concrete Pipe
RCPA	Reinforced Concrete Pipe Arch

(2) Corrugated Metal Pipe:

CAP	Corrugated Aluminum Pipe
CAPA	Corrugated Aluminum Pipe Arch
CMP	Corrugated Metal Pipe
CMPA	Corrugated Metal Pipe Arch
CSP	Corrugated Steel Pipe
CSPA	Corrugated Steel Pipe Arch
BCCSP	Bituminous Coated Corrugated Steel Pipe
BCCSPA	Bituminous Coated Corrugated Steel Pipe Arch

(3) Plastic Pipe:

PP	Plastic Pipe
PVCP	Polyvinyl Chloride Pipe
RPVCP	Ribbed Polyvinyl Chloride Pipe
CPEPDW	Corrugated Polyethylene Pipe Double Wall

(f) Joint Type Abbreviations:

T1	Type 1 Joint
T2	Type 2 Joint
T3	Type 3 Joint

(g) Quality Assurance for Pipe: Manufacturing plants will be periodically inspected for compliance with specified manufacturing methods, and material samples will be randomly obtained for laboratory testing for verification of manufacturing lots. Materials approved at the manufacturing plant will be subject to visual acceptance inspections at the jobsite or point of delivery.

701.03 EXCAVATION. For all pipe, when the sides of the trench are stable as evidenced by the sides of the trench being able to maintain a vertical cut face, the minimum trench width at the bottom of the excavation will be 18 inches (460mm) on either side of the outside diameter of the pipe. If the sides of the trench are unstable, the width of the trench at the bottom of the excavation, for plastic or metal pipe, shall be a minimum width of at least 18 inches (460mm) or one pipe diameter on each side of the outside diameter of the pipe, which ever is greater. Surplus material or excavated material that does not conform to the requirements of Subsection 203.06(a) shall be satisfactorily disposed of in accordance with Subsection 202.02. Moisture controls

Supplemental Specifications (August 2008)

Page 8 of 30

including backfill materials selection and dewatering using sumps, wells, well points or other approved processes may be necessary to control excess moisture during excavation, installation of bedding, over-excavated trench backfilling, pipe placement and pipe backfill.

(a) Over-excavation: When unsuitable soils as defined in Subsection 203.04 or a stable, non-yielding foundation cannot be obtained at the established pipe grade, or at the grade established for placement of the bedding, unstable or unsuitable soils below this grade shall be removed and replaced with granular material meeting the requirements of Subsection 1003.07, bedding materials meeting the requirements of Subsection 1003.08 or Type A backfill. All granular, backfill materials placed below the established pipe or bedding grade shall be placed in lifts not exceeding 8 inches (200 mm) thick and sufficiently compacted by hand or a dynamic mechanical hand compaction device over the surface of each lift to form a stable, non-yielding foundation at the surface of the established bedding or pipe grade.

When rock is encountered, it shall be removed below grade and replaced with material complying with Subsection 1003.07, bedding materials meeting the requirements of Subsection 1003.08 or Type A backfill. The compacted earth cushion shall have a thickness under the pipe of at least 1/2 inch per foot (40 mm/m) of fill height over the top of the pipe with a minimum thickness of 8 inches (200 mm). All granular, backfill materials placed below the established pipe or bedding grade shall be placed in lifts not exceeding 8 inches (200 mm) thick and sufficiently compacted by hand or a dynamic mechanical hand operated compaction device over the surface of each lift to form a stable, non-yielding foundation at the surface of the established bedding or pipe grade.

Materials used to backfill in an over-excavated portion of a trench do not require encasement in a Geotextile Fabric.

Density of approved materials placed in over-excavated trenches will not be measured or determined.

701.04 FORMING PIPE BED. Bedding material, when specified, shall be constructed in accordance with Section 726. Materials allowed for bedding shall be as specified in Subsection 1003.08 or may be Type A backfill materials. When bedding materials are specified, additional excavation shall be performed below established pipe grade and the bedding material placed in lifts not exceeding 8 inches (200 mm) thick and lightly compacted by hand or a dynamic hand compaction device over the surface of each lift.

When the bottom of the pipe is not laid in a trench but is constructed above natural soils, a uniform bed shall be constructed as specified for the bottom of a trench.

Density of approved bedding materials will not be measured or determined.

701.05 LAYING PIPE. Pipe laying shall begin at the downstream end of the line. The pipe shall be in contact with the foundation throughout its length. Bell or groove ends of pipe and outside circumferential laps of riveted metal pipe shall be placed facing upstream. Riveted seam metal pipe shall be placed with longitudinal laps at sides. Pipes in each continuous line shall have the same wall thickness. Metal pipes provided with lifting lugs shall be handled only by these lugs.

After pipe has been laid and before backfill is placed, the engineer will inspect the pipe for alignment, grade, integrity of joints, and coating damage.

701.06 JOINING PIPE.

(a) Joint Usage:

(1) Type 1 (T1) joints shall be used for side drains under drives and similar installations.

(2) Type 2 (T2) joints shall be used for cross drains under roadways, including turnouts.

(3) Type 3 (T3) joints shall be used for closed storm drain systems, flumes and siphons.

(b) Concrete Pipe: Concrete pipe may be either bell and spigot, or tongue and groove. The method of joining pipe sections shall be such that ends are fully entered and inner surfaces are flush and even.

An approved mechanical pipe puller shall be used for joining pipes over 36 inches (900 mm) in diameter. For pipe 36 inches (900 mm) or less in diameter, any approved method for joining pipe may be used which does not damage the pipe.

Joints shall comply with Subsection 1006.05, and shall be sealed with gasket material installed in accordance with the manufacturer's recommendations.

(c) Metal Pipe: Metal pipe shall be firmly joined by coupling bands. Bands shall be centered over the joint.

For Type 1 joints, approved gasket material shall be placed in one corrugation recess on each side of the joint at the coupling band and on each band connection in such manner to prevent leakage.

When Type 2 or 3 joints are specified, joining of metal pipe sections shall conform to the following provisions:

(1) General: Band joints shall be sealed with gasket material. Gasket material shall be placed in accordance with the plan details.

(2) Circular Section: Connecting bands shall be of an approved design and shall be installed in accordance with plan details.

(3) Arch Section: Connecting bands shall be a minimum of 12 inches (300 mm) wide for pipe arch less than 36 inches (900 mm) round equivalent diameter, and a minimum of 21 inches (525 mm) wide for 36 inches (900 mm) round equivalent diameter pipe arch and greater. Bands shall be connected at the ends by approved angle or strap connections. Connecting bands used for 36 inches (900 mm) round equivalent diameter pipe arch and above shall be 2-piece bands.

(d) Plastic Pipe: Joints for plastic pipe shall be either bell and spigot or split coupling bands.

(1) Bell and Spigot Type Joint System: The method of joining pipe sections shall be such that ends are fully entered and inner surfaces are flush and even.

Any approved method for joining pipe may be used which does not damage the pipe.

Joints shall be approved and shall be sealed with a gasket system utilizing gasket material complying with Subsection 1006.06(a).

Supplemental Specifications (August 2008)
Page 10 of 30

(2) Split Coupling Type Joint System: Split coupling bands shall comply with all dimensional and material requirements of Subsection 1006.07. The bands shall be centered over the joint. The split coupling band shall be secured to the pipe with a minimum of five stainless steel or other approved corrosion resistant bands.

Joints shall be approved and shall be sealed with gasket material. Gasket material shall be placed in the first two corrugation recesses on each side of the pipe connections. Gasket material shall also be placed on each band connection to prevent leakage. When flexible plastic gasket material is used it shall be a minimum of 1/2 inch (13 mm) in size. The bands shall be tightened to create overlap of the band and shall adequately compress the gasket material.

(e) Connections: Approved connections shall be used when joining new pipes to existing pipes. When concrete collars are required in order to extend the ends of existing pipes that have been damaged or to join different types or sizes of pipes, the concrete collars shall be constructed in accordance with plan details, the applicable requirements of Section 901, and as directed.

(f) Geotextile Fabric, Pipe Joints: For concrete, metal and plastic pipes, Types 2 and 3 joints shall be wrapped with geotextile fabric for a minimum of 12 inches (300 mm) on each side of joint for pipe 36 inches (900 mm) or less in diameter and a minimum of 18 inches (450 mm) on each side of the joint for pipe greater than 36 inches (900 mm) in diameter. Ends of the fabric shall be lapped at least 10 inches (250 mm). The edges and ends of fabric shall be suitably secured for the entire circumference of the pipe.

701.07 RELAYING PIPE. If specified or directed, existing pipes shall be removed and suitable sections relaid as specified for new pipes.

701.08 BACKFILLING.

(a) General: Prior to backfilling, pipes found to be damaged or out of alignment or grade shall be removed and reinstalled, or replaced.

Type A backfill material shall be stone, recycled portland cement concrete, flowable fill, or RAP.

Type B backfill materials are selected soils. Where Type B backfill materials are called for, Type A backfill materials may be substituted.

When corrugated metal pipe is used, the backfill material shall be tested and shall have a resistivity greater than 1500 ohm-cm and a pH greater than 5 when tested in accordance with DOTD TR 429 and DOTD TR 430 respectively.

When Type A backfill material is used, geotextile fabric surrounding this backfill shall be placed in accordance with Subsection 726.03 between the aggregate backfill material and all other natural or placed soils in the trench or embankment. Care shall be taken to prevent damage to geotextile fabric during placement of backfill material. For concrete pipe, the fabric shall enclose not only the initial backfill but shall be wrapped over the top of the pipe with at least 12 inches (300 mm) of overlap.

When a trench box or trench sheeting is used in unstable soils and/or for worker safety, and when moved during backfilling operations, filling and additional compaction of the disturbed zone of backfill must take place immediately and in a manner acceptable to the engineer.

Initial backfill is a structural backfill encasing the pipe from the bottom of the pipe to the springline for concrete pipe and to a point one foot (0.3 m) above the top of the pipe for both metal and plastic pipe. Final backfill is not a structural backfill and shall extend from the top of the initial backfill to the top of the natural ground or subgrade in cut areas or to the top of existing ground in fill areas. Any fill required above the final backfill is considered and treated as embankment.

(b) Backfill Applications: For projects using A+B+C bidding method where rigid and flexible pavement alternates are considered, backfill application (2) below, "Cross Drains Under Flexible Pavements", shall apply for either rigid or flexible pavements.

(1) Under Concrete Pavements: Type B backfill may be used as initial and final backfill for all pipes, culverts or drains under concrete pavements. Placement and compaction shall be as specified in Heading (d) below.

(2) Cross Drains Under Flexible Pavements: All reaches, exclusive of those portions of the pipe which are under shoulders, of cross drains and all other culverts, pipes or drains that cross the centerlines of the new roadway or centerlines of existing roadways, such as intersections and are under flexible pavements shall receive an initial backfill of Type A material. Type B backfill materials may be used as final backfill for all pipes. Placement and compaction shall be as specified in Heading (c) and (d) below. Where the subgrade is above existing ground, embankment material as specified for the remainder of the project shall be used from the top of the final backfill to the top of the established embankment grade.

(3) Other Drains Under Flexible Pavements: All reaches of all culverts, pipes or drains under flexible pavements that do not cross the centerlines of new roadway or centerlines of existing roadways, and exclusive of those portions of the pipe which are totally under shoulders, shall receive an initial and final backfill of Type B material. Placement and compaction shall be as specified in Heading (d) below. Where the subgrade is above existing ground, embankment material as specified for the remainder of the project shall be used from the top of the final backfill to the top of the established embankment grade.

(4) Other Areas: All culverts, pipes or drains in nonpaved areas or paved areas that serve as driveways or shoulders shall receive an initial and final backfill of Type B material. Placement and compaction shall be as specified in Heading (d) below.

(5) Pipes Subject to Construction Traffic; The embankment or pipe backfill shall be constructed to a minimum of 24 inches (600 mm) over the pipe before heavy construction equipment is allowed to cross the installation. Where practical, installations with less than 24 inches (600 mm) of cover over the top of the pipe shall be constructed after heavy hauling is completed over the pipe location. After completion of hauling operations, the contractor shall remove excess cover material. Pipe damaged by hauling and backfilling operations shall be removed and reinstalled, or replaced, at no direct pay.

(c) Placement and Compaction; Type A Backfill: For all pipes, culverts and conduits under paved and nonpaved areas, where Type A backfill material is used, the Type A backfill shall be thoroughly hand compacted under the pipe haunches and then dynamically compacted in layers not exceeding 8 inches (200 mm) compacted thickness. Compaction under the haunches of the pipe shall initially be by hand tamping or other acceptable means, until a level is reached that the dynamic tamping can commence. Each lift shall be compacted by applying at least eight

Supplemental Specifications (August 2008)

Page 12 of 30

passes of a hand operated, dynamic mechanical compaction device over the surface of each lift. With approval of the engineer, layer thickness may be increased to 12 inches (300 mm) with verification of satisfactory installation and performance. If flowable fill is used it shall be furnished, placed and consolidated in accordance with Section 710. The contractor shall control placement operations during initial backfill operations so as not to damage protective coatings on metal pipes. The contractor shall repair damaged coatings at no additional pay.

(d) Placement and Compaction; Type B Backfill: For all pipes, culverts and conduits, where Type B backfill is allowed, the Type B material shall be placed in layers not exceeding 8 inches (200 mm) compacted thickness. Compaction shall be with suitable mechanical equipment. With approval of the engineer, layer thickness may be increased to 12 inches (300 mm) with verification of satisfactory installation and performance.

(e) Placement and Compaction; Trenchless or Partial Trench Condition: All pipes, culverts, drains and conduits placed with any portion of the pipe above existing ground must also comply with Subsections (a),(b) (c) and (d) above for the portion of the pipe within a trench and that portion of the pipe not constructed in a trench. The width of initial and final backfill of that portion above existing ground and not within a trench will be constructed to such a width that the requirements for placement, compaction and density are met.

(f) Density Requirements: The in place density of Type A backfill materials and bedding materials, will not be measured or determined. Type A backfill, exclusive of RAP and flowable fill, shall be placed at or near optimum moisture content determined in accordance with DOTD TR 415 or 418. RAP materials shall be placed and compacted in a slightly moist condition.

The maximum dry density of initial or final Type B backfill under all paved areas which are to be under traffic will be determined in accordance with DOTD TR 415 or TR 418 and in-place density determined in accordance with DOTD TR 401. Initial and final Type B backfill under all paved areas, under traffic, shall be placed at or near optimum moisture content determined in accordance with DOTD TR 415 or TR 418. Each layer shall be compacted by approved methods prior to the placement of a subsequent layer. The engineer will approve the compaction method based upon validation that such method, including moisture control, will achieve at least 95 percent of maximum dry density as determined in accordance with DOTD TR 401. With approval of the engineer, density testing may be waived on subsequent layers with backfill installation in accordance with approved compaction methods and continued satisfactory performance.

Initial and final backfill in unpaved areas or paved areas such as shoulders or driveways, shall be placed evenly and compacted along the length of the culvert, pipe or drain from the top of the initial backfill to the top of the subgrade. Layered backfill shall be compacted at least to the density of the adjoining existing soils or the compaction required of the laterally adjoining layers of soil immediately outside the trench for embankment elevations. Initial and final backfill shall be placed and compacted at or near optimum moisture content determined in accordance with DOTD TR 415 or TR 418.

701.09 INSPECTION OF PIPES. After completion of embankment and prior to roadway surfacing, the engineer shall inspect pipes for proper alignment and integrity of joints. Any misaligned pipe or defective joints shall be corrected by the contractor at no direct pay.

(a) Plastic Pipe: Installed plastic pipe shall be tested to ensure that vertical deflections do not exceed 5.0 percent. Maximum allowable deflections shall be governed by the mandrel requirements stated herein.

Deflection tests shall be performed no sooner than 30 calendar days after installation and compaction of backfill. The pipe shall be cleaned and inspected for offsets and obstructions prior to testing.

For pipe 36 inches (900 mm) and less in diameter, a mandrel shall be pulled through the pipe by hand to ensure that maximum allowable deflections have not been exceeded. The mandrel shall be approved by the engineer prior to use. Use of an unapproved mandrel or a mandrel altered or modified after approval will invalidate the test. If the mandrel fails to pass, the pipe is overdeflected.

Unless otherwise permitted, overdeflected pipe shall be uncovered and, if not damaged, reinstalled. Damaged pipe shall not be reinstalled, but shall be removed and replaced with new pipe. Any pipe subjected to any method or process other than removal, which attempts, even successfully, to reduce or cure any overdeflection, shall be removed and replaced with new pipe.

The mandrel shall be a rigid, nonadjustable, odd-numbered legged (minimum 9 legs) mandrel having a length not less than its nominal diameter or 24 inches (600 mm), whichever is less. The minimum diameter at any point shall be 5.0 percent less than the base inside diameter of the pipe being tested. The mandrel shall be fabricated of steel, aluminum or other approved material fitted with pulling rings at each end. The nominal pipe size and outside diameter of the mandrel shall be stamped or engraved on some segment other than a runner. A suitable carrying case shall be furnished.

For pipe larger than 36 inches (900 mm) in diameter, deflection shall be determined by a method approved by the engineer. If a mandrel is selected, the minimum diameter, length, and other requirements shall conform to the above requirements.

Mandrel testing shall be conducted by the contractor in the presence of the engineer. Mandrel testing shall be at no direct pay.

(b) Metal Pipe: If the inside diameter of metal pipe or rise dimension of metal pipe arch deflects more than 5.0 percent from original dimensions, they shall be removed and reinstalled, unless they do not rebound or are damaged. Pipe or pipe arch which are damaged or do not rebound shall be removed and replaced at no direct pay. Measurement of deflection will be made by the engineer away from rerolled ends.

701.10 CLEANING PIPES.

(a) Existing Pipes: Pipes designated to be cleaned shall be cleaned of soil, debris and other materials to the invert of the pipe. Designated pipes shall be cleaned by approved methods that will not damage the pipes. Any damage caused by the contractor's operations shall be satisfactorily repaired at no direct pay.

Removed soil, debris and other materials shall be disposed of in accordance with Subsection 202.02 or as otherwise approved in writing.

(b) Contractor Installed Pipes: Prior to final acceptance, pipes shall be cleaned of all debris and soil to the invert of the pipe at no direct pay.

Supplemental Specifications (August 2008)
Page 14 of 30

Removed soil, debris and other materials shall be disposed of in accordance with Subsection 202.02 or as otherwise approved in writing.

701.11 STUBBING AND PLUGGING PIPES. When it is required that pipes be plugged, such plugs shall be constructed of Class R concrete complying with Section 901. Thickness of plug and method of construction shall be as directed.

When new pipes are to be stubbed into new or existing pipes or other structures, the connection shall be made with approved mortar complying with Subsection 702.02.

701.12 MEASUREMENT. Pipe, both new and relaid, will be measured in linear feet (lin m) as follows unless stated otherwise.

(a) Pipe not confined by fixed structures will be measured by the number of joints at the nominal length of each joint.

(b) Pipe confined by fixed structures will be measured along the pipe between the termini of pipe in structure walls.

(c) Pipe confined by a fixed structure on one end and unconfined at the other end will be measured along the pipe from the terminus of pipe in the structure wall to the unconfined end of pipe.

(d) Fabricating of pipe tees, elbows and other fittings will be measured per each fitting. The length of pipe in such fittings will be included in the pay length measurement of pipes of which they form a part.

(e) Excavation required for installation of pipes will not be measured for payment, except as otherwise specified in Subsection 203.14.

(f) Furnishing and placing backfill material below existing ground level for pipes will not be measured for payment. Backfill material needed to complete backfill above natural ground and around pipes that extend above natural ground will be measured and payment will be made under applicable earthwork items. When specified, flowable fill will be measured and paid for in accordance with Section 710.

(g) Plugging and stubbing of pipes will not be measured for payment.

(h) Cleaning existing pipes will be measured by the length of pipe cleaned and accepted.

(i) Concrete collars will be measured per each.

701.13 PAYMENT.

(a) Payment for pipe will be made at the contract unit price per linear foot (lin m) of the types and sizes specified.

When plastic pipe is specified on the plans or elected to be used by the contractor, payment will be made at the contract unit price per linear foot (lin m) of the types and sizes specified in accordance with the payment schedule of Table 701-1.

Table 701-1
Payment Schedule for Plastic Pipe

Percent Payment	Stage of Completeness
75	After placement and backfill has been completed
25	After the pipe has met vertical deflection requirements in accordance with Subsection 701.09(a)

(b) Payment for fabricating pipe tees, elbows and other fittings will be made at the contract unit price per each fitting.

(c) When unstable conditions are encountered, the additional excavation will not be measured for payment; however, the additional materials furnished and placed for the pipe foundation will be measured and paid for as follows:

(1) Granular Materials: Payment will be made under the embankment item. The net section volume of the materials will be multiplied by 3 to determine the pay volume. When the contract does not include a pay item for embankment, payment will be made in accordance with Subsection 104.02.

(2) Bedding Material: Measurement and payment will be made in accordance with Section 726. When the contract does not include a pay item for bedding material, payment will be made in accordance with Subsection 104.02.

(d) Payment for cleaning existing pipes will be made at the contract unit price per linear foot (lin m).

(e) Payment for concrete collars will be made at the contract unit price per each.

Payment will be made under:

Item No.	Pay Item	Pay Unit
701-01	Cross Drain Pipe (Size & Type)	Linear Foot (Lin m)
701-02	Cross Drain Pipe Arch (Size & Type)	Linear Foot (Lin m)
701-03	Storm Drain Pipe (Size & Type)	Linear Foot (Lin m)
701-04	Storm Drain Pipe Arch (Size & Type)	Linear Foot (Lin m)
701-05	Side Drain Pipe (Size)	Linear Foot (Lin m)
701-06	Side Drain Pipe Arch (Size)	Linear Foot (Lin m)
701-07	Yard Drain Pipe (Size)	Linear Foot (Lin m)
701-08	Relaying Pipe	Linear Foot (Lin m)
701-09	Fabricating Pipe Fittings	Each
701-10	Reinforced Concrete Pipe (Extension)	Linear Foot (Lin m)
701-11	Reinforced Concrete Pipe Arch (Extension)	Linear Foot (Lin m)
701-12	Corrugated Metal Pipe (Extension)	Linear Foot (Lin m)
701-13	Corrugated Metal Pipe Arch (Extension)	Linear Foot (Lin m)

Supplemental Specifications (August 2008)

Page 16 of 30

701-14	Cleaning Existing Pipes	Linear Foot (Lin m)
701-15	Concrete Collar	Each
701-16	Plastic Pipe (Extension)	Linear Foot (Lin m)

SECTION 704 – GUARD RAIL:

Subsection 704.03 – General Construction Requirements (01/05), Pages 368 and 369.

Add the following to Heading (d), Guard Rail End Treatments.

All end treatments shall bear a label indicating the manufacturer and exact product name of the end treatment along with its assigned NCHRP 350 test level. This label shall resist weathering and shall be permanently affixed to the railing in such a way as to be readily visible.

SECTION 706 – CONCRETE WALKS, DRIVES AND INCIDENTAL PAVING:

All Subsections within Section 706 (04/08), Pages 375 – 377.

Delete Section 706, Concrete Walks, Drives and Incidental Paving and substitute the following.

SECTION 706 CONCRETE WALKS, DRIVES AND INCIDENTAL PAVING

706.01 DESCRIPTION. This work consists of furnishing and constructing portland cement concrete walks, handicapped curb ramps, drives and incidental paving slabs in accordance with these specifications and in conformity with lines, grades and dimensions shown on the plans or established.

706.02 MATERIALS. Materials shall comply with the following Section or Subsections.

Portland Cement Concrete (Class M)	901
Joint Filler	1005.01(c)
Reinforcing Steel	1009.01
Curing Materials	1011.01

706.03 CONSTRUCTION REQUIREMENTS.

(a) Excavation: Excavation shall be made to required depth and width. The top of the subgrade shall be shaped and compacted to a firm, even surface conforming to the section shown on the plans. Unsuitable material shall be removed and disposed of in accordance with Subsection 202.02 and replaced with approved material at no direct pay.

(b) Forms: Forms shall be of wood or metal and shall extend the full depth of concrete. Forms shall be straight, clean and of sufficient strength to resist the pressure of concrete. Bracing of forms shall be such that forms remain in horizontal and vertical alignment until their removal.

Concrete may be placed by slip-form methods. Slip-formed concrete shall be placed with an approved machine designed to spread, vibrate, consolidate and finish concrete in one pass of the machine in such manner that minimum hand finishing is necessary. Sliding forms shall be

rigidly held together to prevent spreading of forms. After the passing of the side forms there shall be no noticeable slumping of concrete.

(c) Subgrade: The subgrade shall be thoroughly moistened immediately prior to placing concrete.

(d) Placing and Finishing: Concrete shall be placed on the subgrade, struck off to required thickness and tamped sufficiently to bring the mortar to the surface. The surface shall be finished with a wood float or steel trowel followed by brushing to a slightly rough finish. Joints and edges shall be rounded with an edging tool having a 1/4-inch (6 mm) radius.

(e) Joints:

(1) Expansion Joints: Expansion joints shall be filled with 1/2 inch (13 mm) thick preformed expansion joint filler. Expansion joints shall be installed at maximum 100-foot (30 m) intervals, and between intersecting paving and any fixed structure such as a building, bridge or curbing, and between intersecting paving and the handicapped curb ramps. Expansion joint material shall extend for the full width and depth of paving.

(2) Weakened Plane: Weakened planes shall be formed by a jointing tool or other acceptable means. Weakened planes shall extend into concrete for at least 1/4 of the depth and shall be approximately 1/8 inch (3 mm) wide.

a. Walks: Spacing of weakened planes for walks shall be equal to the width of walk.

b. Drives: A longitudinal weakened plane shall be formed along the centerline of drives more than 16 feet (5 m) wide, and transverse weakened planes shall be formed at not more than 16-foot (5 m) intervals.

c. Incidental Paving: Weakened planes for incidental paving shall be formed at intervals not exceeding 30 times the thickness of the concrete in length or width. Incidental paving poured adjacent to jointed concrete shall be jointed to match existing joints, with intermediate joints formed as necessary not to exceed the maximum joint spacing.

(3) Construction Joints: Construction joints shall be formed around manholes, utility poles, etc., extending into paving and 1/4 inch (6 mm) thick preformed expansion joint filler shall be installed in these joints.

(4) Tie-ins: Tie-ins of existing concrete shall be made by full depth sawing at no direct pay.

(f) Curing: Concrete shall be cured in accordance with Subsection 601.10.

(g) Detectable Warning Surface for Handicap Ramps and At-Grade Sidewalk Intersections: Sidewalks, when intersecting with roadways, shall be equipped with a detectable warning surface system consisting of raised truncated domes as a transition between the sidewalk and the street as required by the Americans with Disabilities Act, 28 CFR Part 36, ADA Standards for Accessible Design.

Detectable warnings (truncated domes) shall be installed on the ramp surface over the full width of the ramp throat for a distance of 24 inches (600 mm) in the direction of travel from the back of the curb. Detectable warnings (truncated domes) shall also be installed on at-grade sidewalks intersecting with roadways for a distance of 36 inches (900 mm) in the direction of travel from the end of the sidewalk. Truncated domes shall be laid out on a square grid in order to allow enough space for wheelchairs to roll between the domes.

Supplemental Specifications (August 2008)
Page 18 of 30

Light reflectance of the truncated domes and the underlying surface must meet the 70 percent contrast requirement of ADAAG.

706.04 MEASUREMENT. Quantities of concrete walks, drives and incidental paving slabs for payment will be the design quantities as specified on the plans and adjustments thereto. Design quantities will be adjusted if the engineer makes changes to adjust to field conditions, if design errors are proven or if design changes are made. Design areas are based on the horizontal dimensions shown on the plans. Excavation, backfill, reinforcing steel and joint materials will not be measured for payment.

Handicapped curb ramps, including the detectable surface warning system, will be measured per each.

Detectable surface warning systems for at-grade sidewalk intersection will not be measured for payment.

706.05 PAYMENT. Payment for concrete walks, drives and incidental paving will be made on a lot basis at the contract unit price per square yard (sq m), adjusted in accordance with the following provisions. Payment for each lot will be made in accordance with Table 901-6. Size, sampling, and testing of each concrete lot shall be in accordance with the Materials Sampling Manual.

Payment for handicapped curb ramps, including the detectable surface warning system, will be made by each and shall include, but not limited to, curb transitions, detectable warning system, gutter, landing and base.

Payment will be made under:

Item No.	Pay Item	Pay Unit
706-01	Concrete Walk (inch (mm) Thick)	Square Yard (Sq m)
706-02	Concrete Drive (inch (mm) Thick)	Square Yard (Sq m)
706-03	Incidental Concrete Paving (inch (mm) Thick)	Square Yard (Sq m)
706-04	Handicapped Curb Ramps	Each

SECTION 713 – TEMPORARY TRAFFIC CONTROL:

Subsection 713.06 – Pavement Markings (08/06), Pages 400 – 403.

Delete Table 713-1, Temporary Pavement Markings and substitute the following.

Table 713-1
Temporary Pavement Markings^{1,2}

		Two-lane Highways	Undivided Multilane Highways	Divided Multilane Highways
S H O R T T E R M	ADT<1500; or ADT>1500 and time<3 days	Lane lines 4-foot (1.2 m) tape on 40-foot (12 m) centers; with "Do Not Pass" and "Pass With Care" signs as required		
	ADT>1500; Time>3 days and<2 weeks	Lane lines 4-foot (1.2-m) tape on 40-foot (12-m) centers with no passing zone markings		
	All ADT's with time <2 weeks		Lane lines 4-foot (1.2m) tape on 40-foot (12 m) centers; double yellow centerline	Lane lines 4-foot (1.2 m) tape on 40-foot (12 m) centers
L O N G T E R M	All ADT's with time >2 weeks	Standard lane lines, no-passing zone markings, legends and symbols and when pavement width is 22 feet (6.7 m) or greater, edge lines	Standard lane lines, centerlines, edge lines, and legends and symbols	Standard lane lines, centerlines, edge lines, and legends and symbols.

¹No-passing zones shall be delineated as indicated whenever a project is open to traffic.

²On all Asphaltic Surface Treatments that are open to traffic and used as a final wearing course or as an interlayer, temporary pavement markings (tabs) on 20-foot (6 m) centers shall be used, in lieu of the 4-foot (1.2 m) tape, on 40-foot (12 m) centers.

SECTION 729 – TRAFFIC SIGNS AND DEVICES:

Subsection 729.02 – Materials (04/08), Pages 456 and 457.

Delete the contents of Heading (a), Sign and Marker Sheeting, and substitute the following.

(a) Sign and Marker Sheeting: Sheeting material for sign panels, delineators, barricades and other markers shall comply with Section 1015. All permanent signs shall meet the requirements of ASTM D 4956, Type X.

Supplemental Specifications (August 2008)
Page 20 of 30

Subsection 729.04, Fabrication of Sign Panels and Markers (04/08), Pages 458 – 460.

Delete the third paragraph of Heading (c), Sheeting Application and substitute the following.

ASTM D 4956 Type X reflective sheeting shall be applied with an orientation determined by the engineer to obtain the optimum entrance angle performance. Fabricated vertical splices in ASTM D 4956 Type X reflective sheeting will be allowed only when the horizontal dimension of the sign face or attached shield is in excess of the maximum manufactured width of the sheeting. Fabricated vertical splices in ASTM D 4956 Type X reflective sheeting will also be allowed when the specified orientation will create excessive sheeting waste.

SECTION 804 – DRIVEN PILES:

Subsection 804.08 – Construction Requirements (04/07), Pages 548 – 554.

Delete the first sentence of Heading (a), Preboring and substitute the following.

Preboring by augering, wet-rotary drilling, or other methods used to facilitate pile driving will not be permitted unless specified in the plans or allowed by the engineer.

Delete the first sentence of Heading (b), Jetting and substitute the following.

Jetting will not be permitted unless allowed in the plans or allowed by the engineer.

SECTION 901 – PORTLAND CEMENT CONCRETE:

Subsection 901.06 – Quality Control of Concrete (08/06), Pages 726 – 731.

Add the following to the contents of Heading (b), Quality Control Tests.

The contractor shall be responsible for monitoring the components (cement, mineral and chemical admixtures, aggregates) in their mix to protect against any changes due to component variations. As component shipments arrive, the contractor shall verify slump, air content and set time by testing at ambient temperatures. The contractor shall make adjustments to the mix design to rectify any changes which would adversely affect constructability, concrete placement or the specifications. The contractor shall submit test results to the Department for review each day of paving. Testing to validate component consistency will be documented on the control logs. Conformance or variation in mix parameters (workability, set times, air content, etc.) shall be noted on the control logs. The contractor shall provide a copy of the proposed testing plan to the engineer for record. Acceptance of the plan does not relieve the contractor's responsibility for consistency.

Subsection 901.08 – Composition of Concrete (12/05), Pages 732 – 734.

Add the following to Heading (a).

The blended cement containing up to 50 percent of grade 100 or grade 120 ground granulated blast-furnace slag must be in compliance with Subsection 1001.04 for portland blast-furnace slag cement.

SECTION 1001 – HYDRAULIC CEMENT:

Subsection 1001.01 – Portland Cement (09/07). Page 749.

Delete the contents of this subsection and substitute the following.

1001.01 PORTLAND CEMENT. Portland cement shall be from an approved source listed in QPL 7 and shall comply with AASHTO M 85.

Alkali content calculated as sodium oxide equivalent shall not exceed 0.60 percent by weight for all types of cement.

SECTION 1003 – AGGREGATES:

Subsection 1003.02 – Aggregates for Portland Cement Concrete and Mortar (07/07).

Pages 763 – 766.

Delete the contents of Heading (c), Aggregates for Types B and D Pavements, and substitute the following.

(c) Aggregates for Types B and D Pavements: For the combined aggregates for the proposed portland cement concrete pavement mix, the percent retained based on the dry weight (mass) of the total aggregates shall meet the requirements of Table 1003-1A for the type of pavement specified in the plans. Additionally, the sum of the percents retained on any two adjacent sieves so designated in the table shall be at least 12 percent of the total combined aggregates. The maximum amounts by weight (mass) of deleterious materials for the total aggregate shall be the same as shown in Subsection 1003.02(b).

Table 1003-1A
Aggregates for Types B and D Pavements

U.S. Sieve	Metric Sieve	Percent Retained of Total Combined Aggregates	
		Pavement Type	
		Type B	Type D
2 1/2 inch	63 mm	0	0
2 inch	50 mm	0	0-20
1 1/2 inch	37.5 mm	0-20	0-20
1 inch	25.0 mm	0-20	5-20
3/4 inch	19.0 mm	5-20	5-20
1/2 inch	12.5 mm	5-20	5-20
3/8 inch	9.5 mm	5-20	5-20
No. 4	4.75 mm	5-20	5-20
No. 8	2.36 mm	5-20	5-20
No. 16	1.18 mm	5-20	5-20
No. 30	600 µm	5-20	5-20
No. 50	300 µm	0-20	0-20
No. 100	150 µm	0-20	0-20
No. 200	75 µm	0-5	0-5
Note: For the sieves in the shaded areas, the sum of any two adjacent sieves shall be a minimum of 12 percent of the total combined aggregates.			

Each type of aggregate to be used in the proposed mixture shall be sampled and tested individually. The percent of total combined aggregates retained shall be determined mathematically based on the proportions of the combined aggregate blend. All gradation calculations shall be based on percent of dry weight (mass).

SECTION 1005 – JOINT MATERIALS FOR PAVEMENTS AND STRUCTURES:

Subsection 1005.04 – Combination Joint Former/Sealer (11/05), Pages 782 and 783.

Delete Heading (a) and substitute the following.

(a) Description: This joint former/sealer is intended for use in simultaneously forming and sealing a weakened plane in portland cement concrete pavements.

The material shall consist of an elastomeric strip permanently bonded either mechanically or chemically at the top of each of two rigid plastic side frames and covered with a removable plastic top cap. Side frames shall be of such configuration that when the sealer is inserted into plastic concrete and vibrated, a permanent bond forms between side frames and concrete.

Delete Heading (b)(1) and substitute the following.

(1) Elastomer: The elastomer strip portion of the material shall be manufactured from vulcanized elastomeric compound using polymerized chloroprene or thermoplastic vulcanizate as the base polymer, and shall comply with the following requirements:

<u>Property</u>	<u>ASTM Test Method</u>	<u>Requirements</u>	
		<u>Polymerized Chloroprene</u>	<u>Thermoplastic Vulcanizate</u>
Tensile Strength, kPa, Min.	D 412	12,400	7,400
Elongation at Break, % Min.	D 412	200	400
Hardness, Shore A	D 2240	65 ± 10	65 ± 10
Properties after Aging, 70 h @ 100°C	D 573		
Tensile Strength, % Loss, Max.		20	20
Elongation, % loss, Max.		25	25
Hardness, pts. increase, Max.		10	10
Ozone Resistance, 20% strain or bentloop, 300 pphm in air, 70 h @ 40°C	D 1149	no cracks	no cracks
Oil Swell, IRM 903, 70 h @ 100°C, wt change, % Max.	D 471	45	75

Delete Headings (b)(2) and (b)(3) and substitute the following:

(2) Bond of Elastomer to Plastic: The force required to shear the elastomer from the plastic shall be a minimum of 5.0 pounds per linear inch (90 g/mm) of sealer when tested in accordance with DOTD TR 636.

(3) Bond of Plastic to Cement Mortar: This bond will be evaluated and shall meet the following requirements:

The force required to separate the cement mortar from the plastic shall be a minimum of 5.0 pounds per linear inch (90 g/mm) of sealer when tested in accordance with DOTD TR 636.

SECTION 1006 – CONCRETE AND PLASTIC PIPE:

Subsection 1006.09 – Plastic Yard Drain Pipe (06/07), Page 789.

Delete the contents of Subheading (a)(3), Ribbed Polyvinyl Chloride Pipe (RPVCP) and substitute the following.

Ribbed Polyvinyl Chloride Pipe (RPVCP): Ribbed Polyvinyl Chloride Pipe shall comply with ASTM F 794, Series 46 or ASTM F 949 (46 psi).

SECTION 1013 – METALS:

Subsection 1013.09 – Steel Piles (08/06) Page 822.

Delete the title and references to “Steel Piles” in this subsection and substitute “Steel H Piles”.

SECTION 1015 – SIGNS AND PAVEMENT MARKINGS:

Subsection 1015.04 – Sign Panels (05/07), Pages 832 and 833.

Delete the contents of Heading (a), Permanent Sign Panels and substitute the following.

Supplemental Specifications (August 2008)
Page 24 of 30

(a) Permanent Sign Panels: Flat panels shall be aluminum sheets or plates complying with ASTM B 209, Alloy 6061-T6 or Alloy 5052-H38. Extruded aluminum panels shall comply with ASTM B 221 (ASTM B 221M), Alloy 6063-T6 and after fabrication, have a flatness equal to or less than 0.031 inch per foot of length and 0.004 inch per inch of width.

Subsection 1015.05 - Reflective Sheeting (04/08), Pages 833 – 838.

Delete the contents of this subsection and substitute the following.
1015.05 REFLECTIVE SHEETING.

(a) Permanent and Temporary Standard Sheeting: Reflective sheeting shall be one of the following standard types as specified on the plans and complying with ASTM D 4956 except as modified herein. Permanent warning, regulatory, guide and supplemental guide sign sheeting shall meet the requirements of ASTM D 4956 Type X. Reflective sheeting for temporary signs and devices shall meet the requirements of ASTM D 4956 Type III except as noted in Subsection 1015.05(f). Reflective sheeting shall be an approved product listed in QPL 13.

Type III - A high-intensity retroreflective sheeting that is typically encapsulated glass-bead retroreflective material.

Type VI - An elastomeric high-intensity retroreflective sheeting without adhesive. This sheeting is typically a vinyl microprismatic retroreflective material.

Type X - A super high-intensity retroreflective sheeting having highest retroreflectivity characteristics at medium distances. This sheeting is typically an unmetalized microprismatic retroreflective element material.

(b) Fluorescent Pink Retroreflective Sheeting: Signs for temporary control of traffic through incident management areas shall be Type VI fluorescent pink retroreflective sheeting and shall comply with the MUTCD. Temporary traffic control signs for incident management shall be placed to notify motorists of upcoming incidents on the roadway, and shall be removed from public view once the incident has been managed. Physical properties shall comply with ASTM D 4956. Photometric properties shall be as follows.

(1) Retroreflectivity: Minimum Coefficients of Retroreflection shall be as specified in Table 1015-1.

Table 1015-1
Coefficients of Retroreflection for Fluorescent Pink Sheeting¹

Observation Angle, degrees	Entrance Angle, degrees	Fluorescent Pink
0.2	-4	100
0.2	+30	40
0.5	-4	40
0.5	+30	15

¹Minimum Coefficient of Retroreflection (R_A) ($\text{cd lx}^{-1} \text{m}^{-2}$)

(2) Color and Daytime Luminance: Color Chromaticity Coordinates and Daytime Luminance Factors shall be as specified in Table 1015-2.

Table 1015-2
Fluorescent Pink Color Specifications Limits (Daytime)

Chromaticity Coordinates (corner points) ¹								Luminance Factor, min.
1		2		3		4		Y%
x	y	x	y	x	y	x	y	25
0.450	0.270	0.590	0.350	0.644	0.290	0.536	0.230	

¹The four pairs of chromaticity coordinates measured with CIE 2° Standard Observer and 45/0 (0/45) geometry and CIE D65 Standard Illuminant.

(c) Adhesive Classes: The adhesive required for retroreflective sheeting shall be Class 1 (pressure sensitive) as specified in ASTM D 4956.

(d) Accelerated Weathering: Reflective sheeting, when processed, applied and cleaned in accordance with the manufacturer's recommendations shall perform in accordance with the accelerated weathering standards in Table 1015-3.

Table 1015-3
Accelerated Weathering Standards¹

Type	Retroreflectivity ²				Colorfastness ³	
	Orange/ Fluorescent Orange		All colors, except orange/Fluorescent Orange		Orange/ Fluorescent Orange	All colors, except orange/Fluorescent Orange
III	1 year	80 ⁴	3 years	80 ⁴	1 year	3 years
III (for drums)	1 year	80 ⁴	1 year	80 ⁴	1 year	1 year
VI	1/2 year	50 ⁵	1/2 year	50 ⁵	1/2 year	1/2 year
X	1 year	80 ⁶	3 years	80 ⁶	1 year	3 years

¹At an angle of 45° from the horizontal and facing south in accordance with ASTM G 7 at an approved test facility in Louisiana or South Florida.

²Percent retained retroreflectivity of referenced table after the outdoor test exposure time specified.

³Colors shall conform to the color specification limits of ASTM D 4956 after the outdoor test exposure time specified.

⁴ASTM D 4956, Table 8.

⁵ASTM D 4956, Table 13.

⁶ASTM D 4956, Table 4.

(e) Expected Sign Life Data and Performance: The sheeting manufacturer shall supply expected retroreflectivity service life curves for each of the following sign sheeting colors: white, green, blue, brown, red, and yellow. The service life curves shall be plots of the 95 percent expected life plotted on an x-y graph with life years on the x-axis and retroreflectivity on the y-axis. The expected life shall account for worst case installations, equivalent to an installation in South Louisiana with the sign facing to the South. The sheeting manufacturer shall also supply a table of expected life values taken from the service life curves for Revision Number 2 to the 2003 Edition of the MUTCD minimum reflectivity requirements published in the Federal Register on December 21, 2007. Reflective sheeting for signs, when processed, applied and cleaned in accordance with the manufacturer's recommendations shall perform outdoors in accordance with the performance standards in Table 1015-4.

Table 1015-4
Reflective Sheeting Performance Standards

Type	Retroreflectivity ¹ -- Durability ²				Colorfastness ³
	Orange/ Fluorescent Orange		All colors, except orange/Fluorescent Orange		
III	3 years	80 ⁴	10 years	80 ⁴	3 years
X	3 years	80 ⁵	7years	80 ⁵	3 years

¹Percent retained retroreflectivity of referenced table after installation and the field exposure time specified.

²All sheeting shall maintain its structural integrity, adhesion and functionality after installation and the field exposure time specified.

³All colors shall conform to the color specification limits of ASTM D 4956 after installation and the field exposure time specified.

⁴ASTM D4956, Table 8.

⁵ASTM D 4956, Table 4.

(f) Temporary Signs, Barricades, Channelizing Devices, Drums and Cones: Reflective sheeting for temporary signs, barricades and channelizing devices, shall meet the requirements of ASTM D 4956, Type III except that temporary warning construction signs used on the mainline of freeways and expressways shall be fluorescent orange and meet the requirements of ASTM D 4956, Type X.

Reflective sheeting for vertical panels shall meet the requirements of ASTM D 4956, Type III.

Reflective sheeting for drums shall be a minimum of 6 inches (150 mm) wide and shall meet the requirements of ASTM D 4956, Type III, and the Supplementary Requirement S2 for Reboundable Sheeting as specified in ASTM D 4956. Reflective sheeting for traffic cone collars shall meet the requirements of ASTM D 4956, Type III or Type VI.

(g) Sheeting Guaranty. The contractor shall provide the Department with a guaranty from the sheeting manufacturer stating that if the retroreflective sheeting fails to comply with the performance requirements of this subsection, the sheeting manufacturer shall do the following:

Table 1015-5
 Manufacturer's Guaranty-Reflective Sheeting

Type	Manufacturer shall restore the sign face in its field location to its original effectiveness at no cost to the Department if failure occurs during the time period ¹ as specified below		Manufacturer shall replace the sheeting required to restore the sign face to its original effectiveness at no cost to the Department if failure occurs during the time period ¹ as specified below
	Orange/Fluorescent Orange	All colors, except orange/Fluorescent Orange	All colors, except orange/Fluorescent Orange
III	<3 years	<7 years	7-10 years
X	<3 years	<5 years	5-7 years

¹ From the date of sign installation.

Replacement sheeting for sign faces, material, and labor shall carry the unexpired guaranty of the sheeting for which it replaces.

The sign fabricator shall be responsible for dating all signs with the month and year of fabrication at the time of sign fabrication. This date shall constitute the start of the guaranty obligation period.

Subsection 1015.11 - Preformed Plastic Pavement Marking Tape (06/07), Pages 842 – 844.

Delete the contents of this subsection and substitute the following.

1015.11 PREFORMED PLASTIC PAVEMENT MARKING TAPE.

(a) General: Preformed plastic pavement marking tape shall be approved products listed on QPL 64 and shall comply with ASTM D4505 Retroreflectivity Level I or Level II, or DOTD Intersection Grade (as specified below), except as modified herein. The marking tape shall be Class 2 or 3. The type and color shall be in accordance with the plans and the MUTCD.

(b) Thickness: All preformed plastic pavement marking tape shall have a minimum overall thickness of 0.060 inches (1.5 mm) when tested without the adhesive.

(c) Friction Resistance: The surface of the Retroreflectivity Level II preformed plastic pavement marking tape shall provide a minimum frictional resistance value of 35 British Polish Number (BPN) when tested according to ASTM E303. The surface of the Retroreflectivity Level I and DOTD Intersection Grade preformed plastic pavement marking tape shall provide a minimum frictional resistance value of 45 BPN when tested according to ASTM E303. Values for the Retroreflectivity Level I material with a raised surface pattern as defined in ASTM D4505 are calculated by averaging values taken at downweb and at a 45 degrees angle from downweb.

(d) **Retroreflective Requirements:** The preformed plastic pavement marking tape shall have the minimum initial specific luminance values shown in Table 1015-7 when measured in accordance with ASTM D 4061.

Table 1015-7
Specific Luminance of Preformed Plastic Tape

Type	Observation Angle, degrees	Entrance Angle, degrees	Specific Luminance (mcd/sq m/lx)	
			White	Yellow
Retroreflectivity Level I	1.05	88.76	500	300
DOTD Intersection Grade	1.05	88.76	375	250
Retroreflectivity Level II	1.05	88.76	250	175

(e) **Durability Requirements:** The DOTD Intersection Grade preformed plastic pavement marking tape shall show no appreciable fading, lifting or shrinkage for a least 12 months after placement when placed in accordance with the manufacturer's recommended procedures on pavement surfaces having a daily traffic count not to exceed 15,000 ADT per lane.

The Retroreflectivity Level I preformed plastic pavement marking tape shall show no appreciable fading, lifting or shrinkage for a least 4 years after placement for longitudinal lines and at least 2 years after placement for symbols and legends.

The Retroreflectivity Level I preformed plastic pavement marking tape shall also retain the following reflectance values for the time period detailed in Table 1015-8.

Table 1015-8
Retained Specific Luminance for Retroreflectivity Level I
Preformed Plastic Pavement Marking Tape

Time	Observation Angle, degrees	Entrance Angle, degrees	Specific Luminance (mcd/sq m/lx)	
			White	Yellow
1 year	1.05	88.76	400	240
4 years (2 years for symbols and legend)	1.05	88.76	100	100

(f) **Plastic Pavement Marking Tape Guaranty (DOTD Intersection Grade and Retroreflectivity Level I):** If the plastic pavement marking tape fails to comply with the performance and durability requirements of this subsection within 12 months for DOTD Intersection Grade and 4 years for Retroreflectivity Level I, the manufacturer shall replace the plastic pavement marking material at no cost to the Department.

SECTION 1020 – TRAFFIC SIGNALS:

Subsection 1020.01 – Traffic Signal Heads (06/07), Pages 873 – 884.

Delete the contents of Heading (a), General Requirements and substitute the following.

Supplemental Specifications (August 2008)
Page 30 of 30

(a) General Requirements: Traffic signal sections, beacon sections and pedestrian signal sections shall be of the adjustable type. Materials and construction of each section shall be the same.

Signals shall be constructed for either 8 or 12-inch (200 mm or 300 mm) lens in accordance with the plans. Signal sections shall have three to five sections per face and beacon sections have only one section per face. Signal sections and associated brackets shall be finished inside and out with two coats of high grade dark olive green enamel, color number 14056 according to Federal Standard No. 595b with each coat independently baked. Visors shall be coated green on the outside and black on the inside. Edges shall be deburred and smooth with no sharp edges.

Subsection 1020.04 – Poles for Traffic Signal Systems (06/07), Pages 890 – 894.


Delete the sixth paragraph of Heading (a), Pedestal Support Signal Poles, and substitute the following.

Pedestals shall be finished with at least one coat of rustproofing primer, applied to a clean surface and one coat of dark olive green enamel, color number 14056 according to Federal Standard No. 595b.

PROJECT SIGN DETAIL - STATE SURPLUS FUNDED
(COLOR ARTWORK FURNISHED UPON REQUEST)

Background=Blue

BLACK

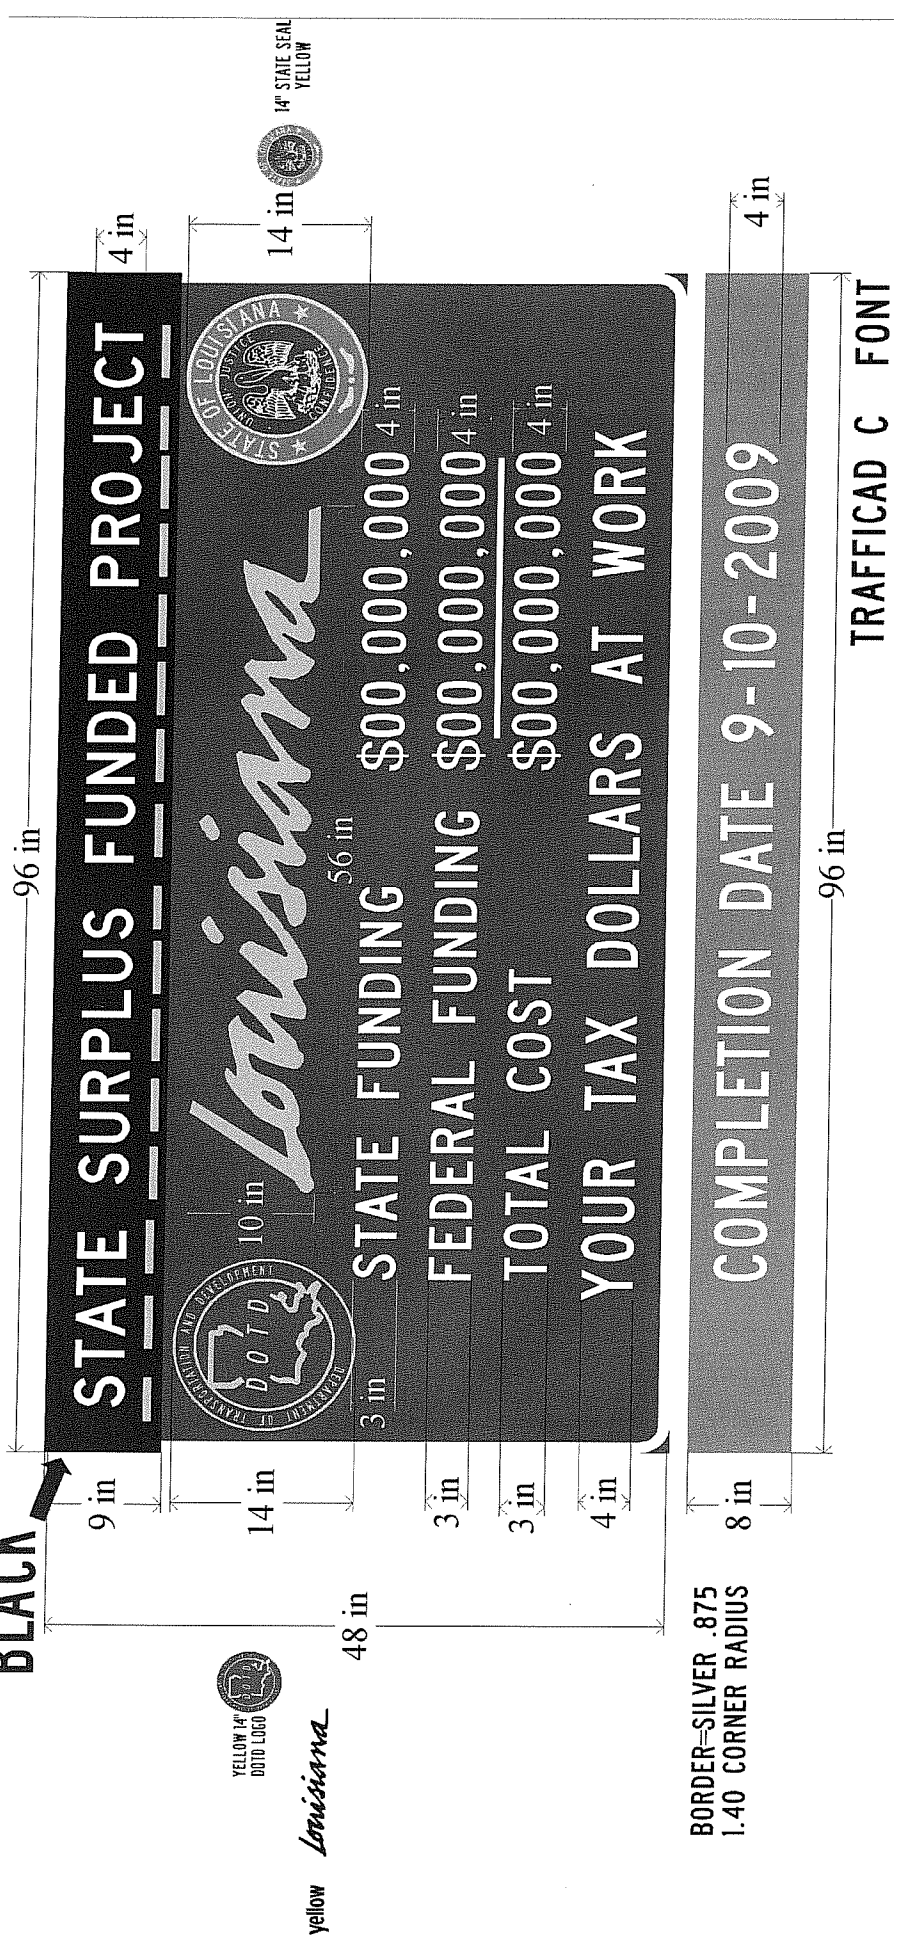

COMPLETE

Additional "Complete" Sign

72 in

STANDARD PLANS

REVISION DATA

DESCRIPTION	REVISION	DATE
BM-01	8-22-07	
MB-01	1-14-92	
PM-01	1-21-98	
DW-05	3-25-88	
GR-200	11-8-04	
GR-201	11-8-04	
CB-02	11-2-00	
MC-01	8-11-06	

STATE OF LOUISIANA

DEPARTMENT OF TRANSPORTATION

PLANS OF PROPOSED


STATE HIGHWAY

STATE PROJECT NO. 838-03-0023

WOODLAND HWY. IMPROVEMENTS (LA 23 TO PLANTERS CANAL) - PHASE I

PLAQUEMINES PARISH

LA 406

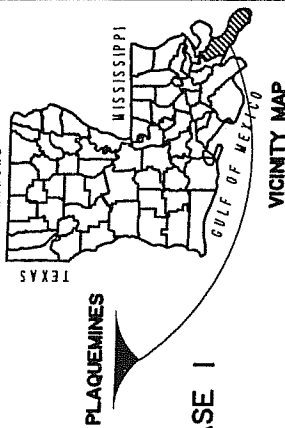

BRIDGE LOCATIONS



STRUCTURE NUMBER	C.S.L.M.	LENGTH (FEET)	WIDTH (FEET)
8380301711	1.89	80	40
8380303111	0.20	60	40

TRAFFIC DATA
2008 A.D.T. = 9,300
2018 A.D.T. = 10,300
D = 55 %
K = 10 %
T = 11 %


POSTED SPEED = 45 M.P.H.

TYPE OF CONSTRUCTION:
WIDENING ASPHALTIC ROADWAY
AND ADD DRAINAGE STRUCTURES.

C.S. LOG MILE 0.000
STA. 98+63
BEG. S.P. 838-03-0023

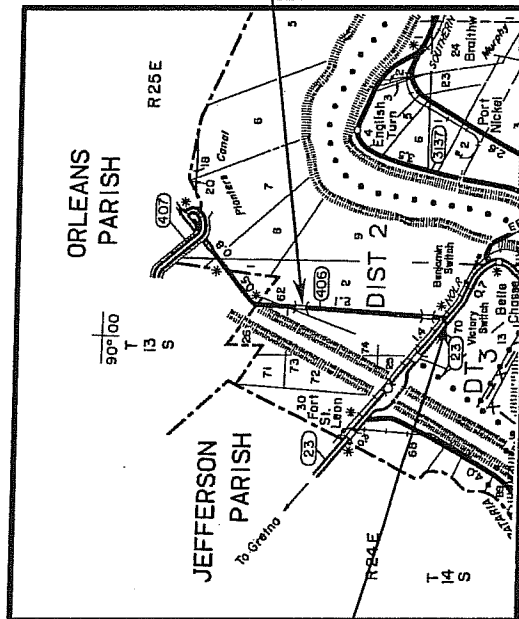

C.S. LOG MILE 1.636
STA. 185+00
END. S.P. 838+03-0023

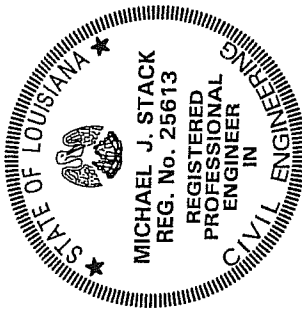

RECOMMENDED FOR APPROVAL

W. Brantley 10/13/08
ASSISTANT DISTRICT 02 ADMINISTRATOR-ENGINEERING

Michael J. Stack 10/13/08
DISTRICT 02 ADMINISTRATOR

Tom CHIEF ENGINEER

NOTE: THE 2006 LOUISIANA DOTD STANDARD SPECIFICATIONS FOR ROADS AND BRIDGES, AS AMENDED BY THE PROJECT SPECIFICATIONS, SHALL GOVERN ON THIS PROJECT.

NO.	DATE	REVISION DESCRIPTION	DATE	RECOMMENDED	DATE	APPROVED
1	10/22/08	shts. 1, 2 & 2a	10-22-08	MAC	10-23-08	PLB

SCHEDULE OF REVISIONS

WOODLAND HWY. IMPROVEMENTS
(LA 23 TO PLANTERS CANAL) - PHASE I

DISTRICT 02
DESIGN



NO.	DATE	REVISION DESCRIPTION

DESIGNED	CAD	DATE	BY
CHECKED	JRM	9/20/08	
DETAILED	CAD	DATE	BY
CHECKED	JRM	9/20/08	

DATE

PARISH	PLAQUEMINES
FEDERAL PROJECT	
STATE PROJECT	838-03-0023

SHEET NO.

INDEX TO SHEETS

SHEET NO.	DESCRIPTION
1 - 1a	TITLE SHEET & INDEX SHEET
2 - 2b	TYPICAL SECTIONS AND DETAILS
3 - 3b	SUMMARY SHEETS
4 - 4j	PLAN SHEETS
5	REMOVAL OF CONCRETE CURBS
6 - 6x	CROSS SECTION SHEETS
7 - 7e	SPECIAL DETAILS
8 - 8e	TRAFFIC CONTROL SHEETS

TOTAL SHEETS 57

LOCATION DESCRIPTION





WORK ON THIS PHASE OF THE PROJECT BEGINS ON LA 406 AT LOG MILE 0.00 (STA. 98+63) AT ITS JUNCTION WITH LA 23 AND PROCEEDS NORTH ALONG LA 406 TO ITS JUNCTION WITH PLANTERS CANAL AT LOG MILE 1.59 (STA. 181+90). NO WORK WILL BE DONE UNDER THIS PHASE FROM LA 23 TO INDUSTRY CANAL (LOG MILE 0.00 TO LOG MILE 0.21, STA. 98+63 TO STA. 110+15).


SCOPE OF PROJECT

THE SCOPE OF THE PROJECT WILL BE TO INSTALL A CENTER TURNLANE BY WIDENING EXISTING ROADWAY, INSTALLING DRAINAGE, AND OVERLAYING EXISTING ROADWAY WITH 2" OF SUPERPAVE ASPHALTIC CONCRETE.

LENGTH OF PROJECT

DESCRIPTION	GROSS LENGTH		EXCEPTION		BRIDGE LENGTH		ROADWAY LENGTH	
	FEET	MILES	FEET	MILES	FEET	MILES	FEET	MILES
STA. TO STA.								
98+63 TO 110+15			1152					
110+15 TO 185+00	7485						7485	1.417
TOTAL LENGTH OF BRIDGES					140	0.026		
TOTAL LENGTH OF ROADWAY							7485	1.417
TOTAL MILES								1.636

																															
DISTRICT DESIGN		INDEX SHEET		WOODLAND HWY. IMPROVEMENTS (LA 23 TO PLANTERS CANAL) - PHASE I		NO.		DATE		REVISION DESCRIPTION		BY		SHEET		DATE		DESIGNED		CHECKED		DESIGNED		CHECKED		PARISH		PLAQUEMINES		SHEET NO.	
02																															

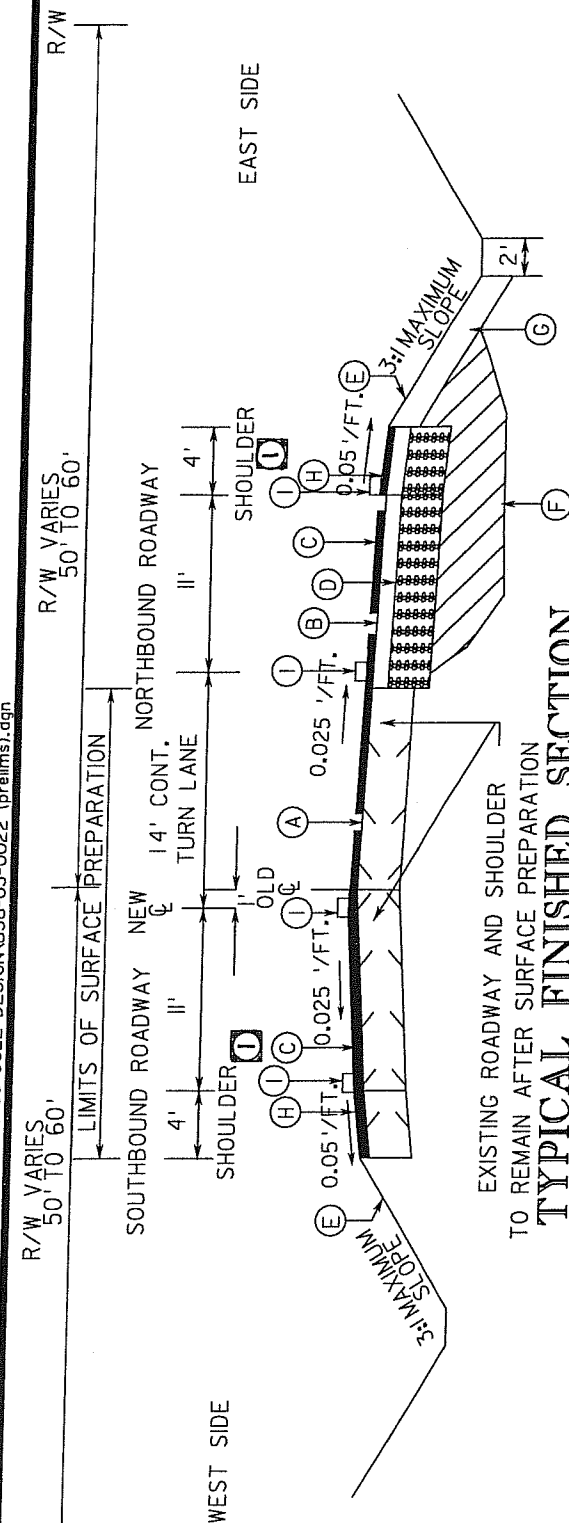

TO APPLY: STA. 110+15 (INDUSTRY CANAL) TO STA. 163+00 (LOG MILE 0.23 TO LOG MILE 1.23)
NOTE: ROADWAY EXCEPTION FROM STA. 98+63 (LA 23) TO STA. 110+15 (INDUSTRY CANAL)

- (A) REQ'D SURFACE PREPARATION TO BE COMPLETED PRIOR TO PLACEMENT OF WEARING COURSE INSTALLATION (ITEM S-004).
- (B) REQ'D 4.0" AVG. ASPHALTIC CONCRETE (LEVEL 1) (BINDER COURSE) (ITEM 502-01).
- (C) REQ'D 2" AVG. ASPHALTIC CONCRETE (LEVEL 1) (WEARING COURSE) (ITEM 502-01).
- (D) REQ'D 12" CLASS II BASE COURSE (ITEM 302-02-F). EXISTING NORTHBOUND SHOULDER TO BE REMOVED (ITEM 202-02-G).
- (E) REQ'D GEOTEXTILE FABRIC TO BE PLACED BETWEEN BASE COURSE AND EMBANKMENT AND PAID FOR UNDER ITEM 302-02-F.
- (F) BORROW TO BE PLACED AS DIRECTED BY THE PROJECT ENGINEER (ITEM 203-07). SEEDING, WATER & FERTILIZER TO BE PLACED AS DIRECTED BY THE PROJECT ENGINEER (ITEMS 717-01 AND 718-01). SWALE DITCH TO BE PLACED AS SHOWN AND AS DIRECTED BY PROJECT ENGINEER.
- (G) REQ'D NONPLASTIC EMBANKMENT TO BE PLACED UNDER BASE COURSE AS NEEDED AND AS DIRECTED BY PROJECT ENGINEER (ITEM 203-04). REQ'D GEOTEXTILE FABRIC TO BE PLACED BETWEEN EMBANKMENT AND EXISTING GROUND (ITEM S-005). EXISTING EMBANKMENT TO BE REMOVED TO CREATE A HORIZONTAL PLANE, SCARIFIED, AND COMPACTED PRIOR TO PLACING GEOTEXTILE FABRIC.
- (H) REQ'D 12" BORROW (VEHICULAR MEASUREMENT) (PLASTIC SOILS) (ITEM 203-07-B) TO BE PLACED IN ACCORDANCE WITH SECTION 203 AND 203.10 OF THE STANDARD SPECIFICATIONS.
- (I) REQ'D RUMBLE STRIPS (GROUND-IN) TO BE PLACED ALONG PAVED SHOULDERS. SEE SPECIAL DETAIL (ITEM S-006).
- (J) REQ'D STRIPING SHALL CONFORM TO STANDARD PLAN PM-01.

NOTE: 1. SEE CROSS SECTIONS FOR ADDITIONAL INFORMATION.


2. CENTER TURN LANE VARIES FROM 0' TO 14' FROM STATIONS 110+15 TO 112+50.

3. NEW CENTER LINE IS 1' WEST OF OLD CENTER LINE.

20 YEAR ESAL'S = 2,793,014

NTS

WOODLAND HWY. IMPROVEMENTS (LA 23 TO PLANTERS CANAL) - PHASE I		SHEET NO. 2	
DISTRICT 02 DESIGN		PARISH PLAQUEMINES	
TYPICAL SECTION		FEDERAL PROJECT	
1 10/22/08 Revised typical section		STATE PROJECT 838-03-0023	
NO. DATE		DATE 9/2008	
BY		SHEET 2	

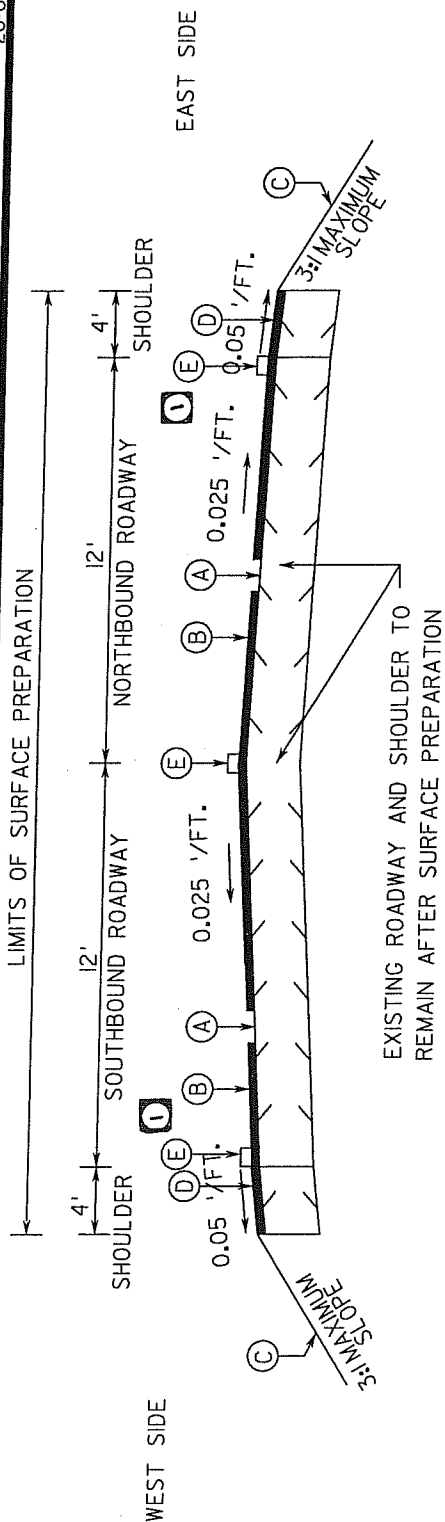

TYPICAL FINISHED SECTION

TO APPLY: STA. 163+00 TO STA. 181+90 (PLANTERS CANAL)

- (A) REQ'D SURFACE PREPARATION TO BE COMPLETED PRIOR TO PLACEMENT OF WEARING COURSE INSTALLATION (ITEM S-004).
- (B) REQ'D 2" AVG. ASPHALTIC CONCRETE (LEVEL IF) (WEARING COURSE) (ITEM 502-01).
- (C) BORROW TO BE PLACED AS DIRECTED BY THE PROJECT ENGINEER (ITEM 203-07). SEEDING, WATER & FERTILIZER TO BE PLACED AS DIRECTED BY THE PROJECT ENGINEER (ITEM 717-01 AND ITEM 718-01).
- (D) REQ'D RUMBLE STRIPS (GROUND-IN) TO BE PLACED ALONG PAVED SHOULDERS. SEE SPECIAL DETAIL (ITEM S-006).
- (E) REQ'D STRIPING SHALL CONFORM TO STANDARD PLAN PM-01.

NOTE: STA. 163+00 TO STA. 181+90 NOT SHOWN ON PLAN VIEW SHEETS.

NOTE: TRANSITION BETWEEN TYPICAL SECTIONS AS DIRECTED BY PROJECT ENGINEER.

1


20 YEAR ESAL'S = 2,793,014

NTS

DISTRICT 02 DESIGN		WOODLAND HWY. IMPROVEMENTS (LA 23 TO PLANTERS CANAL) - PHASE I		SHEET NO. 20	
TYPICAL SECTION		1 10/22/08 Revised typical section		PLAQUEMINES	
NO. DATE		DESIGNED CHECKED		PARISH	
BY SHEET		DATE		FEDERAL PROJECT	
10/22/08		9/2/08		STATE PROJECT	
10/22/08		20		838-03-0023	

GENERAL CONSTRUCTION NOTES

1. THE CONTRACTOR SHALL PROVIDE FOR AND MAINTAIN THROUGH AND LOCAL TRAFFIC AT ALL TIMES AND SHALL CONDUCT HIS OPERATIONS IN SUCH MANNER AS TO CAUSE THE LEAST POSSIBLE INTERFERENCE WITH TRAFFIC.
2. THE CONTRACTOR SHALL MAINTAIN DRAINAGE. ALL MATERIAL DEPOSITED IN ANY DRAINAGE FEATURE (DITCHES, CROSSEDRAINS, ETC.) DURING CONSTRUCTION SHALL BE CLEANED OUT BEFORE FINAL ACCEPTANCE.
3. THE CONTRACTOR SHALL CONTACT AND COORDINATE WORK WITH ALL UTILITIES LOCATED IN PROJECT AREA. CONTRACTOR SHALL PROVIDE 14 DAYS NOTICE TO UTILITY COMPANIES PRIOR TO BEGINNING WORK. ANY DAMAGE DONE TO UTILITIES SHALL BE REPAIRED AT NO COST TO THE DEPARTMENT. LOCATIONS OF UTILITIES SHOWN ON PLANS ARE APPROXIMATE, CONTRACTOR SHALL CONTACT UTILITY COMPANIES FOR EXACT LOCATIONS PRIOR TO BEGINNING WORK.
4. THE CONTRACTOR SHALL CONDUCT OPERATIONS TO AVOID DAMAGE TO EXISTING FACILITIES (POWER POLES, FENCE, ETC.). ANY DAMAGE DONE SHALL BE REPAIRED AT NO COST TO THE DEPARTMENT.
5. THE CONTRACTOR SHALL PROVIDE A SMOOTH TIE IN WITH THE BRIDGES AT PLANTERS CANAL AND INDUSTRY CANAL.
6. THE CONTRACTOR SHALL COORDINATE WITH DOTD FOR ALL REQ'D PERMITS.
7. THE CONTRACTOR SHALL NOT LEAVE ANY HOLES OPEN OVERNIGHT. ANY DROP OFF AT THE EDGE OF THE ROAD GREATER THAN 2" SHALL BE DELINEATED BY PLACING LIGHTED CONES/BARRELS ALONG THE EDGE OF THE SHOULDER AT ALL TIMES.
8. CROSS DRAINS TO BE EXTENDED AS DIRECTED BY PROJECT ENGINEER AT STATIONS 120+00, 128+75, 142+15, AND 151+05.
9. CROSS DRAIN PIPES ARE 24" CMP (ITEM 701-01-B) AND BEDDING (ITEM 726-01).
10. EXISTING LANDSCAPE LIGHTING TO BE RELOCATED AT STA. 122+67. EXACT LOCATION TO BE DETERMINED BY PROJECT ENGINEER (ITEM S-002).
11. ALL RIGHT OF WAYS ON PLAN VIEW SHEETS ARE FROM THE CENTER LINE OF THE EXISTING ROADWAY.
12. EXISTING VEGETATION SHOULD TO BE SCARIFIED PRIOR TO PLACING NON-PLASTIC EMBANKMENT AND SHOULD BE PAID FOR UNDER (ITEM 203-04).
13. EXISTING PLANTS TO BE REMOVED AT STA. 122+67 AT SPRINGWOOD ESTATES (ITEM 202-02-I). ALL PLANTS REMOVED ARE TO BE GIVEN TO SPRINGWOOD ESTATES.
14. THE SUBMITTAL OF A BID WILL BE UNDERSTOOD TO INDICATE THAT THE BIDDER HAS INSPECTED THE WORK SITE AND HAS BECOME THOROUGHLY FAMILIAR WITH THE PLANS, GENERAL PROVISIONS, SPECIAL PROVISIONS, SUPPLEMENTAL SPECIFICATIONS AND TECHNICAL SPECIFICATIONS. THE FAILURE OR OMISSION OF ANY BIDDER TO EXAMINE ANY OF THE ABOVE SHALL IN NO WAY RELIEVE THE CONTRACTOR FROM ANY OBLIGATION IN RESPECT TO THE BID.
15. ITEMS 202-02-G, 202-02-E, 203-01, 203-02, 203-07, 203-07-B, 701-01-I, 707-01, AND 726-01 TO BE USED AT LOCATIONS AND AS DIRECTED BY PROJECT ENGINEER.
16. ITEM 731-02 INCLUDES 10 BLUE MARKERS FOR FIRE HYDRANTS.
17. ITEM 203-04 INCLUDES ADDITIONAL QUANTITY TO BE USED AS DIRECTED BY PROJECT ENGINEER.
18. ALL CATCH BASIN GRATES ARE TO BE TYPE C GRATES. SEE MC-01 FOR DETAILS.
19. CONTRACTOR SHALL SUBMIT THE ELEVATIONS OF THE TOPS OF CATCH BASINS TO THE PROJECT ENGINEER FOR APPROVAL. COST TO BE INCLUDED IN (ITEM 702-03-B). ALL INVERT ELEVATIONS OF THE CATCH BASINS ARE TO BE SET AT THE INVERT OF THE EXISTING CULVERTS OR AS DIRECTED BY PROJECT ENGINEER. SIDE DRAIN PIPES SLOPES ARE TO MATCH EXISTING PIPE SLOPES OR AS DIRECTED BY PROJECT ENGINEER (ITEM 701-05-M).

						DESIGNED CHECKED JRM		PARISH FEDERAL PROJECT	PLAQUEMINES	SHEET NO.	2b
DISTRICT 02 DESIGN		WOODLAND HWY. IMPROVEMENTS (LA 23 TO PLANTERS CANAL) - PHASE I		GENERAL NOTES		DATE 9/2/08		DATE 9/2/08	STATE PROJECT	838-03-0023	
						REVISION DESCRIPTION		BY			

ASPHALTIC CONCRETE ROADWAY AND SHOULDER SURFACING

STA.	STA.	LOCATION	LENGTH (FEET)	2.0"		4.0"	
				WIDTH (FT)*	TONS	WIDTH (FT)*	TONS
110+15	112+50	ROADWAY TRANSITION TO 3 LANE SECTION	235.0	VARIES 32' TO 44'	109.1	VARIES 0' TO 16'	46.0
112+50	159+00	ROADWAY	4650.0	44	2500.7	16	1818.7
159+00	163+00	ROADWAY TRANSITION BACK TO TWO 12' LANES	400.0	VARIES 32' TO 44'	185.8	VARIES 16' TO 0'	78.2
163+00	181+90	ROADWAY	1890.0	32	739.2		
ADDITIONAL FOR SPOT LEVELING AND SLOPE CORRECTION					700.0		
TOTAL					4234.8		1942.8


				WOODLAND HWY. IMPROVEMENTS (LA 23 TO PLANTERS CANAL) - PHASE I		NO. DATE		REVISION DESCRIPTION		DESIGNED CHECKED DATE 9/2008 SHEET 3		PARISH FEDERAL PROJECT STATE PROJECT 836-03-0023		SHEET NO. 3	
DISTRICT 02 DESIGN				ROADWAY SURFACING								PLAQUEMINES			

SUMMARY OF ESTIMATED QUANTITIES					STATE PROJECT 838-03-0023	PARISH PLAQUEMINES	SHEET NO. 39
ITEM NO.	ITEM	UNIT	QUANTITY S.P. NO. 838-03-0023	TOTAL QUANTITY			
202-02-C	REMOVAL OF PORTLAND CEMENT CONCRETE PAVEMENT	SQYD	400				
202-02-E	REMOVAL OF CONCRETE CURBS	LNFT	100.0				
202-02-G	REMOVAL OF SURFACING & STABILIZED BASE	SQYD	2,350.0				
202-02-H	REMOVAL OF GUARD RAIL	LNFT	712				
202-02-I	REMOVAL OF SMALL PLANTS (LESS THAN 3 FT. TALL)	EACH	50				
203-01	GENERAL EXCAVATION						
203-02	DRAINAGE EXCAVATION	CUYD	4,717				
203-04	NONPLASTIC EMBANKMENT	CUYD	3,925				
203-07	BORROW (VEHICULAR MEASUREMENT)	CUYD	20,000				
203-07-B	BORROW (VEHICULAR MEAS.) (PLASTIC SOILS)	CUYD	2,000				
302-02-F	CLASS II BASE COURSE (12" THICK)	CUYD	2,500				
401-02	AGGREGATE SURFACE COURSE (ADJUSTED VEHICULAR MEASUREMENT)	SQYD	8,900.0				
502-01	SUPERPAVE ASPHALTIC CONCRETE	CUYD	100				
502-01-A	SUPERPAVE ASPHALTIC CONCRETE, DRIVES, TURNOUTS AND MISCELLANEOUS	TON	6,177.6				
701-01-I	CROSS DRAIN PIPE (24" CMP)	TON	316.3				
701-05-M	SIDE DRAIN PIPE (36")	LNFT	80				
702-03-B	CATCH BASINS (CB-02)	LNFT	180				
704-03	BLOCKED OUT GUARD RAIL	EACH	7				
704-07-A	GUARD RAIL BRIDGE ATTACHMENTS (SINGLE THRIE BEAM)	LNFT	93.8				
704-08-B	GUARD RAIL TRANSITIONS (DOUBLE THRIE BEAM)	LNFT	100.0				
704-11-A	GUARD RAIL END TREATMENT (FLARED)	LNFT	193.8				
707-01	CONCRETE CURB	EACH	8				
711-04	GEOTEXTILE FABRIC	LNFT	100.0				
713-01	TEMPORARY SIGNS & BARRICADES	SQYD	300				
713-02-E	TEMPORARY PAVEMENT MARKINGS (24" WIDTH)	LUMP	LUMP				
713-03-A	TEMPORARY PAVEMENT MARKINGS (BROKEN LINE) (4" WIDTH) (4' LENGTH)	LNFT	1,195				
713-03-B	TEMPORARY PAVEMENT MARKINGS (BROKEN LINE) (4" WIDTH) (10' LENGTH)	MILE	7.576				
713-04-A	TEMPORARY PAVEMENT MARKINGS (SOLID LINE) (4" WIDTH)	MILE	4.720				
717-01	SEEDING	MILE	9.976				
718-01	FERTILIZER	LB	120				
726-01	BEDDING MATERIAL	LB	4,000				
727-01	MOBILIZATION	CUYD	80.0				
		LUMP	LUMP				

SUMMARY OF ESTIMATED QUANTITIES					STATE PROJECT 838-03-0023	PARISH PLAQUEMINES	SHEET NO. 36
ITEM NO.	ITEM	UNIT	QUANTITY S.P. NO. 838-03-0023	TOTAL QUANTITY			
729-16-C	OBJECT MARKER ASSEMBLY (Type 3)	EACH	8				
731-02	REFLECTORIZED RAISED PAVEMENT MARKERS	EACH					
732-01-E	PLASTIC PAVEMENT STRIPING (24" WIDTH)	EACH	704				
732-02-A	PLASTIC PAVEMENT STRIPING (SOLID LINE) (4" WIDTH)	LNFT	598				
732-03-A	PLASTIC PAVEMENT STRIPING (BROKEN LINE) (4" WIDTH)	MILE	4.988				
732-04-A	PLASTIC PAVEMENT LEGENDS & SYMBOLS (ARROW)	MILE	2.360				
735-01	MAILBOXES	EACH	24				
735-02	MAILBOX SUPPORTS (SINGLE)	EACH	2				
740-01	CONSTRUCTION LAYOUT	EACH	2				
S-001	CLEANING EXISTING CULVERTS (16 TO 48 INCHES)	LUMP	LUMP				
S-002	RELOCATION OF EXISTING LANDSCAPE LIGHTING	LNFT	200				
S-003	FULL DEPTH SAW CUT OF EXISTING PAVEMENT	EACH	1				
S-004	SURFACE PREPARATION	LNFT	360				
S-005	GEOTEXTILE FABRIC	LUMP	LUMP				
S-006	RUMBLE STRIPS (GROUND-IN)	SQYD	23,500				
		MILE		2.75			

07-OCT-2008 08:52

R:\PROJECT FOLDERS\838-03-0022 LA 406 WIDENING\DESIGN\REVISION OF SURPLUS DSGN.dgn

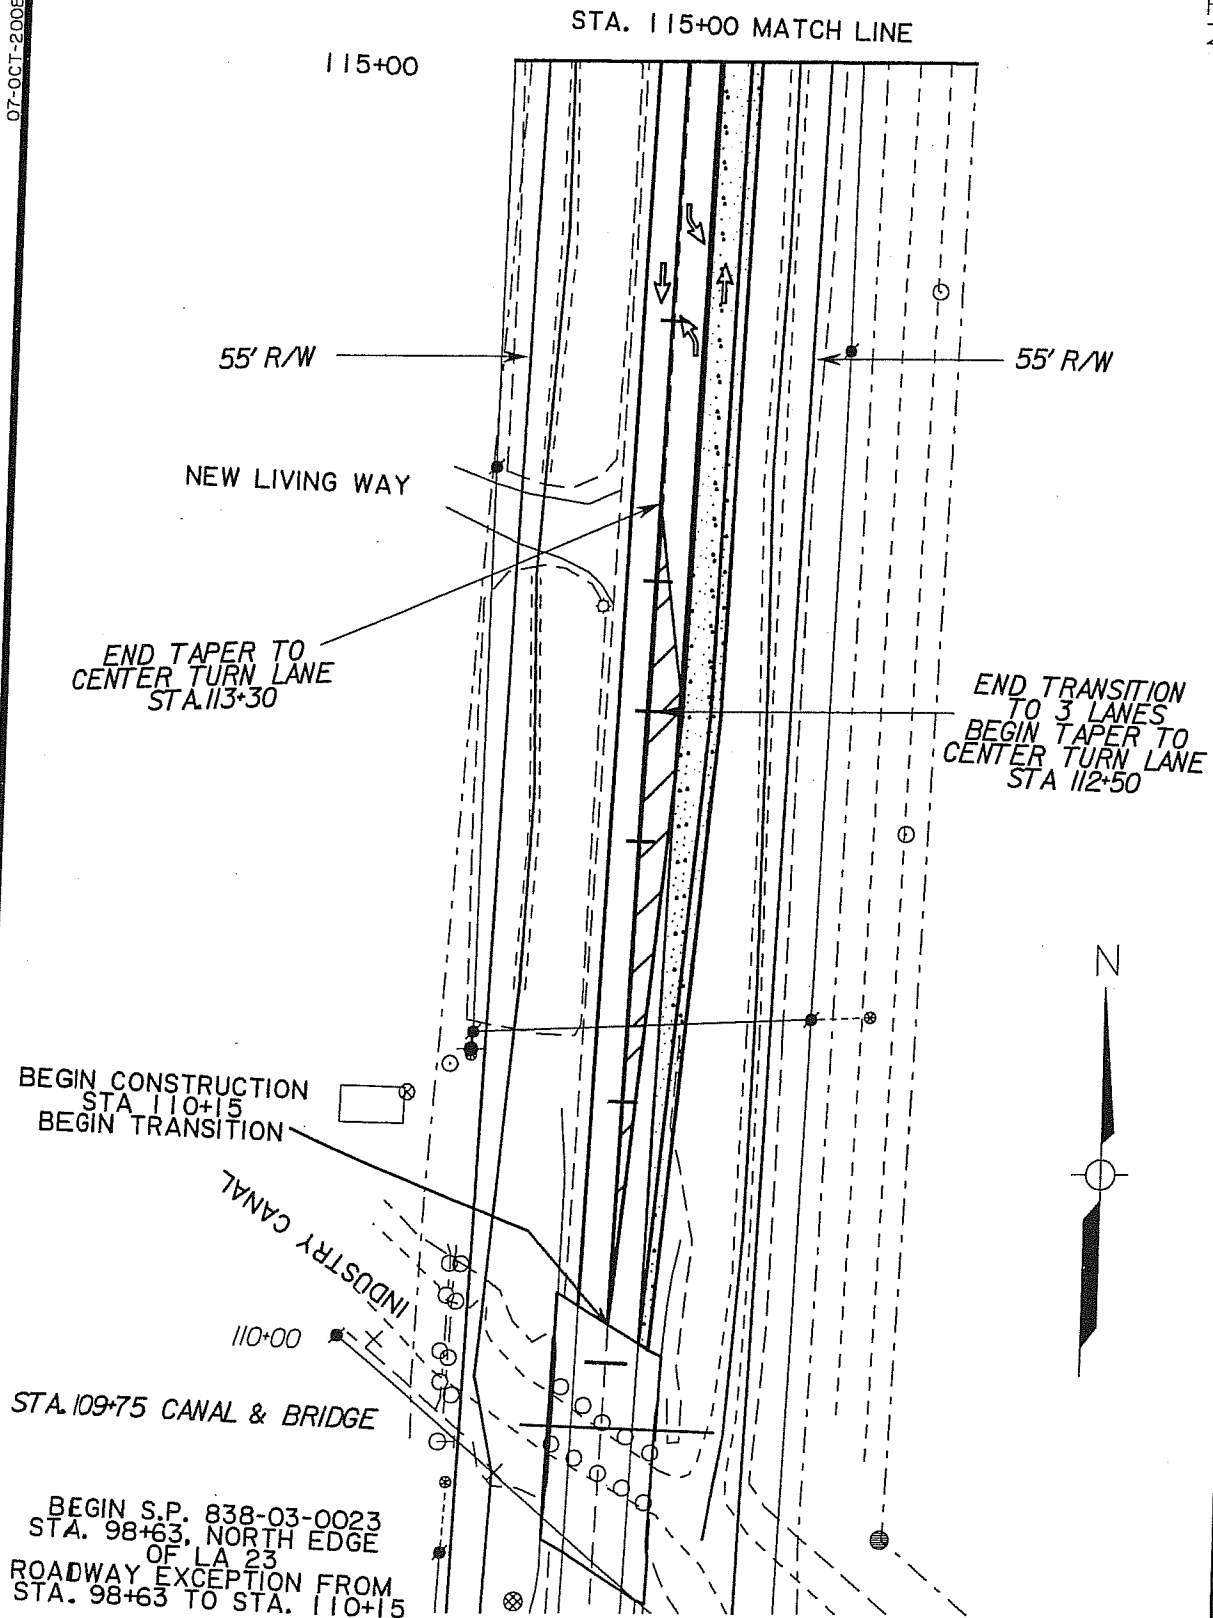

NTS

SHEET NO. 4	
DESIGNED CHECKED JRM	PLAQUEMINES
DETAILED CHECKED JRM	PARISH
DATE 9/2008	FEDERAL PROJECT
SHEET 4	STATE PROJECT 838-03-0023
REVISION DESCRIPTION	
NO.	DATE
PLAN VIEW	
WOODLAND HWY. IMPROVEMENTS (LA 23 TO PLANTERS CANAL) - PHASE I	
DISTRICT 02 DESIGN	


07-OCT-2008 08:52

R:\PROJECT FOLDERS\B38-03-0022 LA 406 WIDENING\DESIGN\REVISION OF SURPLUS DESIGN.dgn

208 WOODLAND HWY.

115+00

LIBERTY STREET

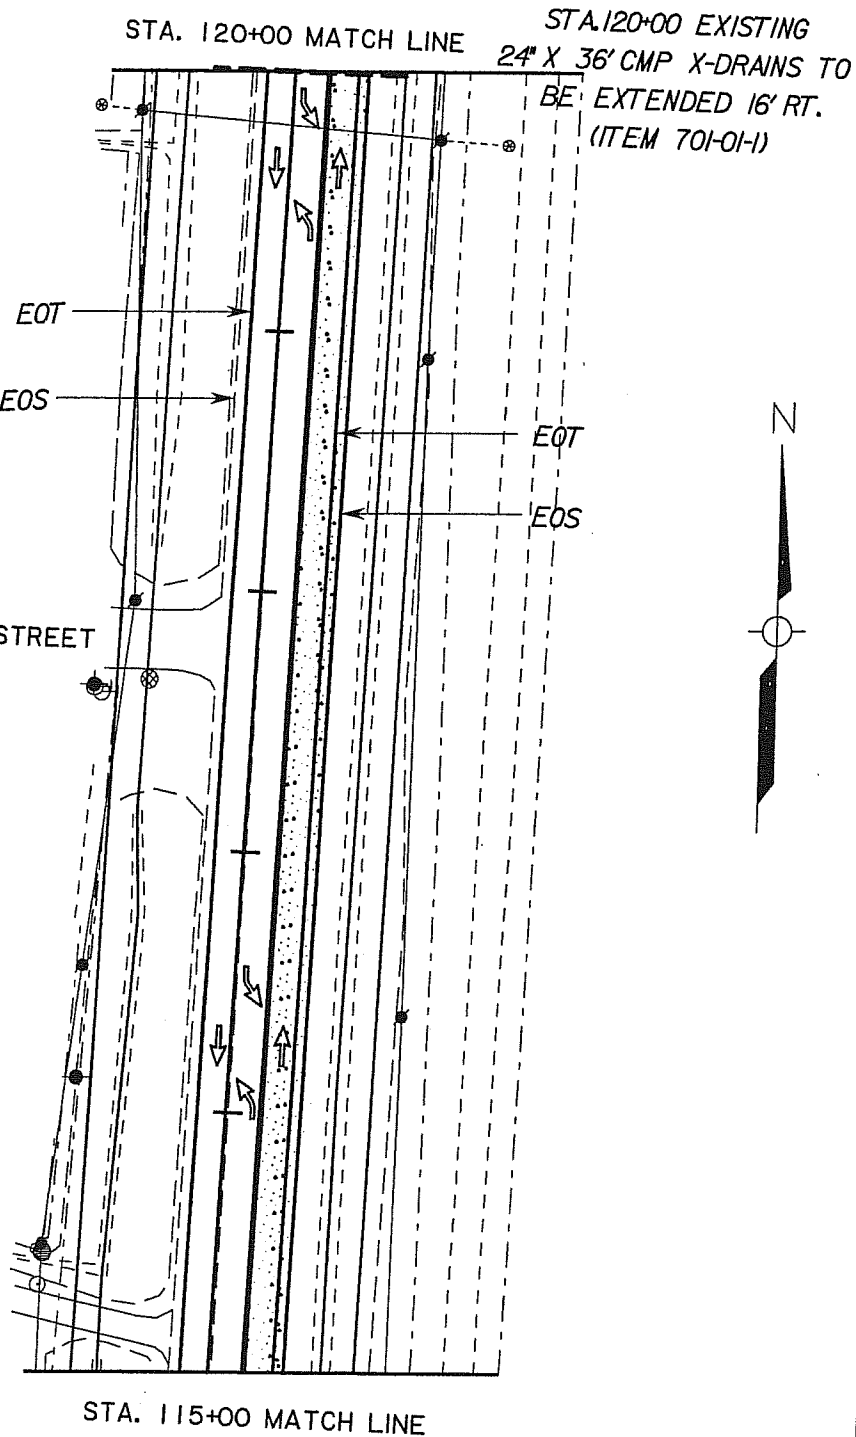


NTS

SHEET NO. 4a	
PARISH	PLAQUEMINES
FEDERAL PROJECT	STATE PROJECT
DATE 9/2/08	BY SHEET 4a
REVISION DESCRIPTION	
NO. DATE	
WOODLAND HWY. IMPROVEMENTS (LA 23 TO PLANTERS CANAL) - PHASE I	
PLAN VIEW	
DISTRICT DESIGN 02	


07-OCT-2008 08:52

R:\PROJECT FOLDERS\838-03-0022 LA 406 WIDENING\DESIGN\REVISION OF SURPLUS DESIGN.dgn

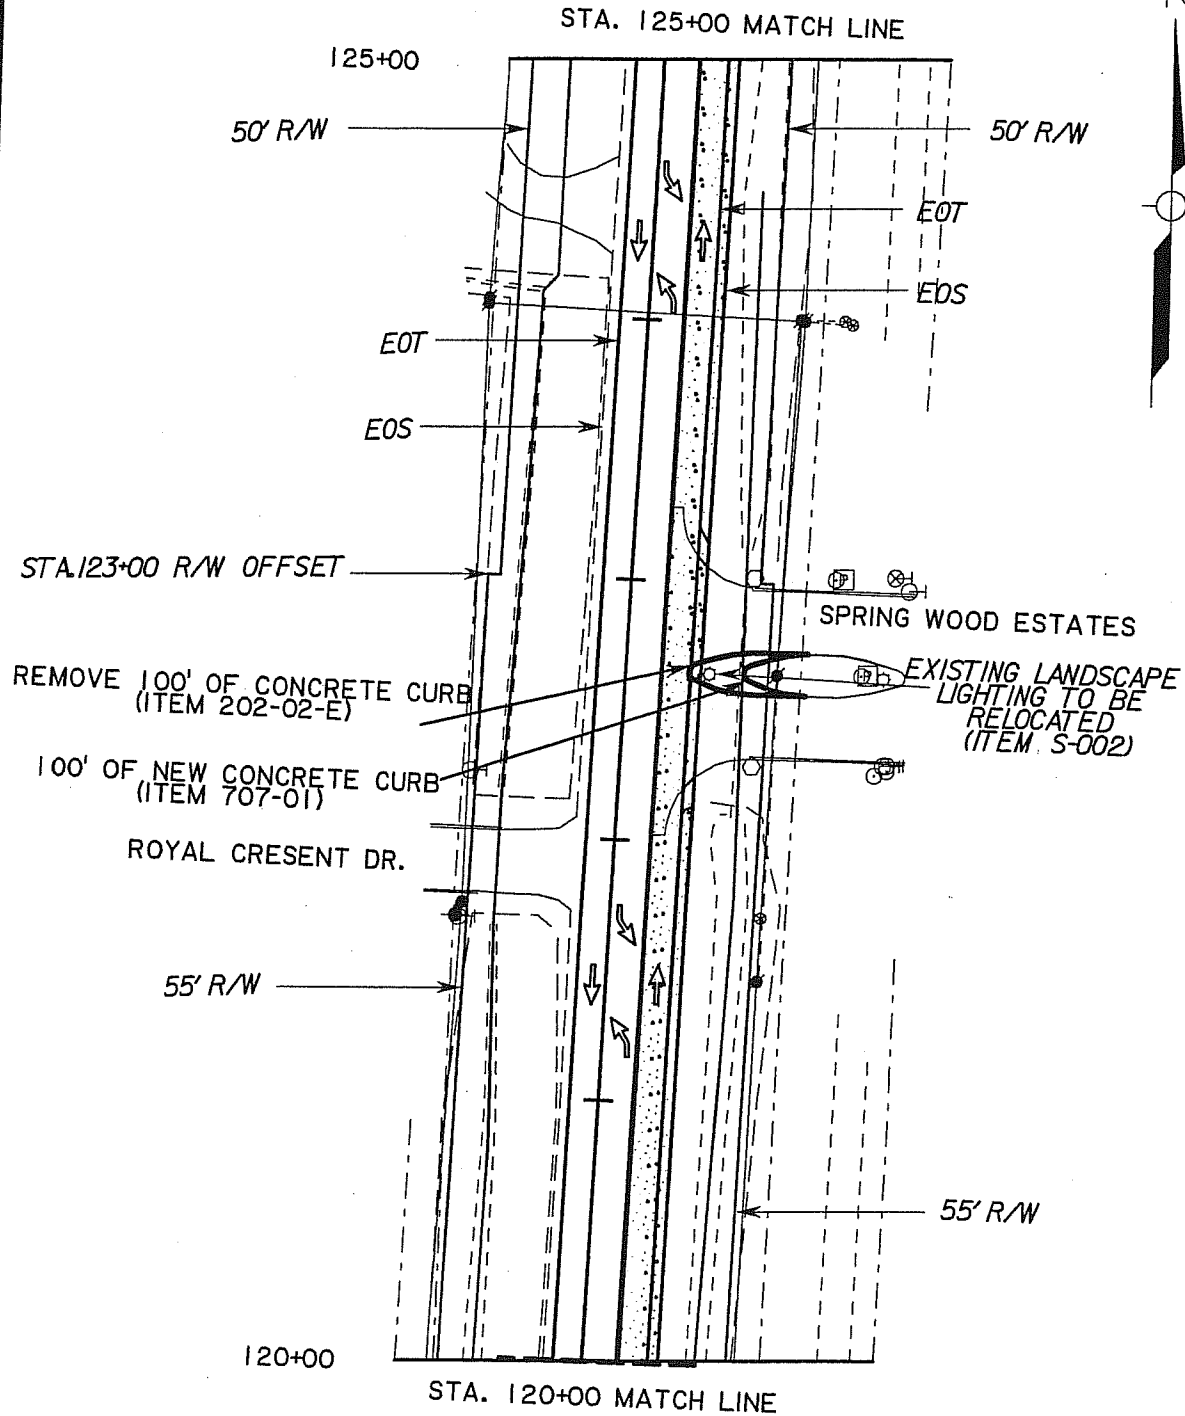


NTS

SHEET NO. 4b		PLAQUEMINES		PARISH		FEDERAL PROJECT		STATE PROJECT 838-03-0023	
DESIGNED	CMS	CHECKED	JRM	DATE	9/2008	BY		REVISION DESCRIPTION	
DETAILED	CMS	CHECKED	JRM	DATE		NO.	DATE		
WOODLAND HWY. IMPROVEMENTS (LA 23 TO PLANTERS CANAL) - PHASE I									
PLAN VIEW									
DISTRICT 02 DESIGN									

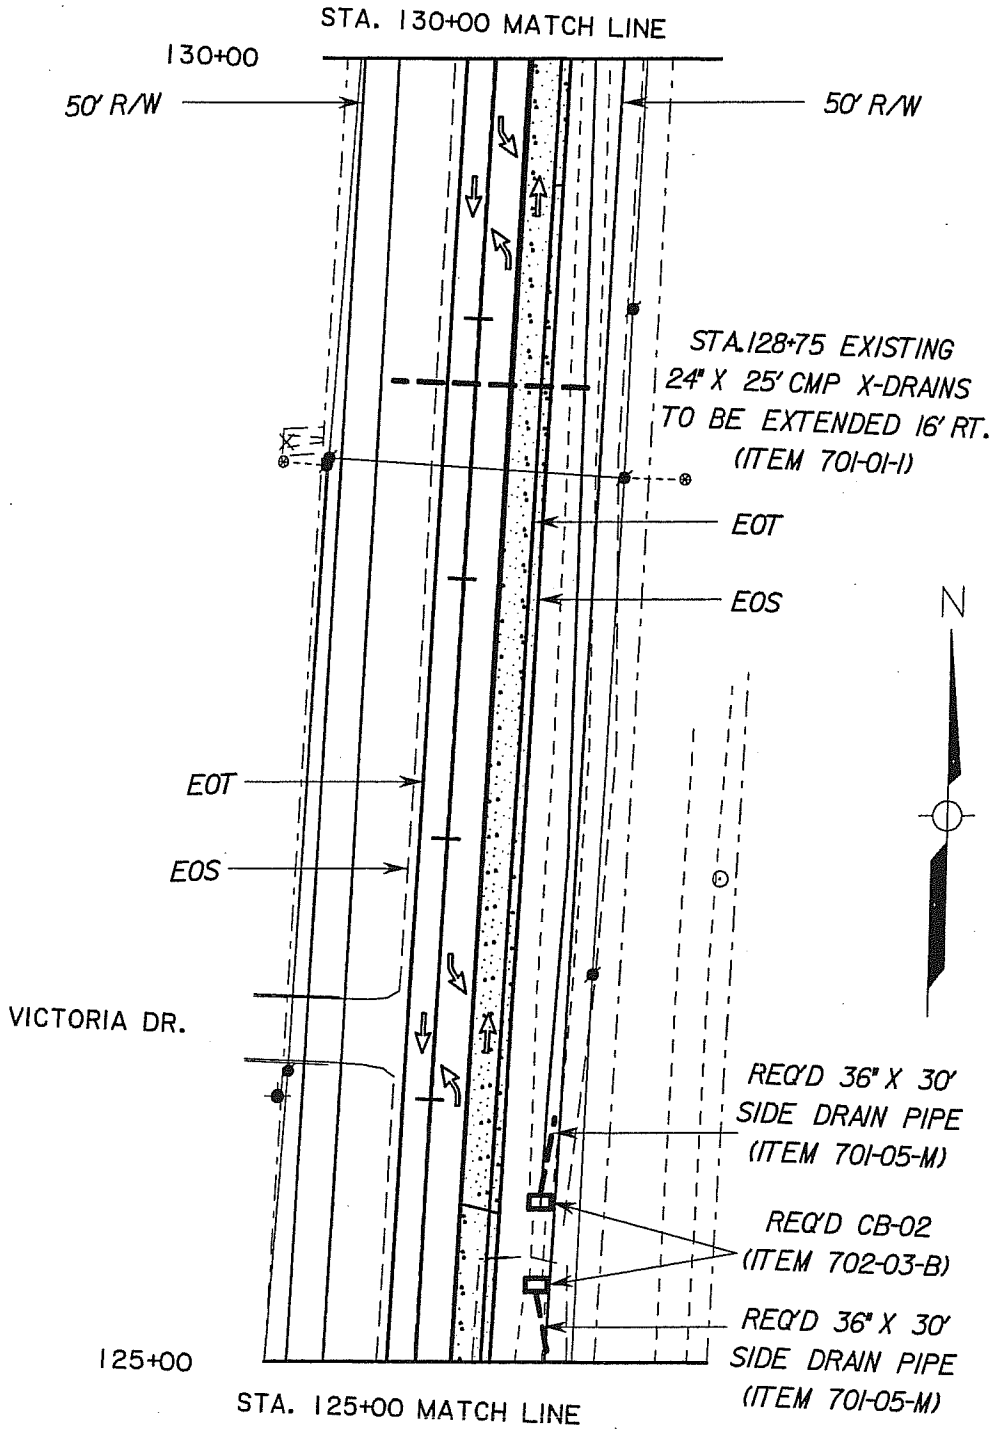


NTS

SHEET NO. 4c		PLAQUEMINES		PARISH		FEDERAL PROJECT		STATE PROJECT	
DESIGNED	CAR	CHECKED	JRM	DATE	9/20/08	BY	4c	REVISION DESCRIPTION	
DETAILED	CAR	CHECKED	JRM	NO.	DATE				
WOODLAND HWY. IMPROVEMENTS (LA 23 TO PLANTERS CANAL) - PHASE I									
PLAN VIEW									
DISTRICT 02 DESIGN									

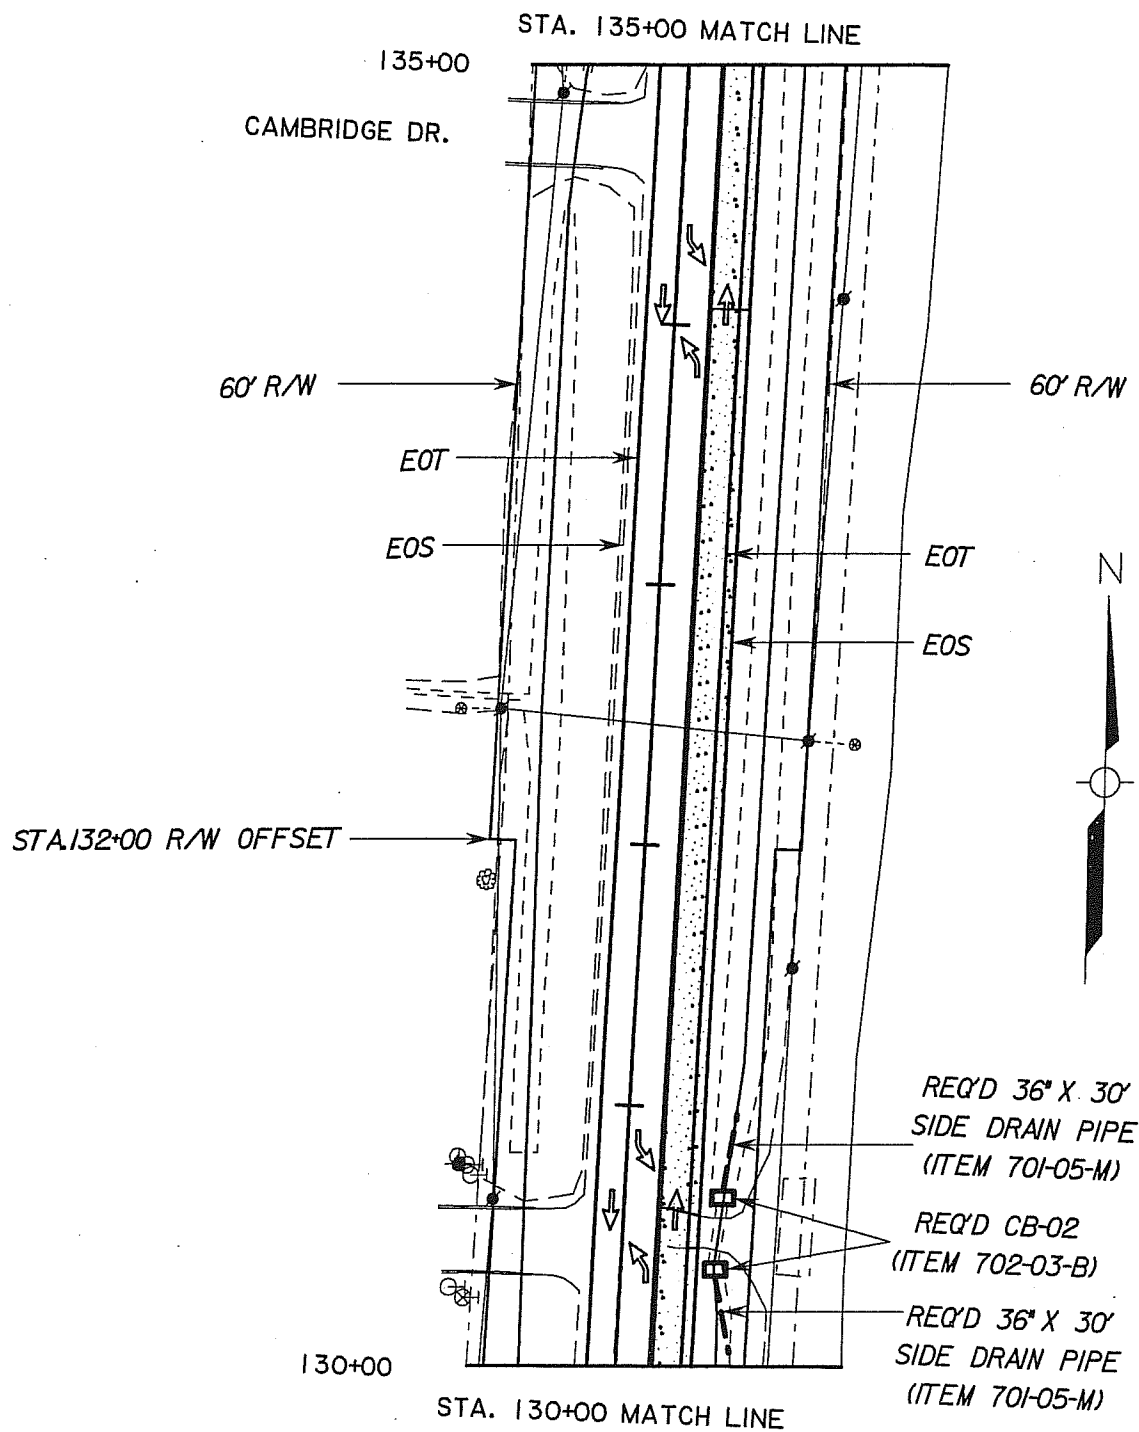

STN

DISTRICT C02 DESIGN		WOODLAND HWY. IMPROVEMENTS (LA 23 TO PLANTERS CANAL) - PHASE I									
		PLAN VIEW									
		TWO.	DATE	REVISION DESCRIPTION				BY			
											
	</										

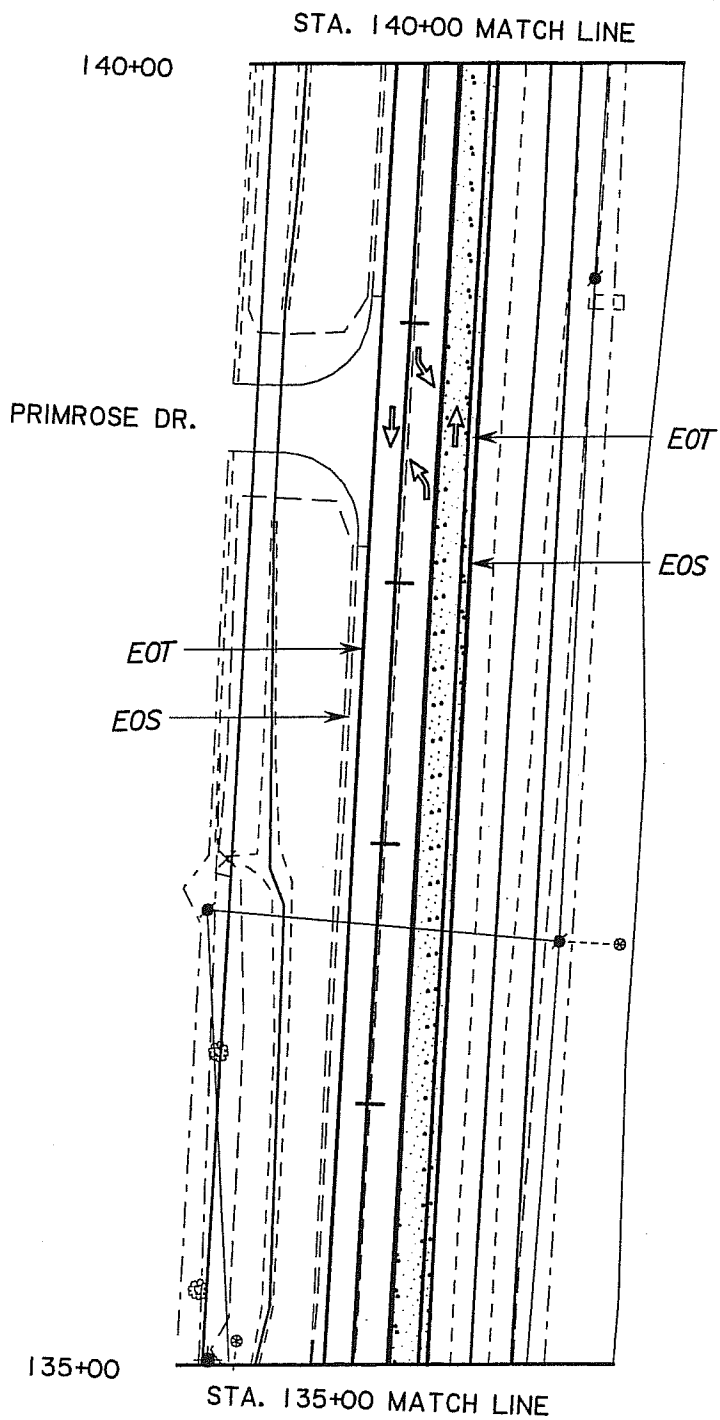


NTS

				WOODLAND HWY. IMPROVEMENTS (LA 23 TO PLANTERS CANAL) - PHASE I		DISTRICT 02 DESIGN	
NO. DATE		REVISION DESCRIPTION		PLAN VIEW		SHEET NO. 4e	
DESIGNED CHECKED JPM		DETAILED CHECKED JPM		DATE 9/20/08		BY 4e	
PARISH PLaquemines		FEDERAL PROJECT		STATE PROJECT		838-03-0023	


07-OCT-2008 15:25

R:\PROJECT FOLDERS\B38-03-0022 LA 406 WIDENING\DESIGN\REVISION OF SURPLUS DSGN.dgn

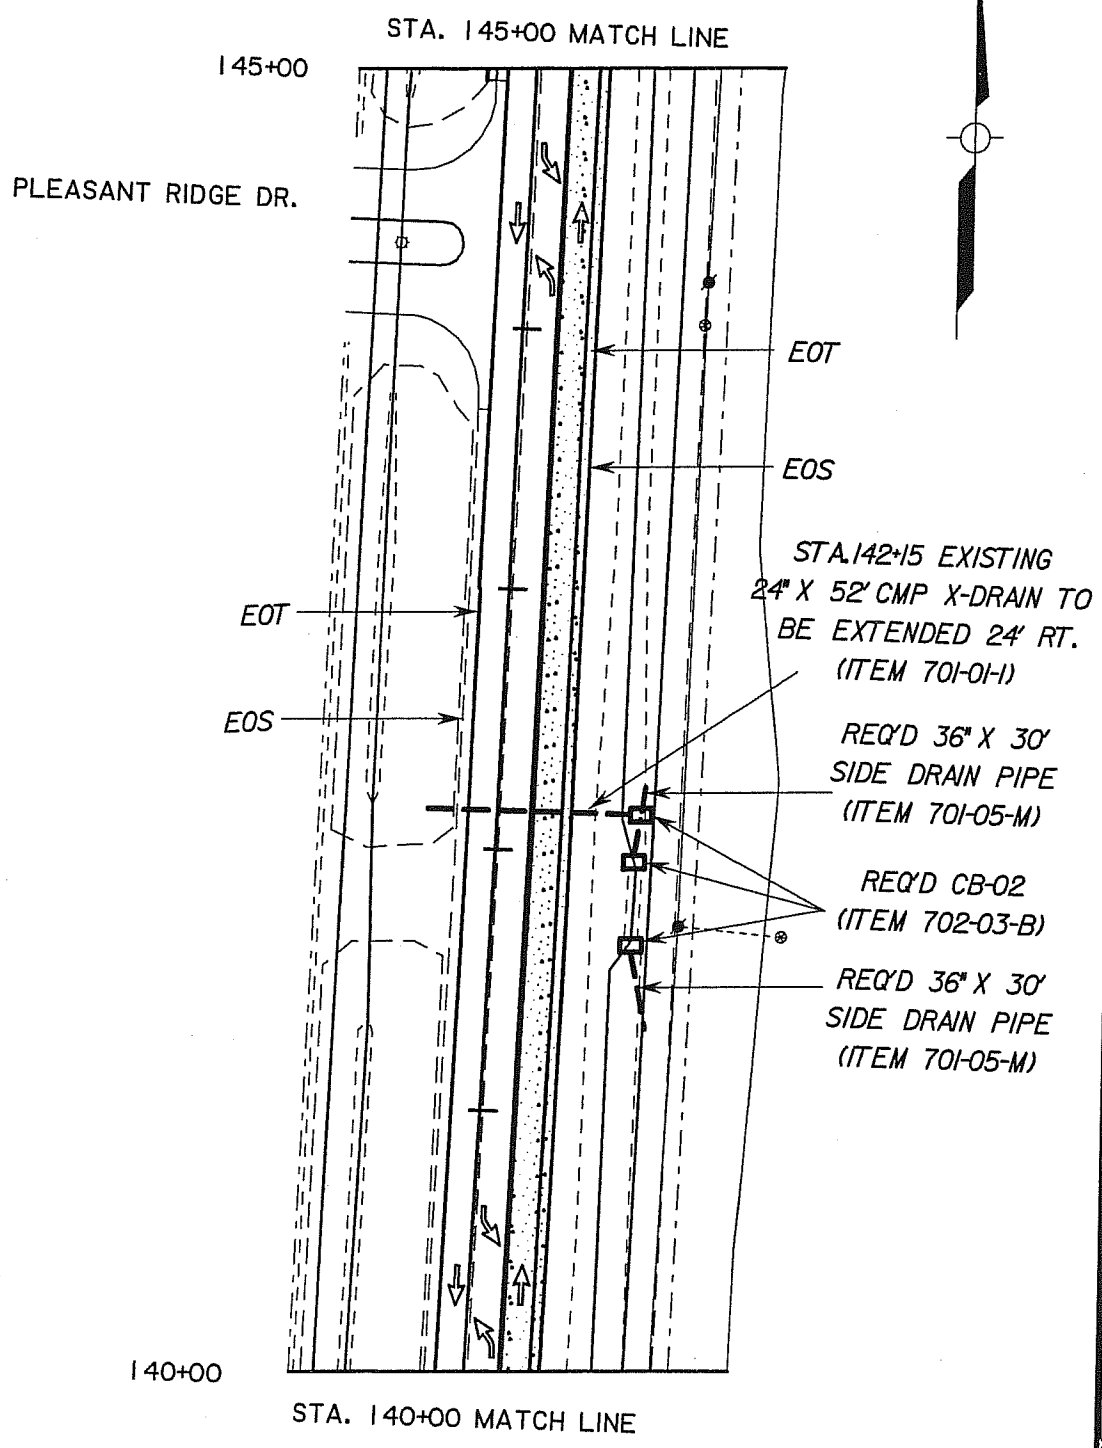


NTS

SHEET NO. 4f	
PLAQUEMINES	
PARISH	FEDERAL PROJECT
STATE PROJECT	838-03-0023
DESIGNED	CMS
CHECKED	JPM
DATE	9/2008
BY	4f
REVISION DESCRIPTION	
NO.	DATE
WOODLAND HWY. IMPROVEMENTS (LA 23 TO PLANTERS CANAL) - PHASE I	
PLAN VIEW	
DISTRICT 02 DESIGN	

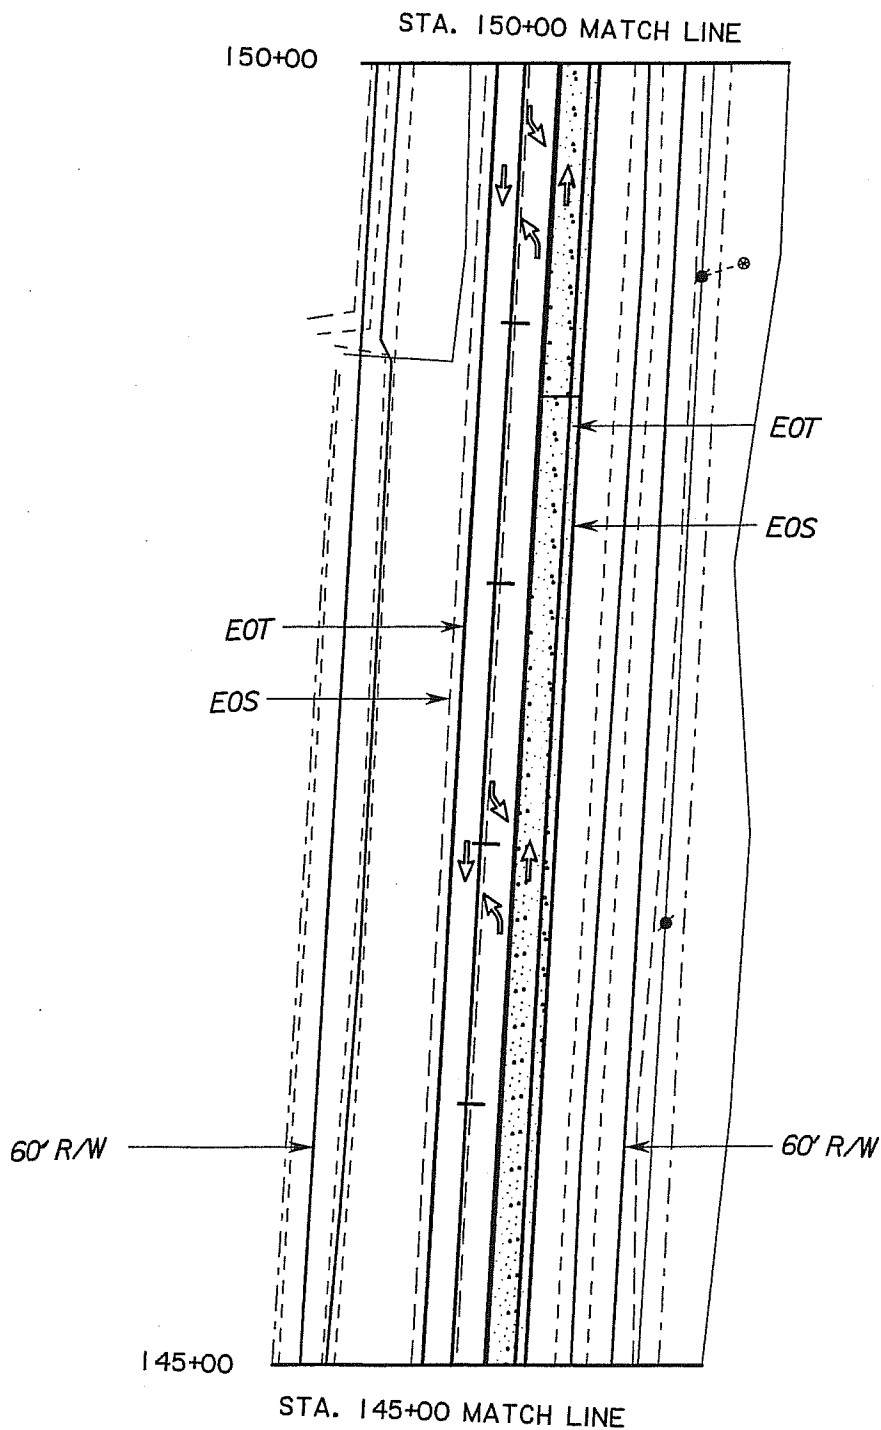

NTS


SHEET NO. 40		PLAQUEMINES		PARISH		DESIGNED		CHECKED		DATE		BY	
838-03-0023		FEDERAL PROJECT		STATE PROJECT		9/2008		4		9/2008		4	
WOODLAND HWY. IMPROVEMENTS (LA 23 TO PLANTERS CANAL) - PHASE I													
PLAN VIEW													
DISTRICT Q2 DESIGN													

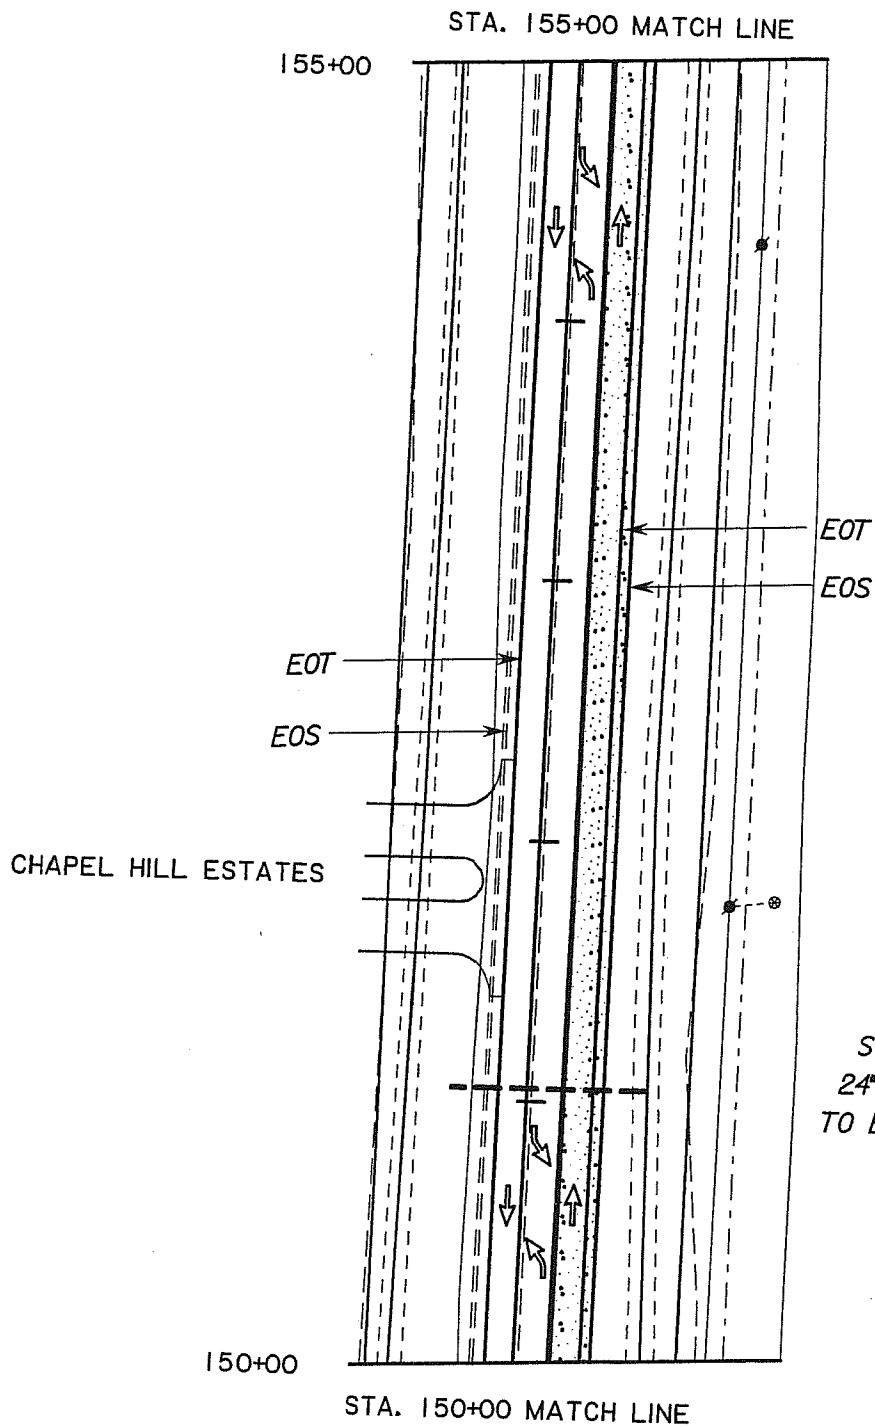

STA. 151+05 EXISTING
24" X 52' CMP X-DRAIN
TO BE EXTENDED 24' RT.
(ITEM 701-01-1)

NTS

SHEET NO. 4h		PLAQUEMINES		PARISH		FEDERAL PROJECT		STATE PROJECT 838-03-0023	
DESIGNED	CAR	CHECKED	ARM	DATE	9/2008	BY	SHEET	4h	
REVISION DESCRIPTION									
NO. DATE									
									
WOODLAND HWY. IMPROVEMENTS (LA 23 TO PLANTERS CANAL) - PHASE I									
PLAN VIEW									
									
DISTRICT 02 DESIGN									

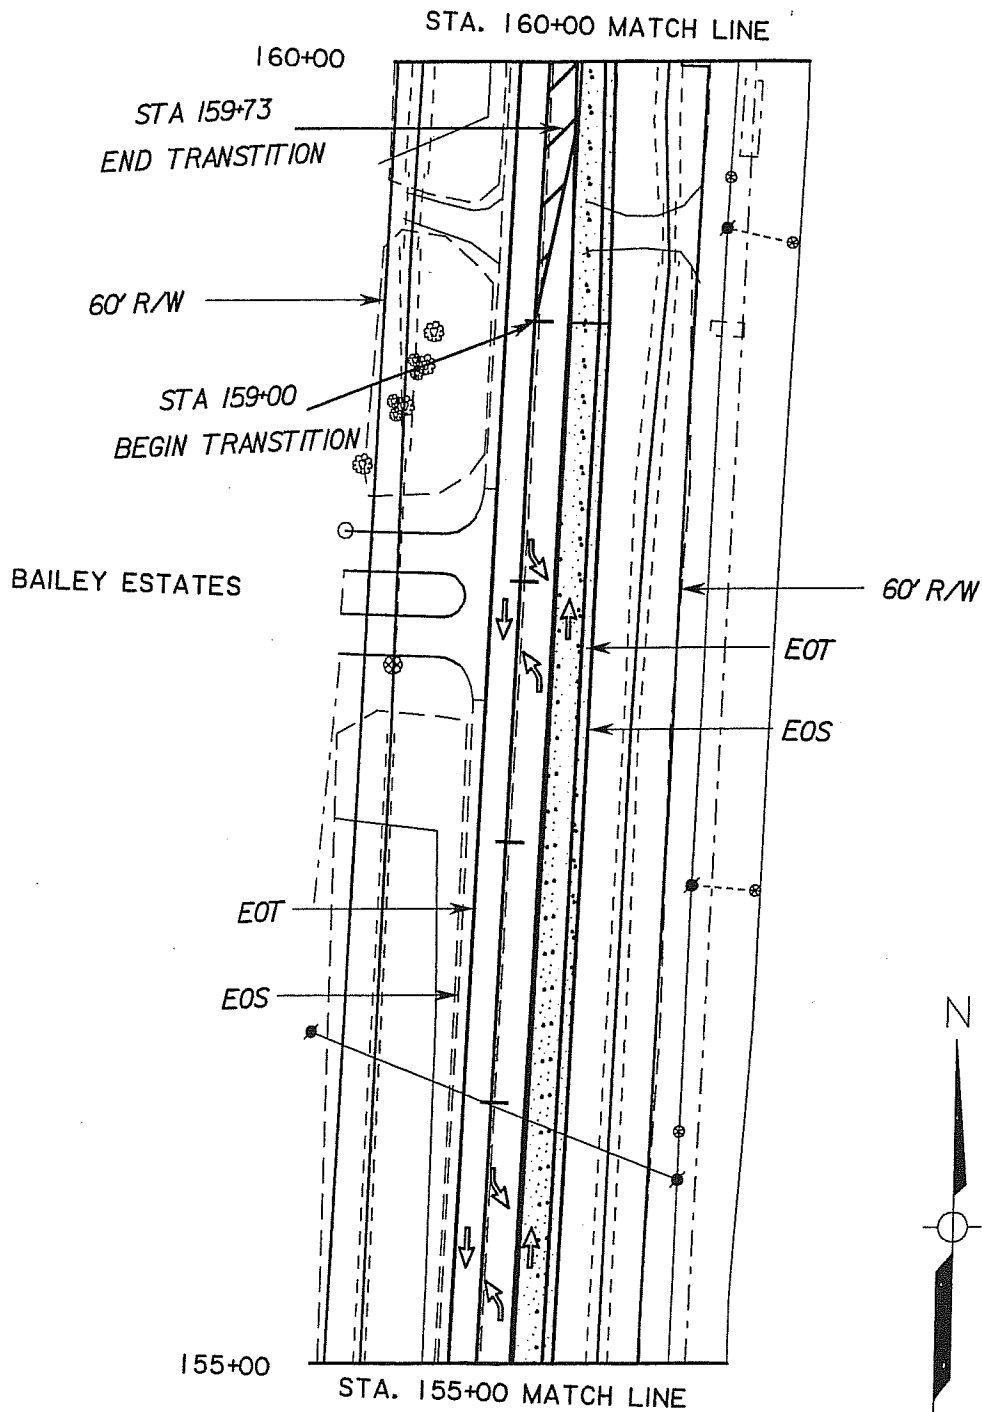


NTS

SHEET NO. 41		PLAQUEMINES		PARISH		FEDERAL PROJECT		STATE PROJECT	
DESIGNED JPM		CHECKED JPM		DATE 9/2008		BY SHEET 4		REVISION DESCRIPTION	
NO.		DATE		NO.		DATE		REVISION DESCRIPTION	
DISTRICT 02 DESIGN		WOODLAND HWY. IMPROVEMENTS (LA 23 TO PLANTERS CANAL) - PHASE I		PLAN VIEW		DISTRICT 02 DESIGN		DISTRICT 02 DESIGN	

07-OCT-2008 08:53

R:\PROJECT FOLDERS\838-03-0022 LA 406 WIDENING\DESIGN\REVISION OF SURPLUS DSIGN.dgn

STA.181+90,END S.P.838-03-0023
END CONSTRUCTION AT PLANTERS
CANAL (STA.181+90) LOG MILE 159 NOT SHOWN

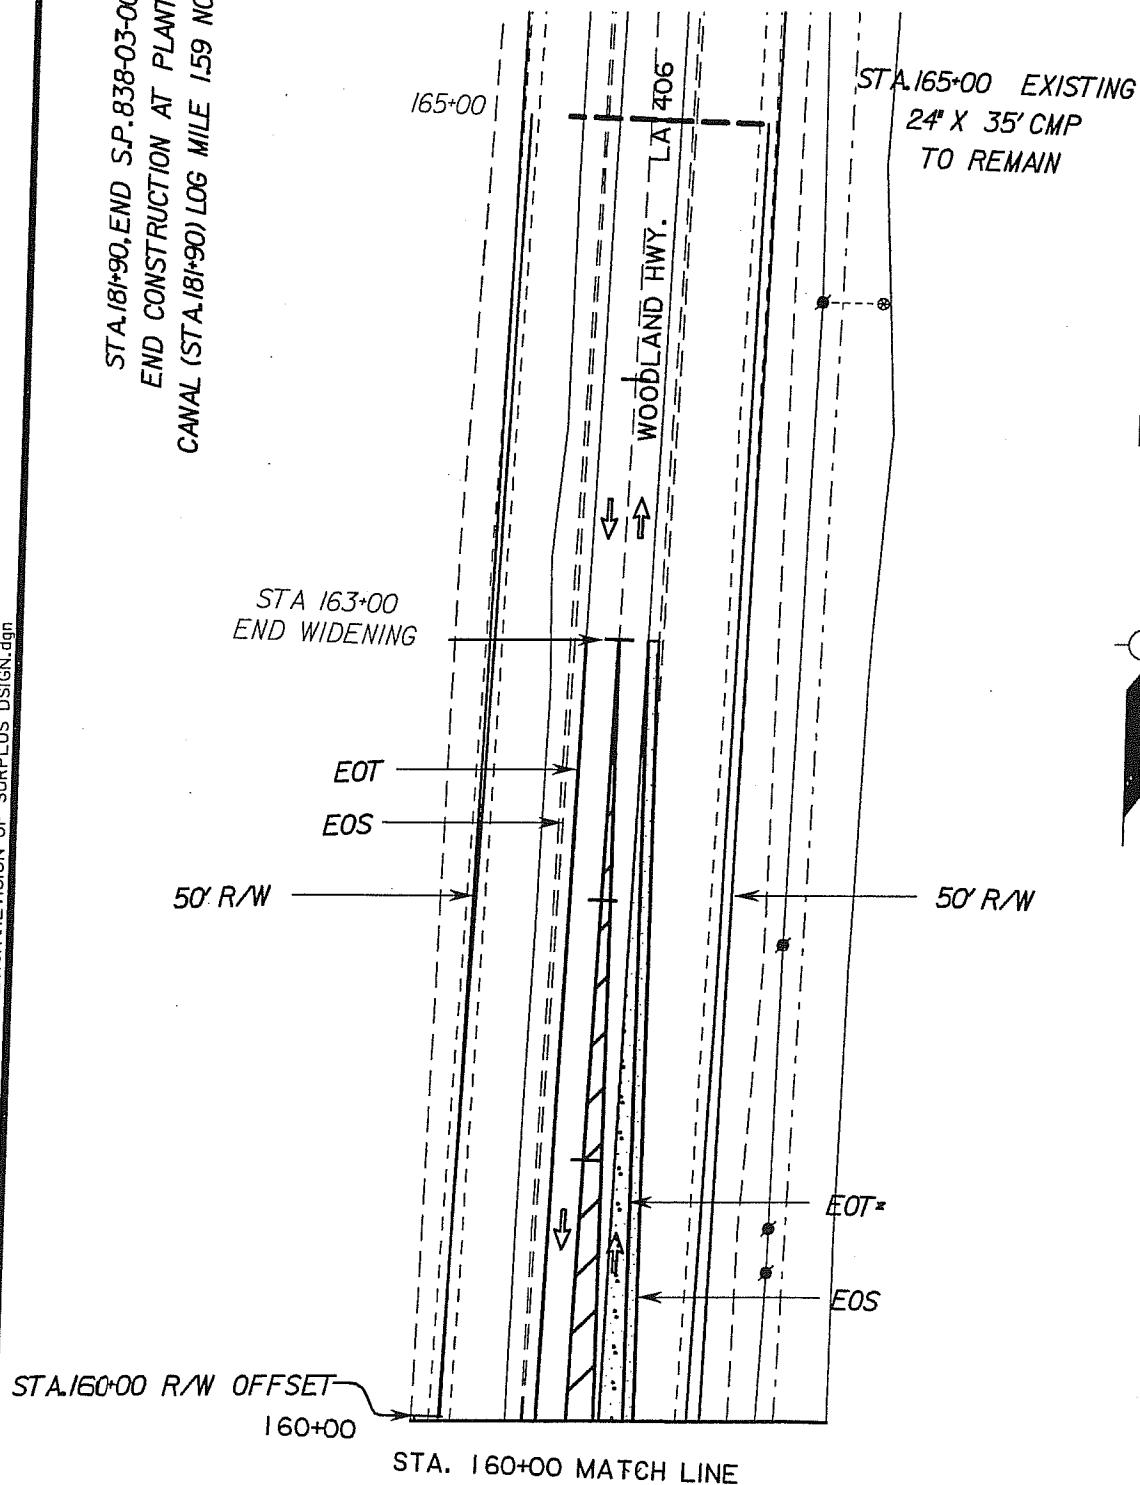


NTS

SHEET NO. 41		PLAQUEMINES		PARISH		FEDERAL PROJECT		STATE PROJECT 838-03-0023	
DESIGNED	CMS	CMS	DATE 9/2008	BY	REVISION DESCRIPTION	NO.	DATE	PLAN VIEW	
CHECKED	JRM	CHECKED	JRM						
									
WOODLAND HWY. IMPROVEMENTS (LA 23 TO PLANTERS CANAL) - PHASE I									
									
DISTRICT 02 DESIGN									


REMOVAL OF CONCRETE CURBS AND OFFSETS			
STATION	SUBDIVISION	LENGTH OF CURB TO BE REMOVED (ITEM 202-02-E)	LENGTH OF CURB TO BE REPLACED (ITEM 707-01)
122+65	SPRING WOOD ESTATES	100 FEET	100 FEET
			20 FEET
			REQ'D OFFSET DISTANCE (OR AS DIRECTED BY PROJECT ENGINEER)

				NO. DATE REVISION DESCRIPTION BY		DESIGNED CHECKED DATED DATE SHEET	PARISH FEDERAL PROJECT STATE PROJECT	PLAQUEMINES 838-03-0023	SHEET NO. 5
DISTRICT 02 DESIGN		WOODLAND HWY. IMPROVEMENTS (LA 23 TO PLANTERS CANAL) - PHASE I REMOVAL OF CONCRETE CURBS				9/2008 5			

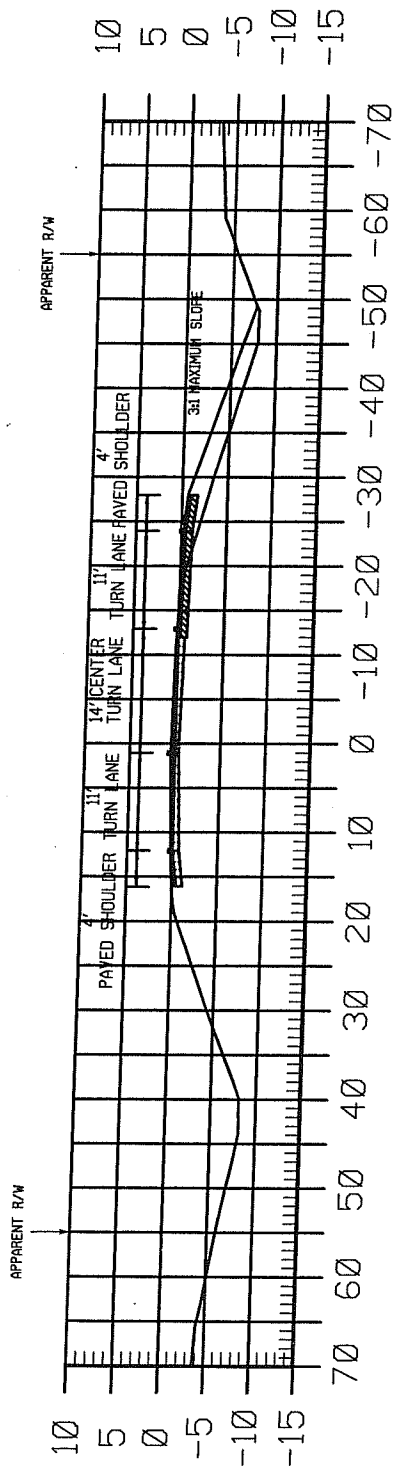

GENERAL EXCAVATION = 89 CUBIC YARDS
 DRAINAGE EXCAVATION = 74 CUBIC YARDS
 NON-PLASTIC EMBANKMENT = 427.3 CUBIC YARDS

112+00

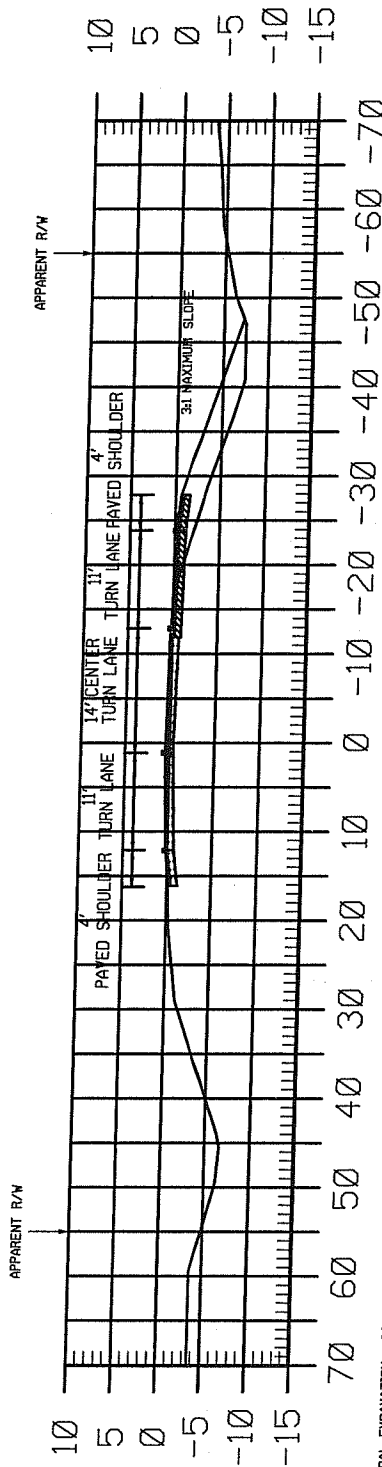


GENERAL EXCAVATION = 89 CUBIC YARDS
 DRAINAGE EXCAVATION = 74 CUBIC YARDS
 NON-PLASTIC EMBANKMENT = 427.3 CUBIC YARDS

113+00


NTS

DISTRICT 02 DESIGN		WOODLAND HWY. IMPROVEMENTS (LA 23 TO PLANTERS CANAL) - PHASE I		SHEET NO. 6	
CROSS SECTIONS		REVISION DESCRIPTION		BY SHEET	
NO. DATE		DATE 9/2008		STATE PROJECT 838-03-0023	
DESIGNED CAG		CHECKED JRM		PARISH PLAQUEMINES	
DETAILED CAG		CHECKED JRM		FEDERAL PROJECT	

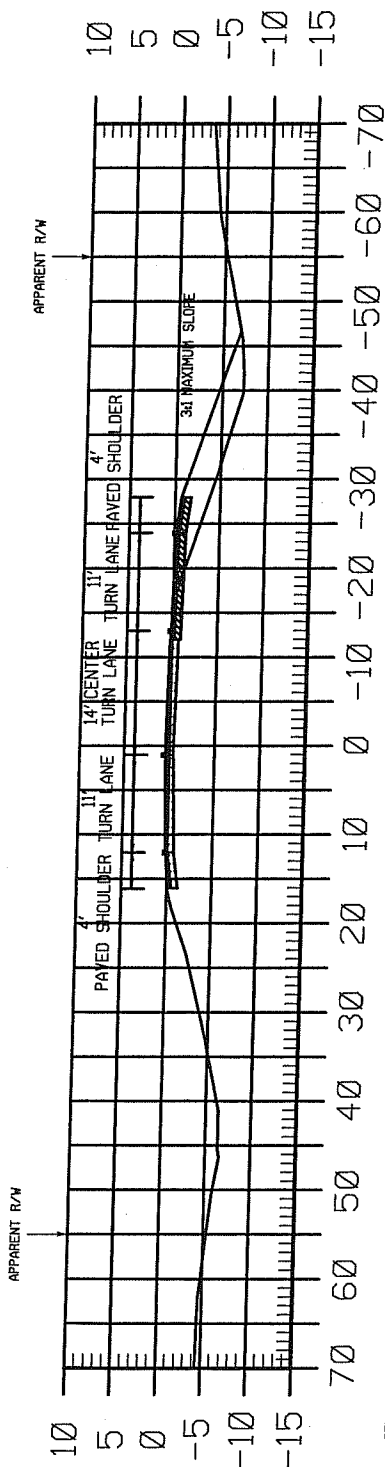

GENERAL EXCAVATION = 89 CUBIC YARDS
DRAINAGE EXCAVATION = 74 CUBIC YARDS
NON-PLASTIC EMBANKMENT = 423.2 CUBIC YARDS

114+00

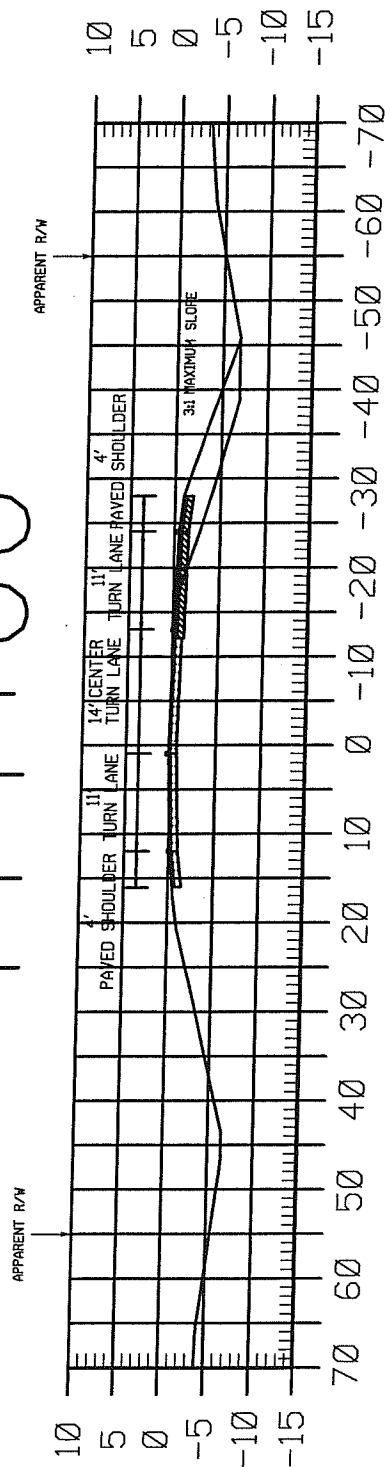


GENERAL EXCAVATION = 89 CUBIC YARDS
DRAINAGE EXCAVATION = 74 CUBIC YARDS
NON-PLASTIC EMBANKMENT = 384.9 CUBIC YARDS

115+00


NTS

DISTRICT 8 DESIGN		WOODLAND HWY. IMPROVEMENTS (LA 23 TO PLANTERS CANAL) - PHASE I				NO. DATE REVISION DESCRIPTION		BY SHEET 9/2008 6a		DATE 9/2008		CHECKED JPM		DESIGNED JPM		PARISH PLAQUEMINES		FEDERAL PROJECT		STATE PROJECT 838-03-0023		SHEET NO. 6a	
----------------------	--	---	--	--	--	----------------------------------	--	-----------------------	--	----------------	--	----------------	--	-----------------	--	-----------------------	--	--------------------	--	------------------------------	--	-----------------	--

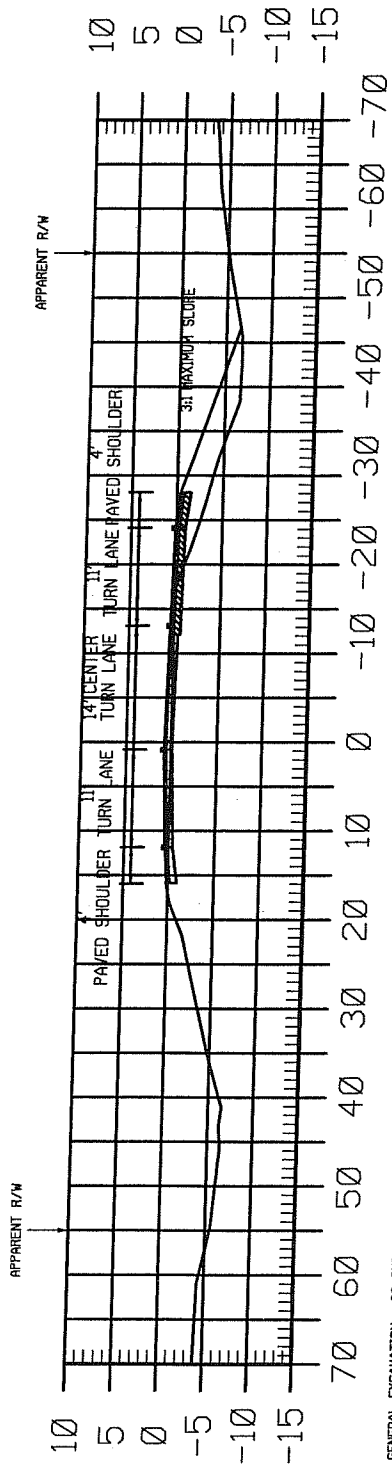

GENERAL EXCAVATION = 89 CUBIC YARDS
DRAINAGE EXCAVATION = 74 CUBIC YARDS
NON-PLASTIC EMBANKMENT = 411.1 CUBIC YARDS

116+00

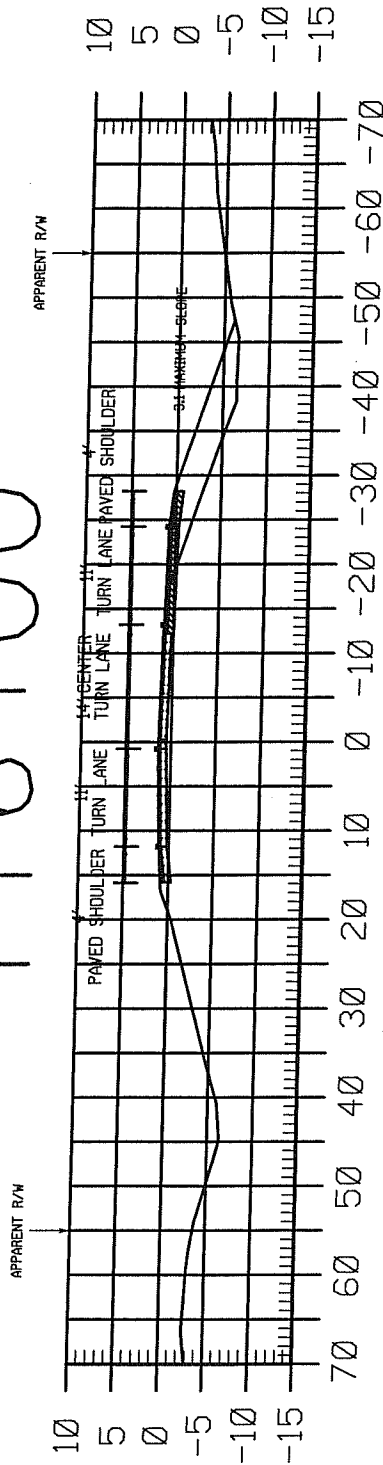


GENERAL EXCAVATION = 89 CUBIC YARDS
DRAINAGE EXCAVATION = 74 CUBIC YARDS
NON-PLASTIC EMBANKMENT = 454.4 CUBIC YARDS

117+00


NTS

		WOODLAND HWY. IMPROVEMENTS (LA 23 TO PLANTERS CANAL) - PHASE I		CROSS SECTIONS	
DISTRICT DESIGN		NO. DATE		REVISION DESCRIPTION	
DESIGNED ☒ CMR CHECKED ☒ JRM		PARISH PLAQUEMINES		SHEET NO. 86	
DETAILED ☒ CMR CHECKED ☒ JRM		FEDERAL PROJECT		STATE PROJECT 838-03-0023	
DATE 9/2008 BY 86					

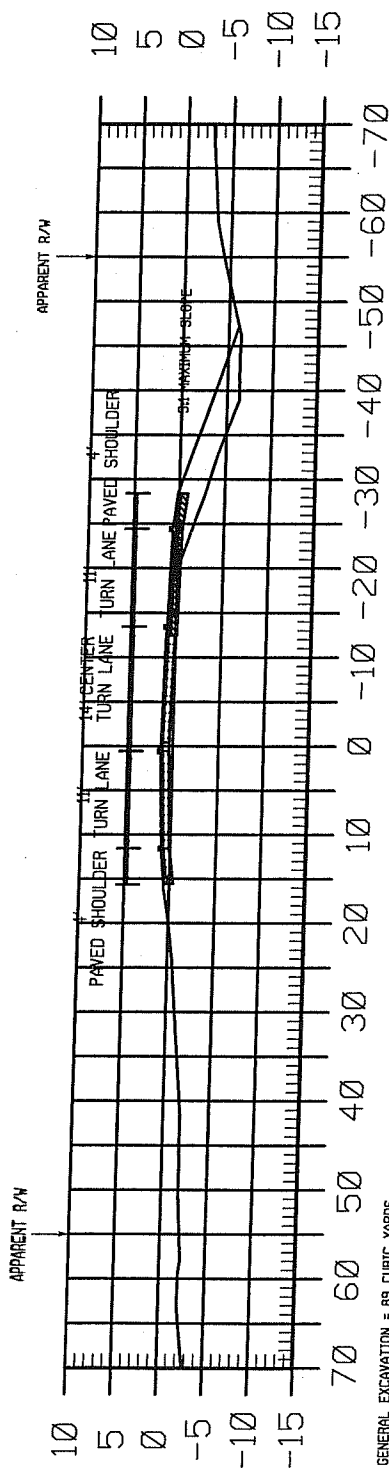

GENERAL EXCAVATION = 89 CUBIC YARDS
 DRAINAGE EXCAVATION = 74 CUBIC YARDS
 NON-PLASTIC EMBANKMENT = 464.2 CUBIC YARDS

118+00

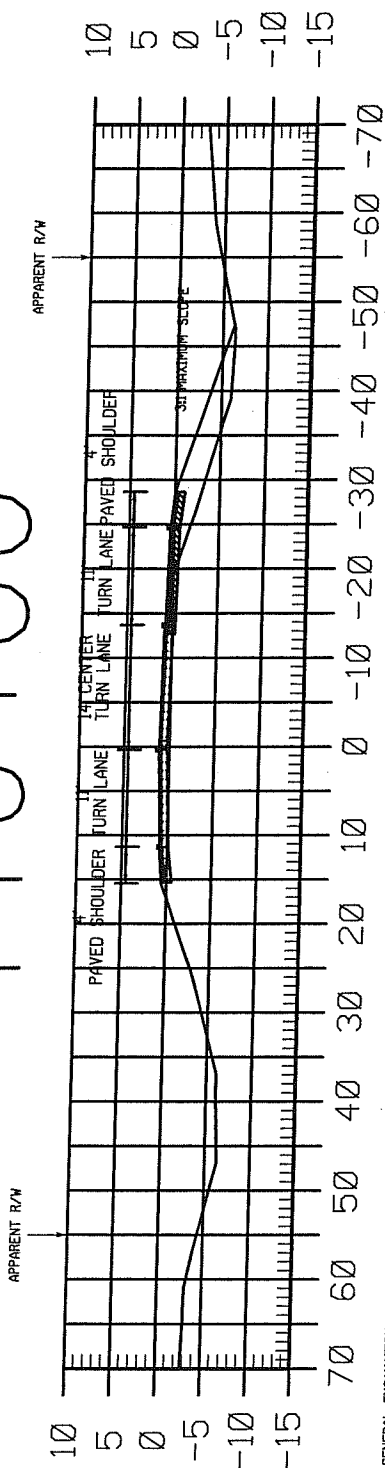


GENERAL EXCAVATION = 89 CUBIC YARDS
 DRAINAGE EXCAVATION = 74 CUBIC YARDS
 NON-PLASTIC EMBANKMENT = 366.7 CUBIC YARDS


119+00

NTS

		WOODLAND HWY. IMPROVEMENTS (LA 23 TO PLANTERS CANAL) - PHASE I		CROSS SECTIONS		DISTRICT 8 DESIGN	
NO. _____ DATE _____		REVISION DESCRIPTION _____		BY _____		SHEET NO. 6	
DESIGNED CMG CHECKED JRM		PARISH _____		PLAQUEMINES		SHEET NO. 6	
DETAILED CMG CHECKED JRM		FEDERAL PROJECT _____		STATE PROJECT 838-03-0023		DATE 9/2008 BY 66	

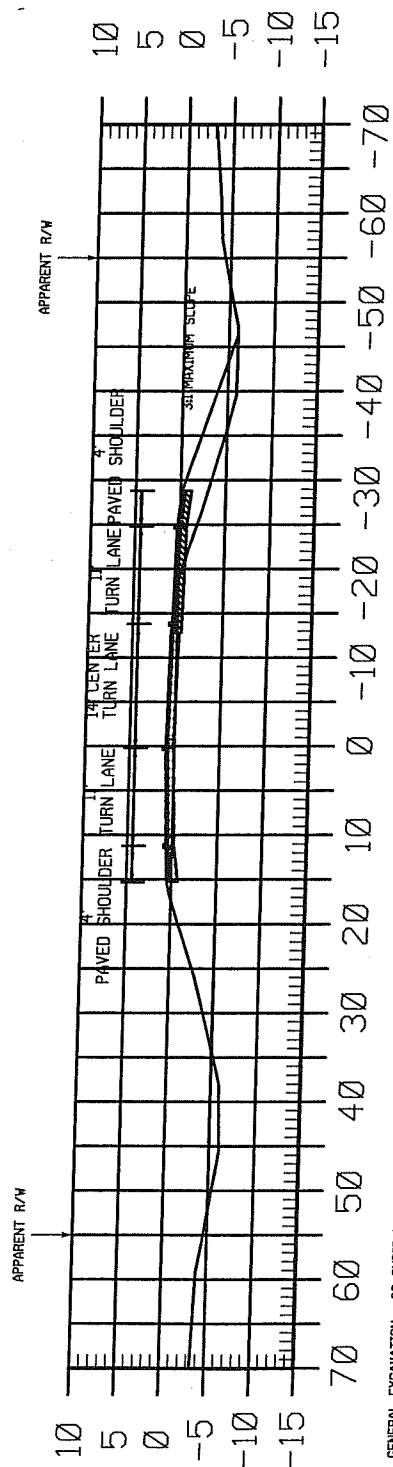


120+00

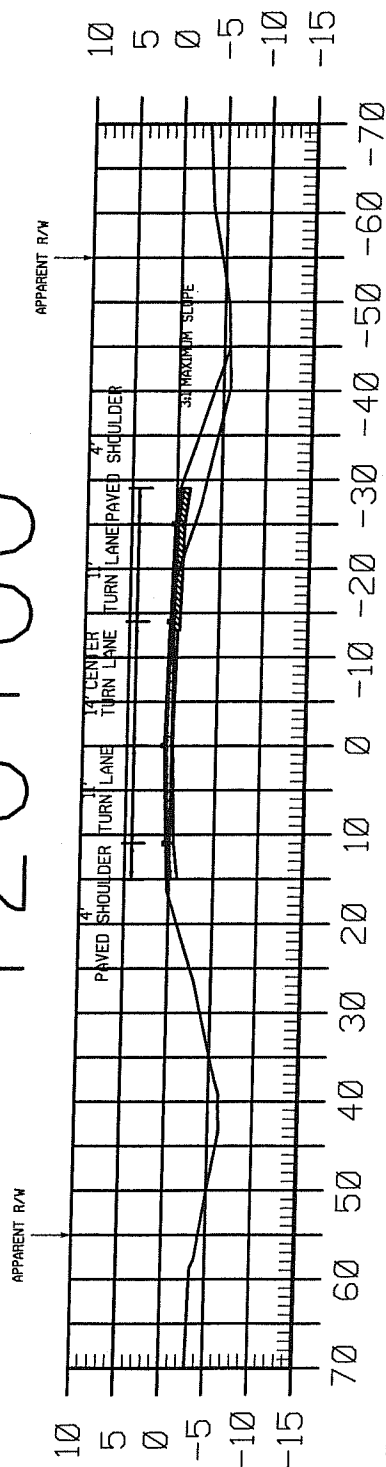

121+00


NTS

		WOODLAND HWY. IMPROVEMENTS (LA 23 TO PLANTERS CANAL) - PHASE I		SHEET NO. 6d	
DISTRICT 02 DESIGN		CROSS SECTIONS		PARISH PLAQUEMINES	
NO. DATE		REVISION DESCRIPTION		DESIGNED CMS JPM CHECKED JPM	
NO. DATE		REVISION DESCRIPTION		DETAILED CMS JPM CHECKED JPM	
NO. DATE		REVISION DESCRIPTION		DATE 9/2008 BY 6d	
NO. DATE		REVISION DESCRIPTION		STATE PROJECT 838-03-0023	

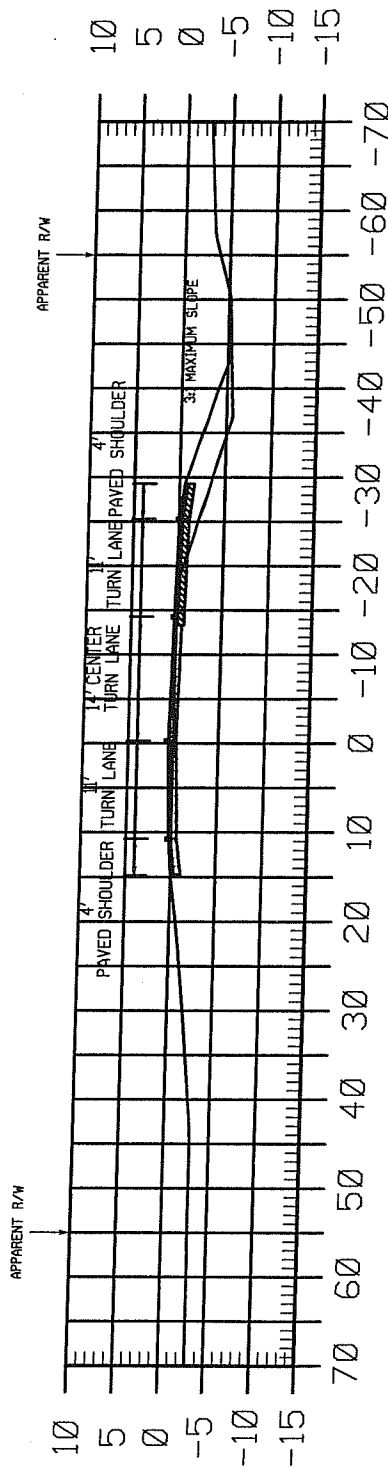

GENERAL EXCAVATION = 89 CUBIC YARDS
 DRAINAGE EXCAVATION = 74 CUBIC YARDS
 NON-PLASTIC EMBANKMENT = 341.5 CUBIC YARDS

122+00

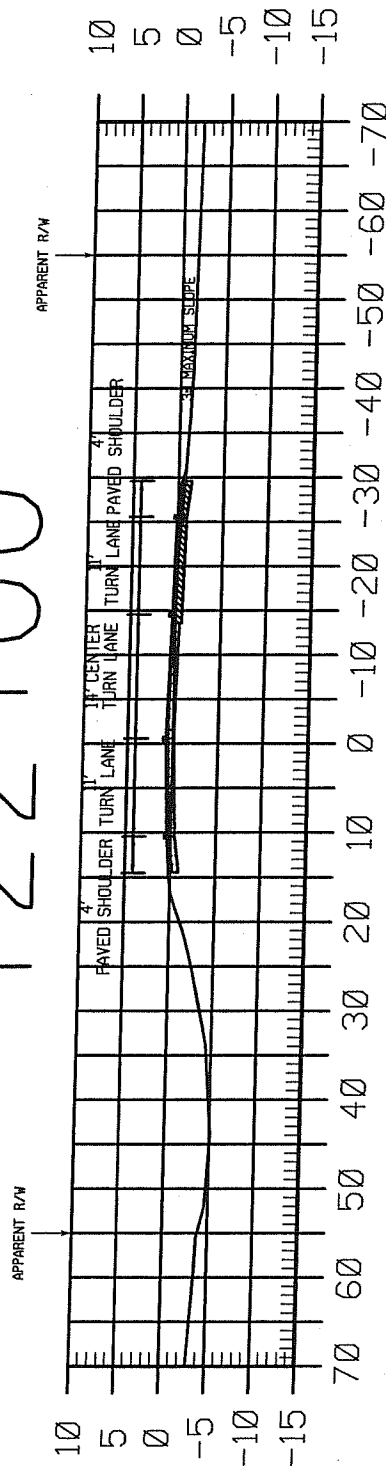


GENERAL EXCAVATION = 89 CUBIC YARDS
 DRAINAGE EXCAVATION = 74 CUBIC YARDS
 NON-PLASTIC EMBANKMENT = 113.7 CUBIC YARDS


123+00

NTS

 DISTRICT 02 DESIGN	WOODLAND HWY. IMPROVEMENTS (LA 23 TO PLANTERS CANAL) - PHASE I			DESIGNED	CAG	PARISH	PLAQUEMINES	SHEET NO.	68
	CROSS SECTIONS			CHECKED	JRM	FEDERAL PROJECT	STATE PROJECT	838-03-0023	
NO. DATE REVISION DESCRIPTION BY		DATE 9/2008		CHECKED JRM		PROJECT 838-03-0023		SHEET 68	

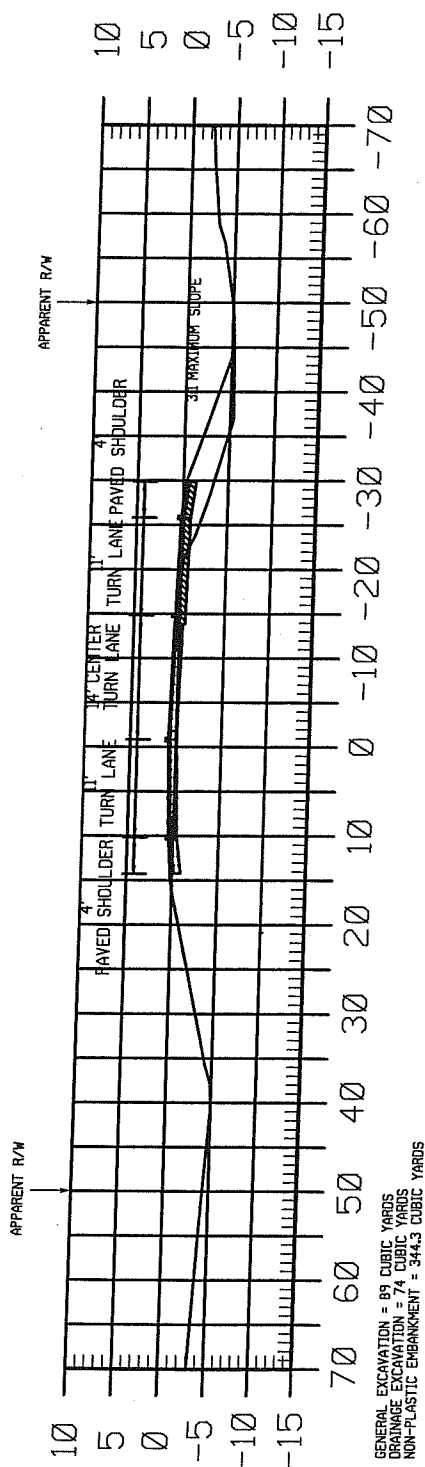


124+00

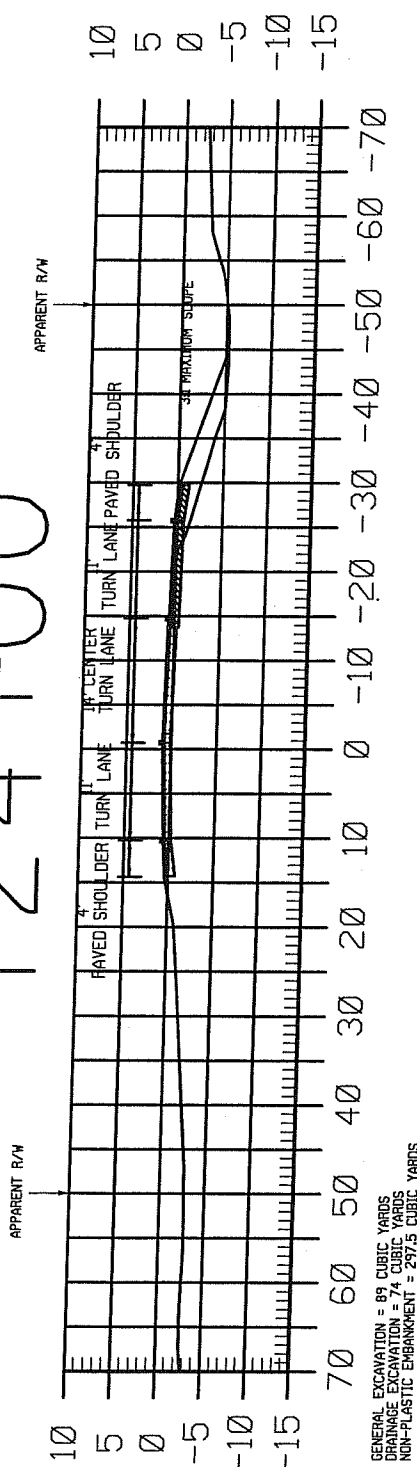


125+00

NTS

		DISTRICT 02 DESIGN		WOODLAND HWY. IMPROVEMENTS (LA 23 TO PLANTERS CANAL) - PHASE I		CROSS SECTIONS		NO. DATE BY		REVISION DESCRIPTION		DESIGNED CMS CHECKED JRM		PARISH PLAQUEMINES		SHEET NO. 6f	
												DETAILED CMS CHECKED JRM		FEDERAL PROJECT		STATE PROJECT 838-03-0023	
												DATE 9/2008 SHEET 6f					

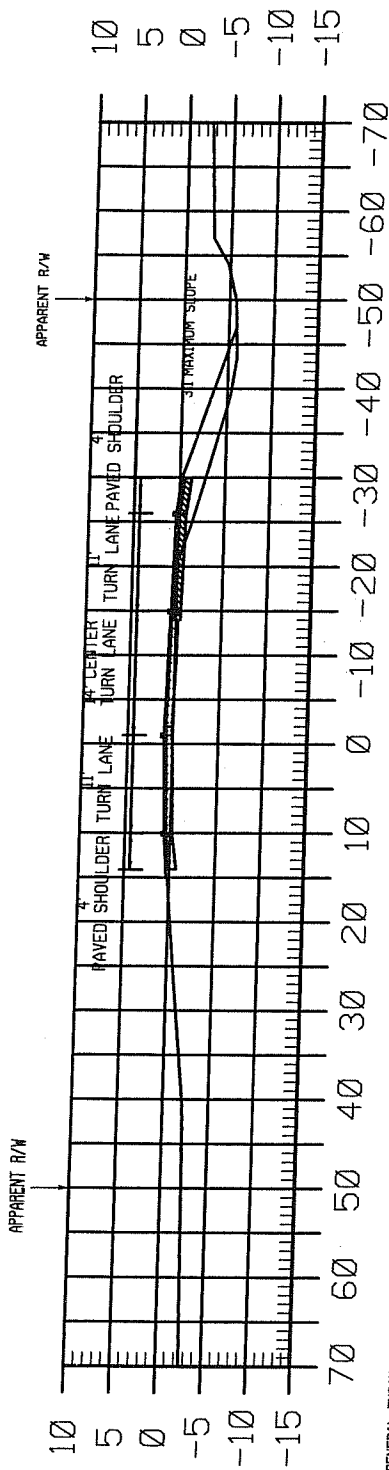


126+00

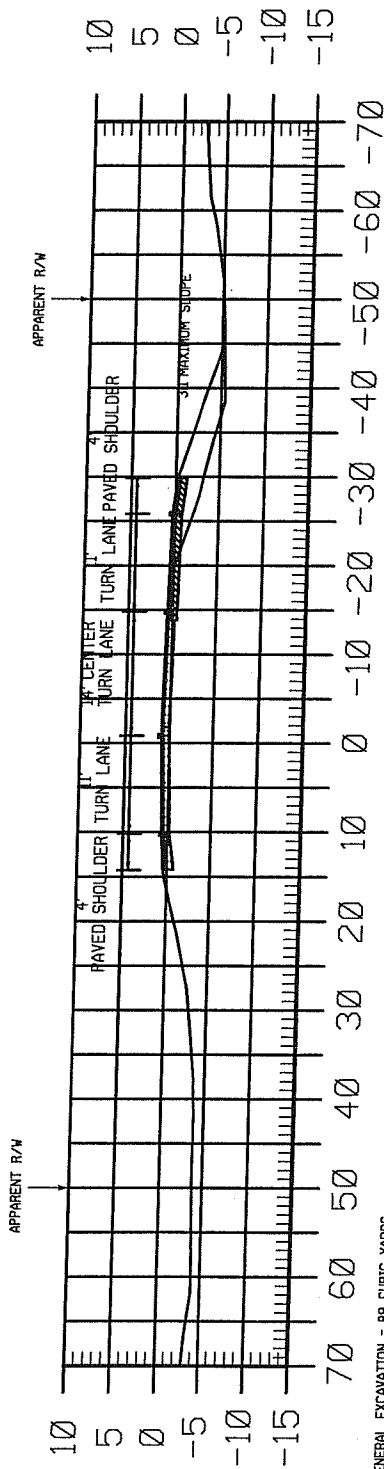

127+00


NTS

		WOODLAND HWY. IMPROVEMENTS (LA 23 TO PLANTERS CANAL) - PHASE I		CROSS SECTIONS		DISTRICT 2 DESIGN	
NO. _____ DATE _____		REVISION DESCRIPTION _____		BY _____ SHEET 6g		DATE 9/2008	
DESIGNED _____ CHECKED _____		DETAILED _____ CHECKED _____		PARISH _____ FEDERAL PROJECT _____		STATE PROJECT _____	
SHEET NO. _____		PLAQUEMINES		838-03-0023		6g	

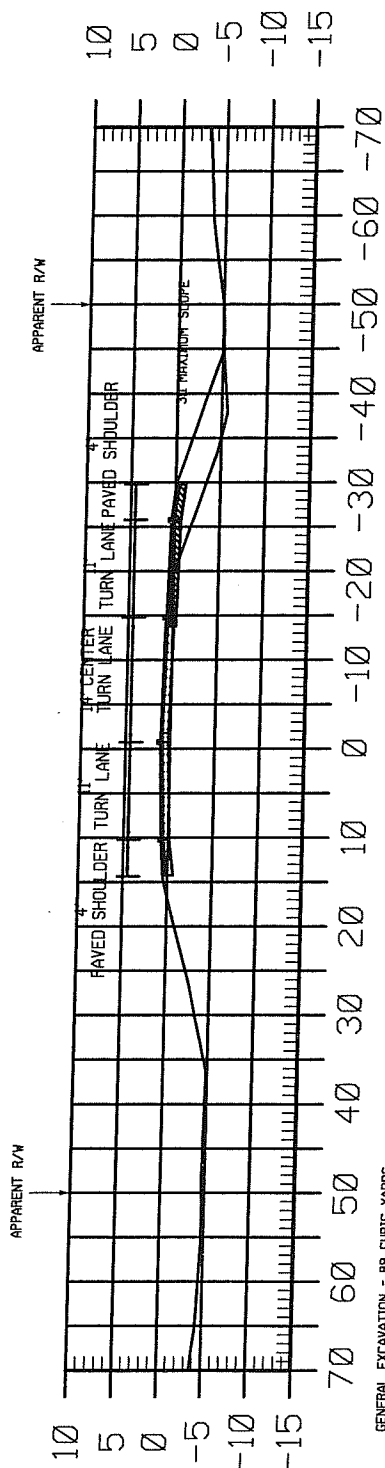

GENERAL EXCAVATION = 89 CUBIC YARDS
 DRAINAGE EXCAVATION = 74 CUBIC YARDS
 NON-PLASTIC EMBANKMENT = 36% CUBIC YARDS

128+00

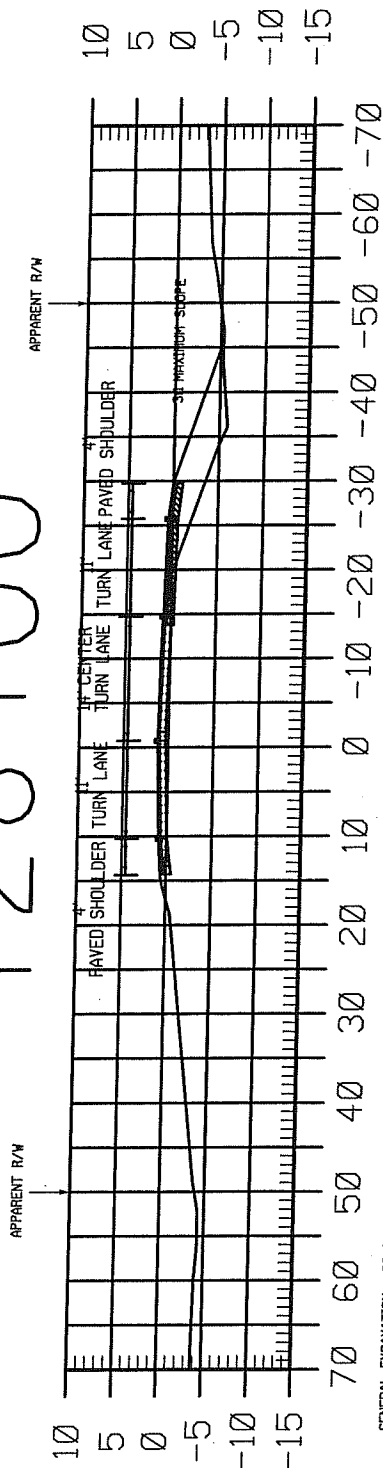


GENERAL EXCAVATION = 89 CUBIC YARDS
 DRAINAGE EXCAVATION = 74 CUBIC YARDS
 NON-PLASTIC EMBANKMENT = 44.8 CUBIC YARDS


129+00

NTS

				SHEET NO. 6h	
DISTRICT 2 DESIGN		WOODLAND HWY. IMPROVEMENTS (LA 23 TO PLANTERS CANAL) - PHASE I		PLAQUEMINES	
CROSS SECTIONS		NO. DATE		PARISH PROJECT	
REVISION DESCRIPTION		DATE 9/2008 BY SHEET 6h		FEDERAL PROJECT	
STATE PROJECT		839-03-0023		STATE PROJECT	

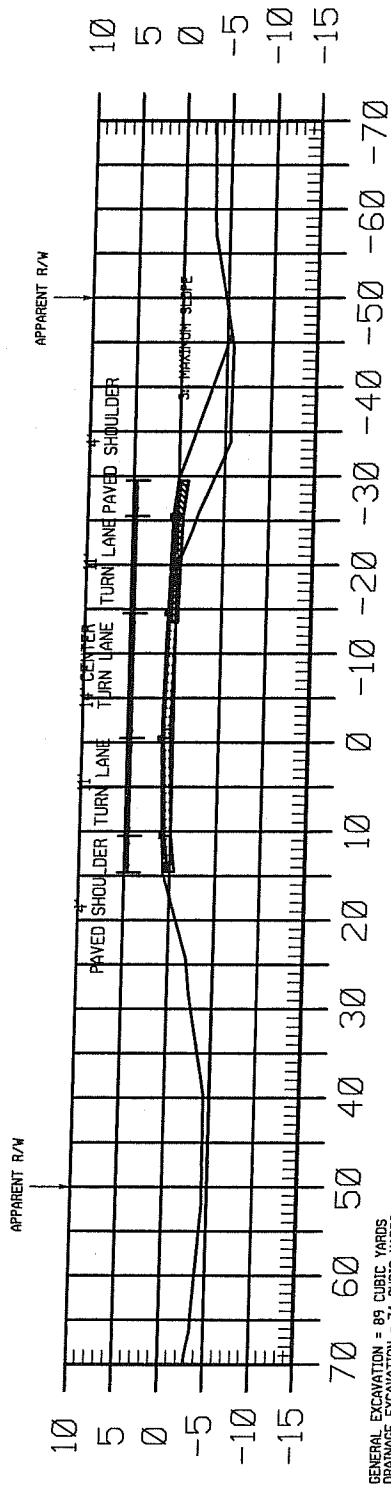


130+00

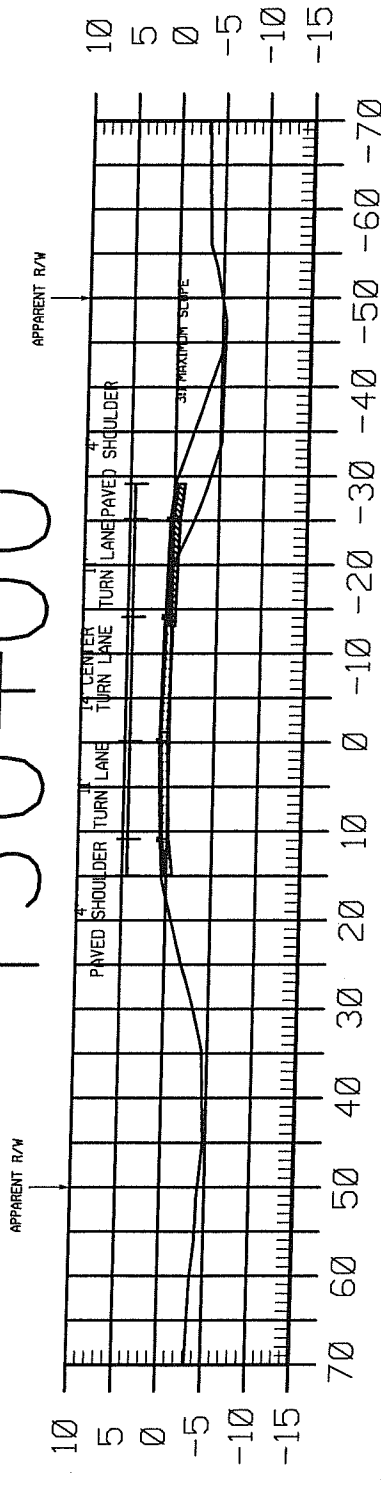

131+00


NTS

		WOODLAND HWY. IMPROVEMENTS (LA 23 TO PLANTERS CANAL) - PHASE I		CROSS SECTIONS		DISTRICT DESIGN 02
NO. 1 DATE _____		REVISION DESCRIPTION _____		BY SHEET 61		SHEET NO. 02
DESIGNED CHECKED DETAILED CHECKED	CAG CAG CAG CAG	PARISH FEDERAL PROJECT	PLAQUEMINES	DATE 9/2008	STATE PROJECT 838-03-0023	02

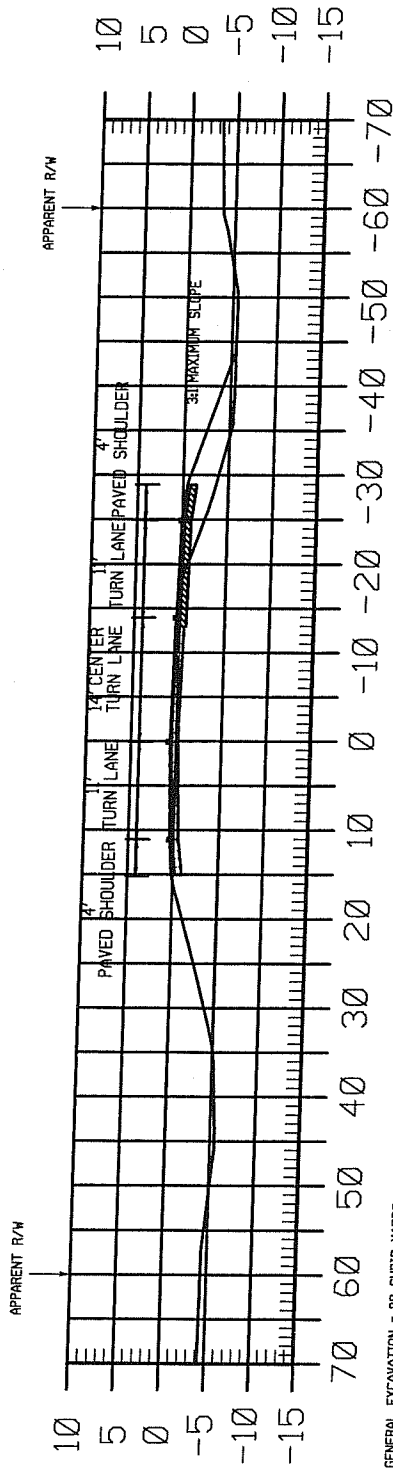

GENERAL EXCAVATION = 89 CUBIC YARDS
DRAINAGE EXCAVATION = 74 CUBIC YARDS
NON-PLASTIC EMBANKMENT = 360.6 CUBIC YARDS

132+00

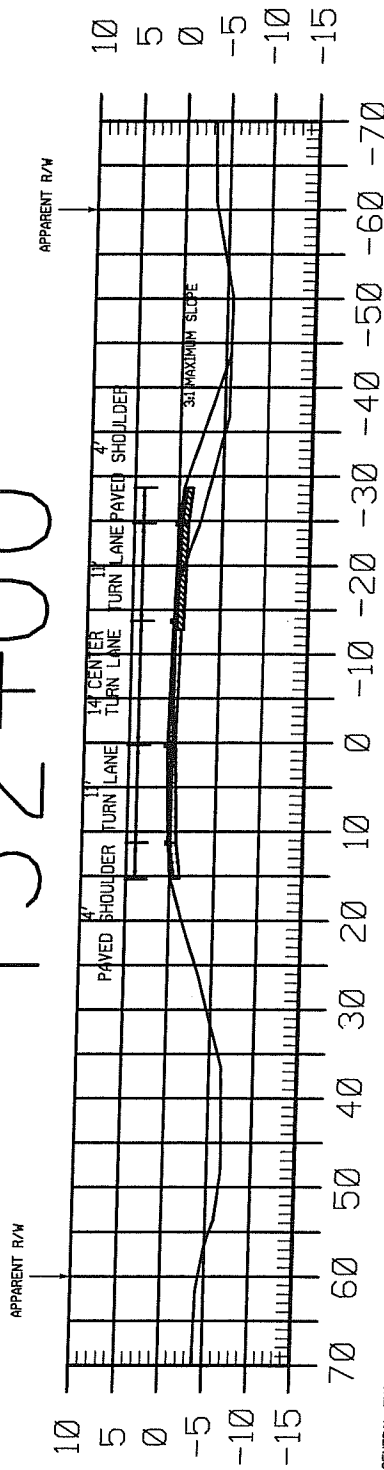


GENERAL EXCAVATION = 89 CUBIC YARDS
DRAINAGE EXCAVATION = 74 CUBIC YARDS
NON-PLASTIC EMBANKMENT = 343.6 CUBIC YARDS

133+00


NTS

				WOODLAND HWY. IMPROVEMENTS (LA 23 TO PLANTERS CANAL) - PHASE I		CROSS SECTIONS	
NO. _____ DATE _____		REVISION DESCRIPTION _____		BY _____		SHEET NO. 02	
DESIGNED CMS CHECKED JRM		PARISH PLAQUEMINES		FEDERAL PROJECT _____		STATE PROJECT 838-03-0023	
DETAILED CMS CHECKED JRM		DATE 9/2008		SHEET 02		PROJECT 838-03-0023	

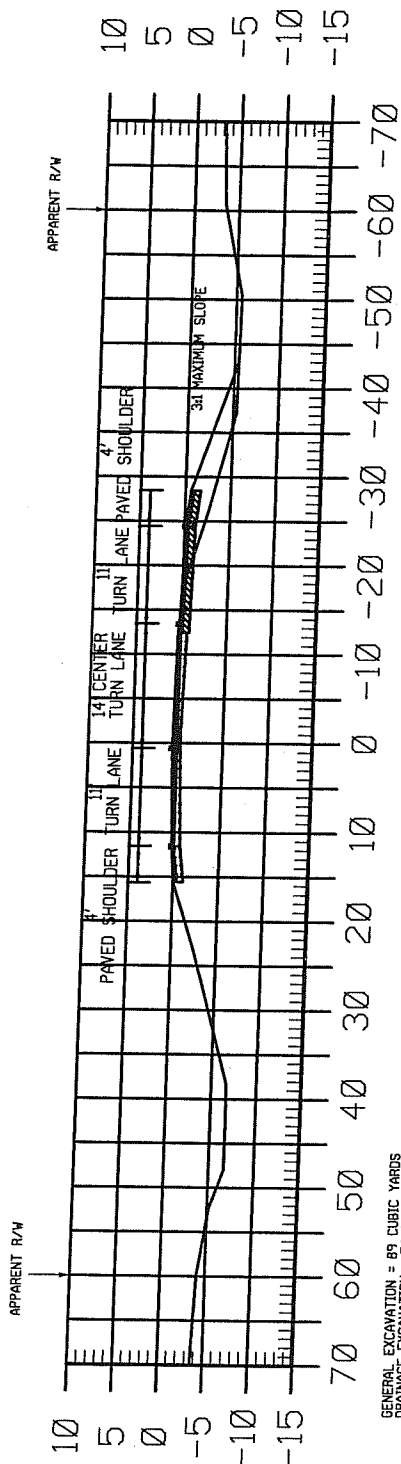

GENERAL EXCAVATION = 89 CUBIC YARDS
DRAINAGE EXCAVATION = 74 CUBIC YARDS
NON-PLASTIC EMBANKMENT = 386.6 CUBIC YARDS

134+00

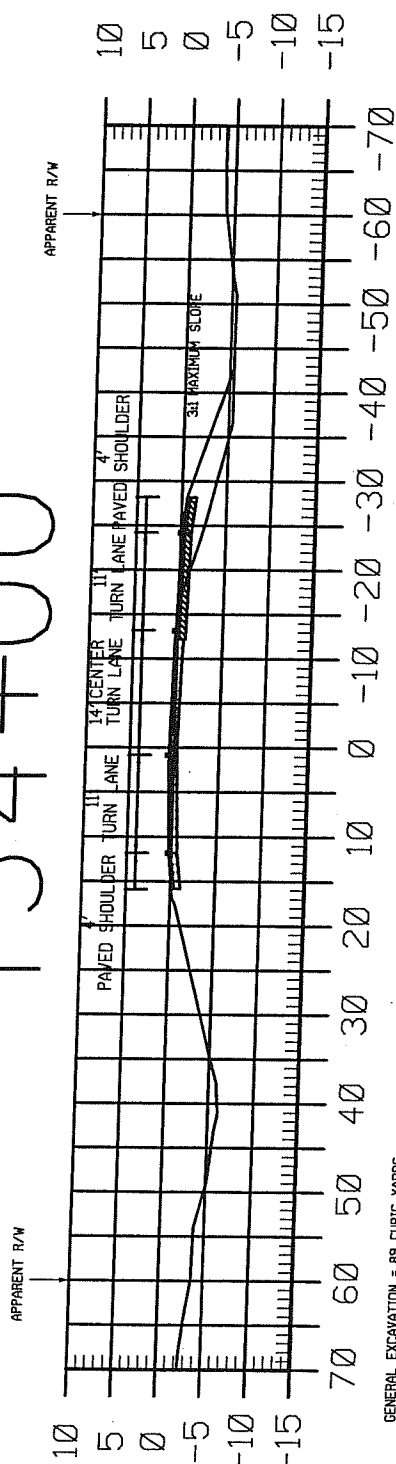


GENERAL EXCAVATION = 89 CUBIC YARDS
DRAINAGE EXCAVATION = 74 CUBIC YARDS
NON-PLASTIC EMBANKMENT = 343.2 CUBIC YARDS

135+00


NTS

DISTRICT 02 DESIGN		WOODLAND HWY. IMPROVEMENTS (LA 23 TO PLANTERS CANAL) - PHASE I		SHEET NO. 6k	
CROSS SECTIONS		PARISH PLAQUEMINES		FEDERAL PROJECT	
NO. DATE		DESIGNED CHECKED DATE		STATE PROJECT 838-03-0023	
REVISION DESCRIPTION		BY SHEET		DATE 9/2008	

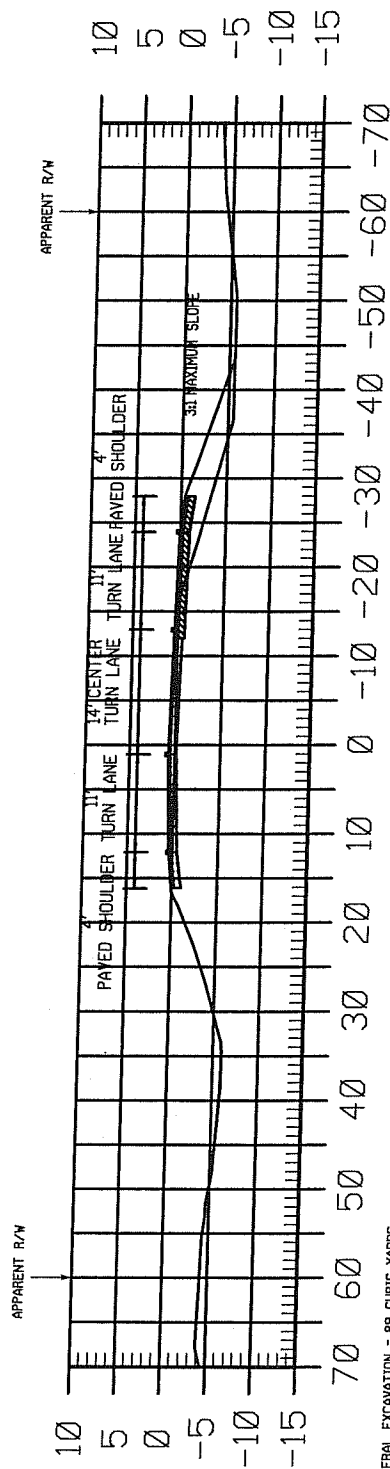

GENERAL EXCAVATION = 89 CUBIC YARDS
DRAINAGE EXCAVATION = 74 CUBIC YARDS
NON-PLASTIC EMBANKMENT = 345.1 CUBIC YARDS

136+00

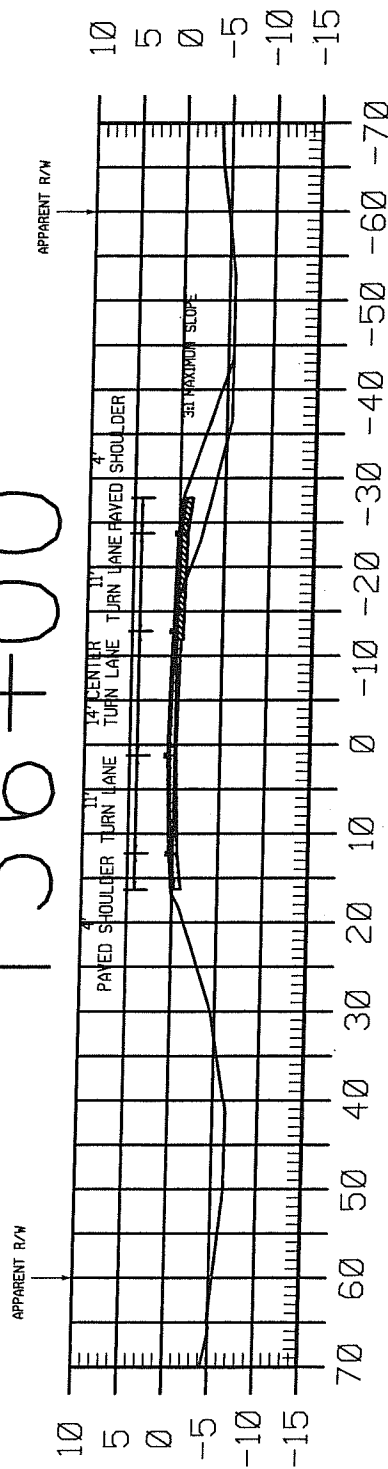


GENERAL EXCAVATION = 89 CUBIC YARDS
DRAINAGE EXCAVATION = 74 CUBIC YARDS
NON-PLASTIC EMBANKMENT = 377.2 CUBIC YARDS

137+00


NTS

DISTRICT 02 DESIGN		WOODLAND HWY. IMPROVEMENTS (LA 23 TO PLANTERS CANAL) - PHASE I		SHEET NO. 02	
CROSS SECTIONS		REVISION DESCRIPTION		PLAQUEMINES	
NO. DATE		BY SHEET		PARISH PLAQUEMINES	
DESIGNED		CHECKED		FEDERAL PROJECT	
DATE 9/2008		BY 61		STATE PROJECT 838-03-0023	

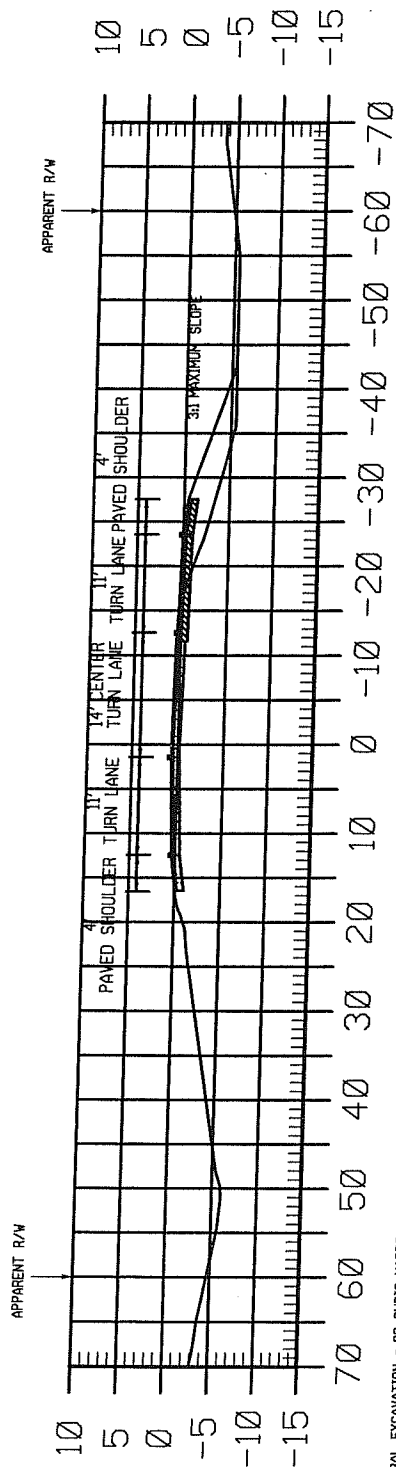

GENERAL EXCAVATION = 89 CUBIC YARDS
DRAINAGE EXCAVATION = 74 CUBIC YARDS
NON-PLASTIC EMBANKMENT = 355.2 CUBIC YARDS

138+00

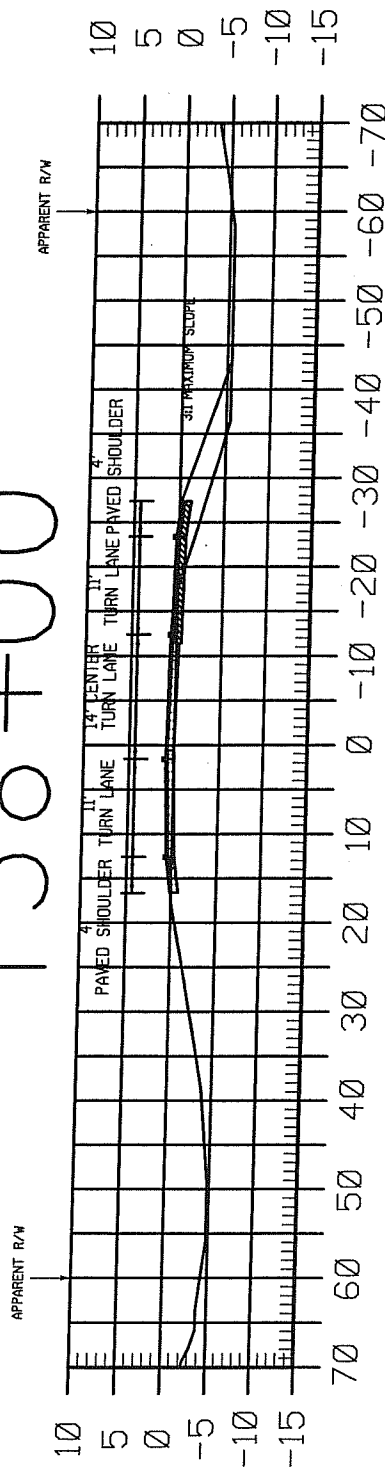


GENERAL EXCAVATION = 89 CUBIC YARDS
DRAINAGE EXCAVATION = 74 CUBIC YARDS
NON-PLASTIC EMBANKMENT = 355.2 CUBIC YARDS

139+00


NTS

		WOODLAND HWY. IMPROVEMENTS (LA 23 TO PLANTERS CANAL) - PHASE I				SHEET NO. 6m	
CROSS SECTIONS		NO. DATE		REVISION DESCRIPTION		PARISH PLAQUEMINES	
DESIGNED CMS CHECKED JRM		DETAILED CMS CHECKED JRM		DATE 9/2008 BY 6m		FEDERAL PROJECT STATE PROJECT 838-03-0023	

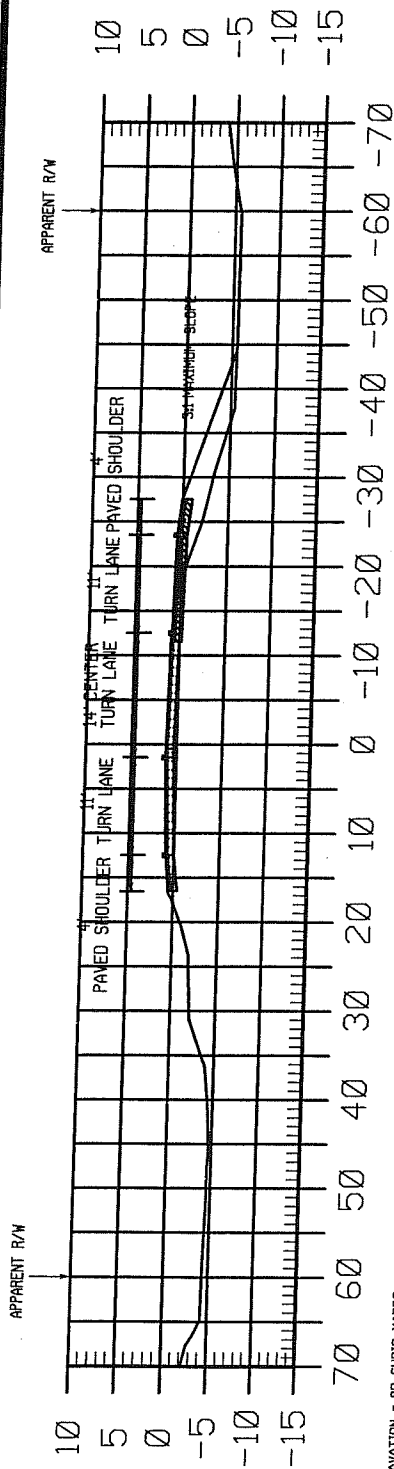

GENERAL EXCAVATION = 89 CUBIC YARDS
DRAINAGE EXCAVATION = 74 CUBIC YARDS
NON-PLASTIC EMBANKMENT = 354.8 CUBIC YARDS

1400+00

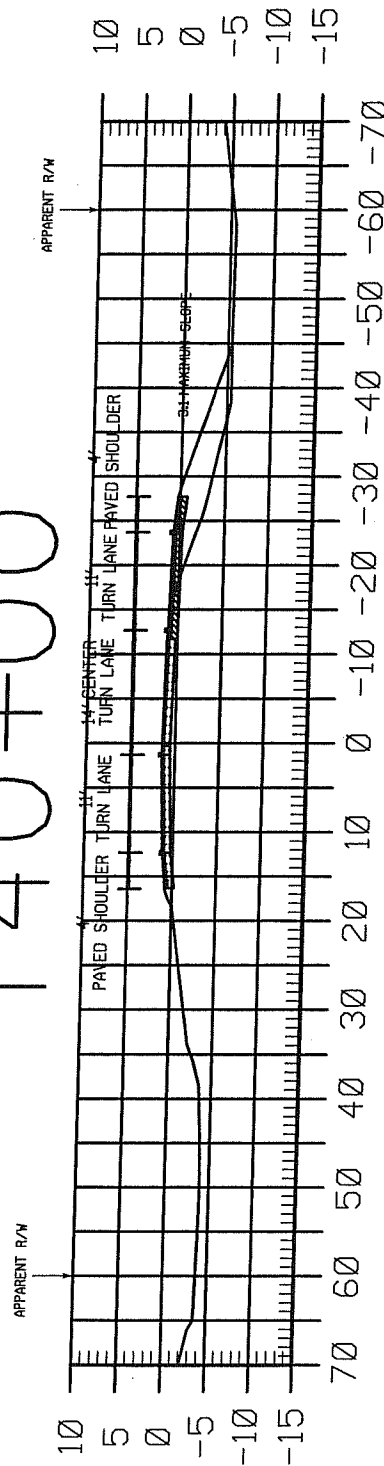


GENERAL EXCAVATION = 89 CUBIC YARDS
DRAINAGE EXCAVATION = 74 CUBIC YARDS
NON-PLASTIC EMBANKMENT = 396.5 CUBIC YARDS

141+00


NTS

		WOODLAND HWY. IMPROVEMENTS (LA 23 TO PLANTERS CANAL) - PHASE I		CROSS SECTIONS	
DISTRICT 02 DESIGN		NO. DATE REVISION DESCRIPTION		BY	
DESIGNED	CMS	PARISH	PLAQUEMINES	SHEET NO.	6
CHECKED	JRM	FEDERAL PROJECT		STATE PROJECT	638-03-0023
DATE	9/2008	DATE	9/2008	BY	

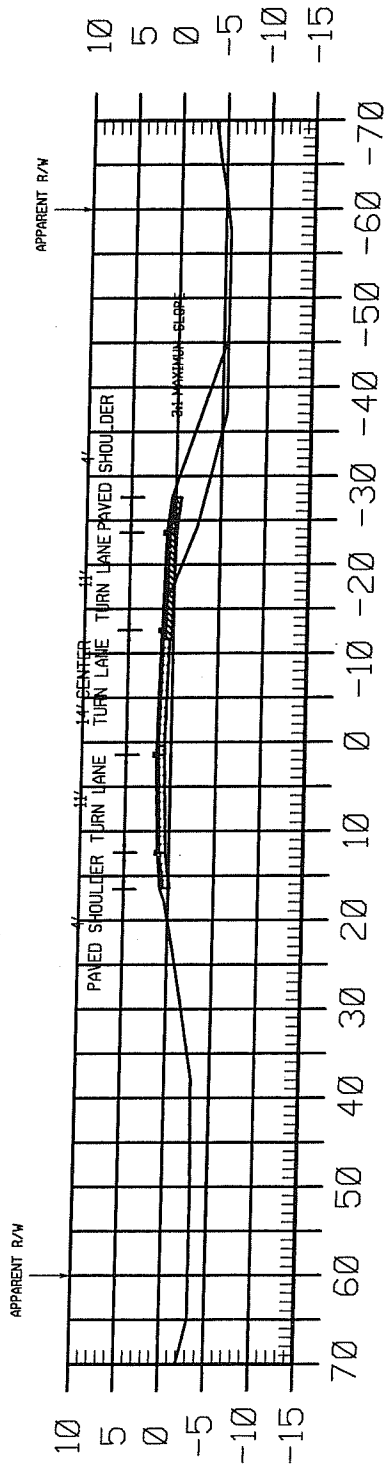

GENERAL EXCAVATION = 89 CUBIC YARDS
DRAINAGE EXCAVATION = 74 CUBIC YARDS
NON-PLASTIC EMBANKMENT = 442.0 CUBIC YARDS

142+00

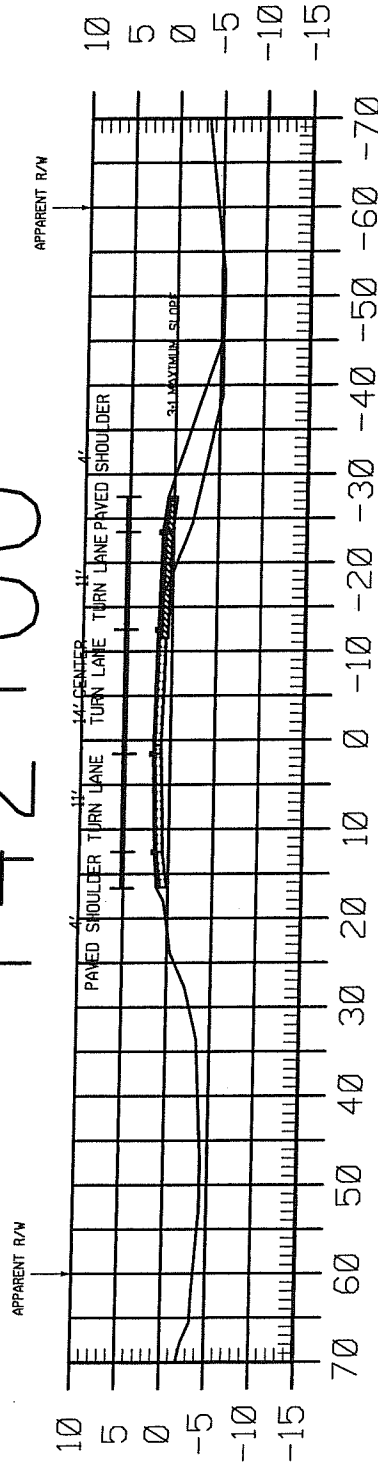


GENERAL EXCAVATION = 89 CUBIC YARDS
DRAINAGE EXCAVATION = 74 CUBIC YARDS
NON-PLASTIC EMBANKMENT = 422.1 CUBIC YARDS


143+00

NTS

DISTRICT 02 DESIGN		WOODLAND HWY. IMPROVEMENTS (LA 23 TO PLANTERS CANAL) - PHASE I				SHEET NO. 60 PROJECT 838-03-0023	
CROSS SECTIONS		REVISION DESCRIPTION		DATE 9/2008		BY SHEET 60	
NO. DATE		NO. DATE		DESIGNED CMB		PARISH	
				CHECKED JRM		PLAQUEMINES	
				DETAILED CMB		FEDERAL PROJECT	
				CHECKED JRM		STATE PROJECT	

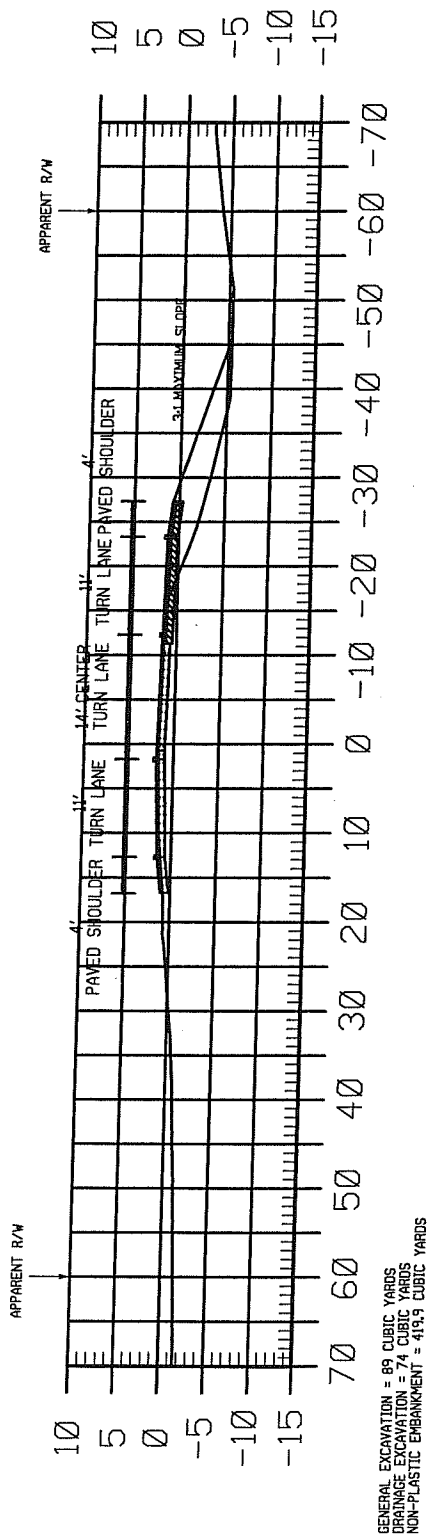


144+00

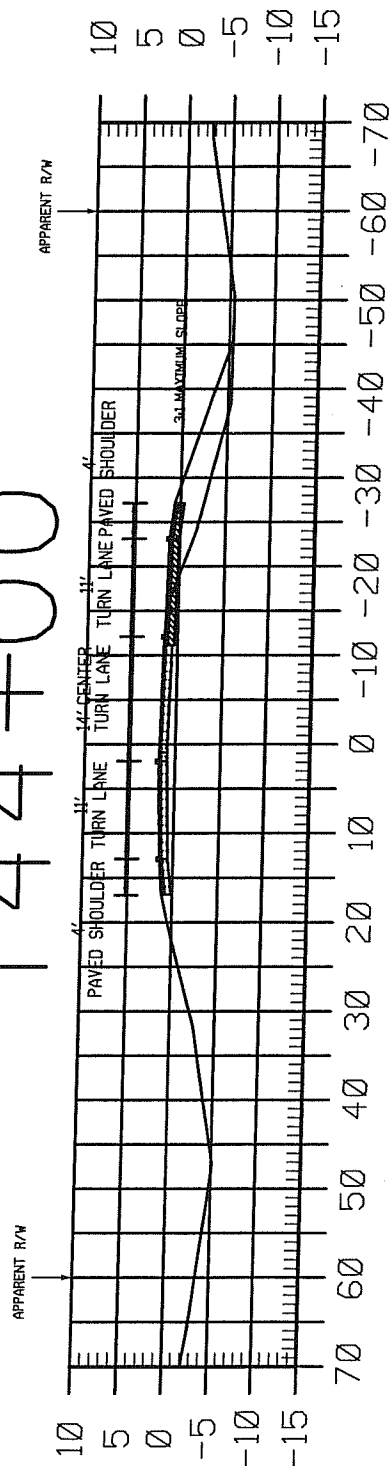

145+00


NTS

		WOODLAND HWY. IMPROVEMENTS (LA 23 TO PLANTERS CANAL) - PHASE I		CROSS SECTIONS	
NO. _____ DATE _____		REVISION DESCRIPTION _____		BY _____	
DESIGNED	CHECKED	DATE	BY	PARISH	PLAQUEMINES
9/2008	9/2008	9/2008	9/2008	FEDERAL PROJECT	STATE PROJECT
SHEET NO. 6p				PROJECT 838-03-0023	

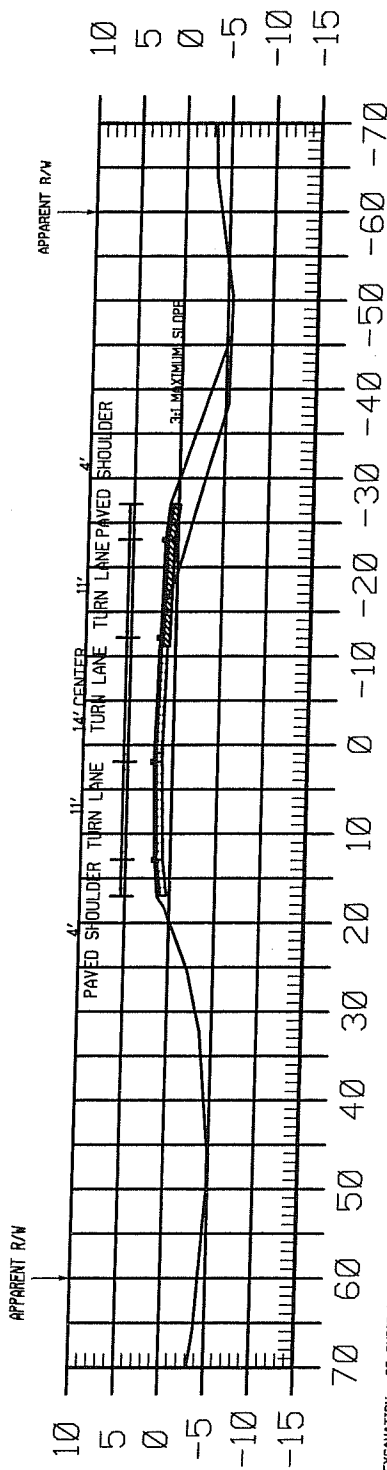

GENERAL EXCAVATION = 89 CUBIC YARDS
DRAINAGE EXCAVATION = 74 CUBIC YARDS
NON-PLASTIC EMBANKMENT = 413.2 CUBIC YARDS

146+00

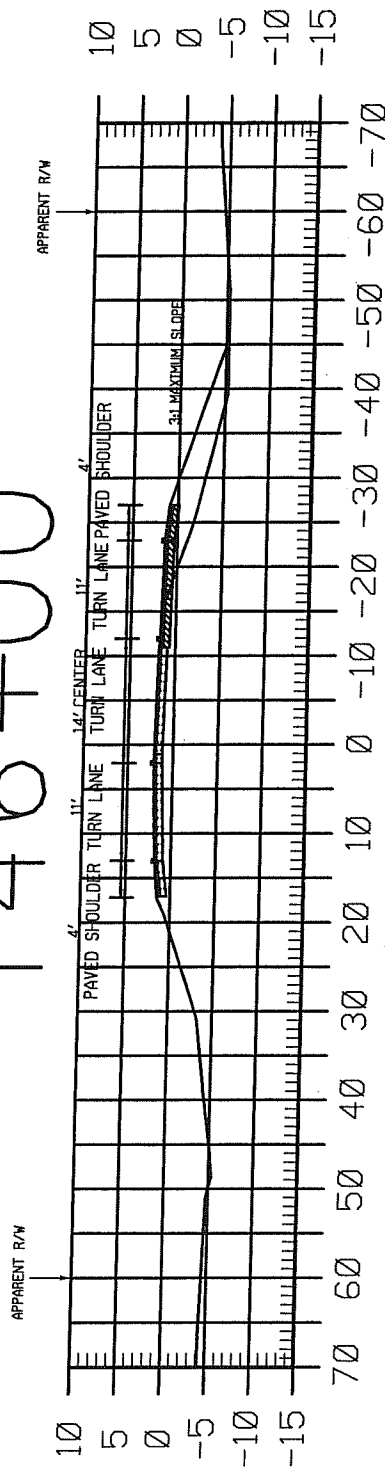

GENERAL EXCAVATION = 89 CUBIC YARDS
DRAINAGE EXCAVATION = 74 CUBIC YARDS
NON-PLASTIC EMBANKMENT = 405.8 CUBIC YARDS

147+00

NTS

WOODLAND HWY. IMPROVEMENTS
(LA 23 TO PLANTERS CANAL) - PHASE I


CROSS SECTIONS



DISTRICT 02
DESIGN


DESIGNED JRM	CAD JRM	PARISH PLAQUEMINES	SHEET NO.
CHECKED JRM	CHECKED JRM	FEDERAL PROJECT	69
DATE 9/2008	BY JRM	STATE PROJECT	838-03-0023

REVISION DESCRIPTION	NO.	DATE

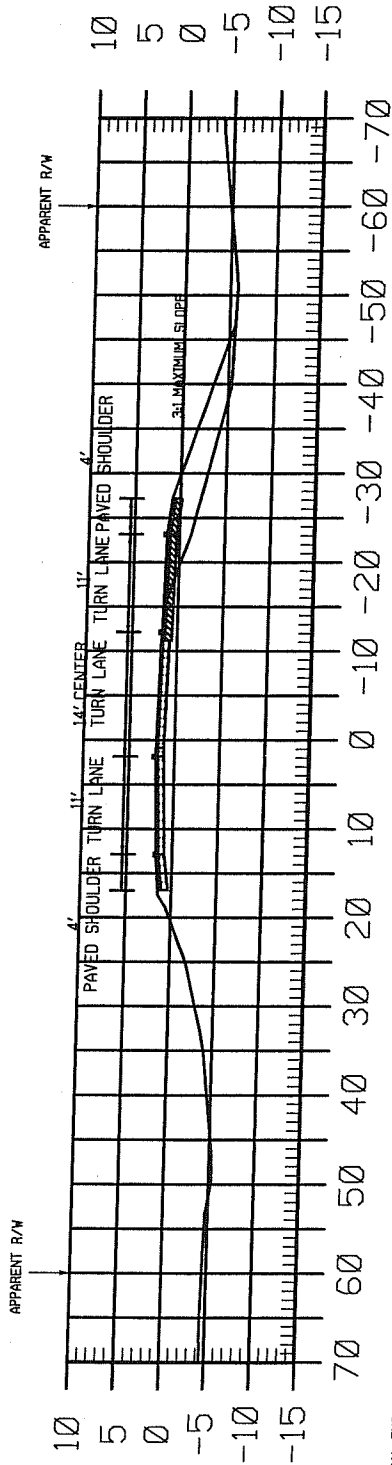

GENERAL EXCAVATION = 89 CUBIC YARDS
DRAINAGE EXCAVATION = 74 CUBIC YARDS
NON-PLASTIC EMBANKMENT = 411.9 CUBIC YARDS

148+00

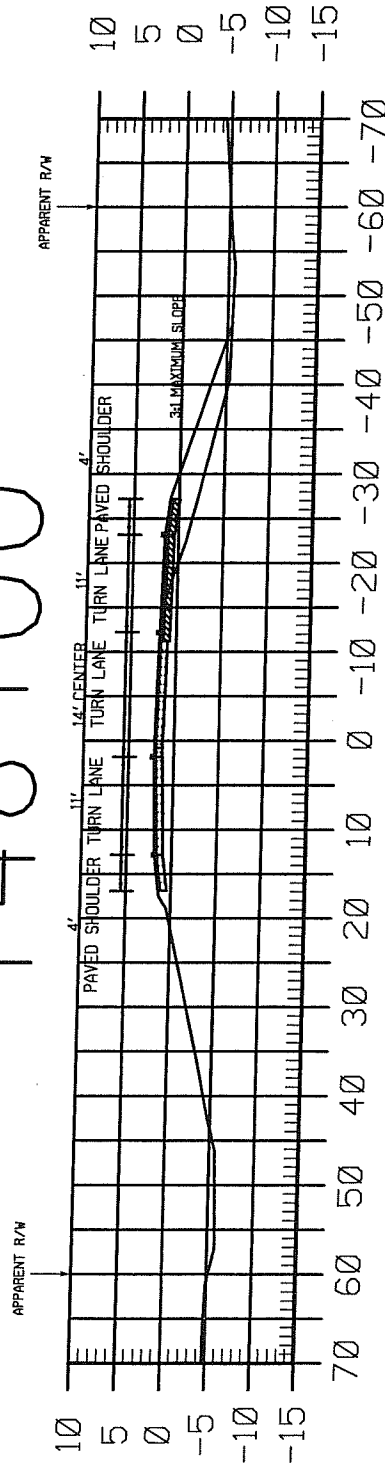


GENERAL EXCAVATION = 89 CUBIC YARDS
DRAINAGE EXCAVATION = 74 CUBIC YARDS
NON-PLASTIC EMBANKMENT = 424.9 CUBIC YARDS


149+00

NTS

DISTRICT DESIGN		WOODLAND HWY. IMPROVEMENTS (LA 23 TO PLANTERS CANAL) - PHASE I		SHEET NO. 6	
CROSS SECTIONS		REVISION DESCRIPTION		PLAQUEMINES	
NO. DATE		DATE 9/2008		PARISH PROJECT	
BY SHEET 6		STATE PROJECT		838-03-0023	

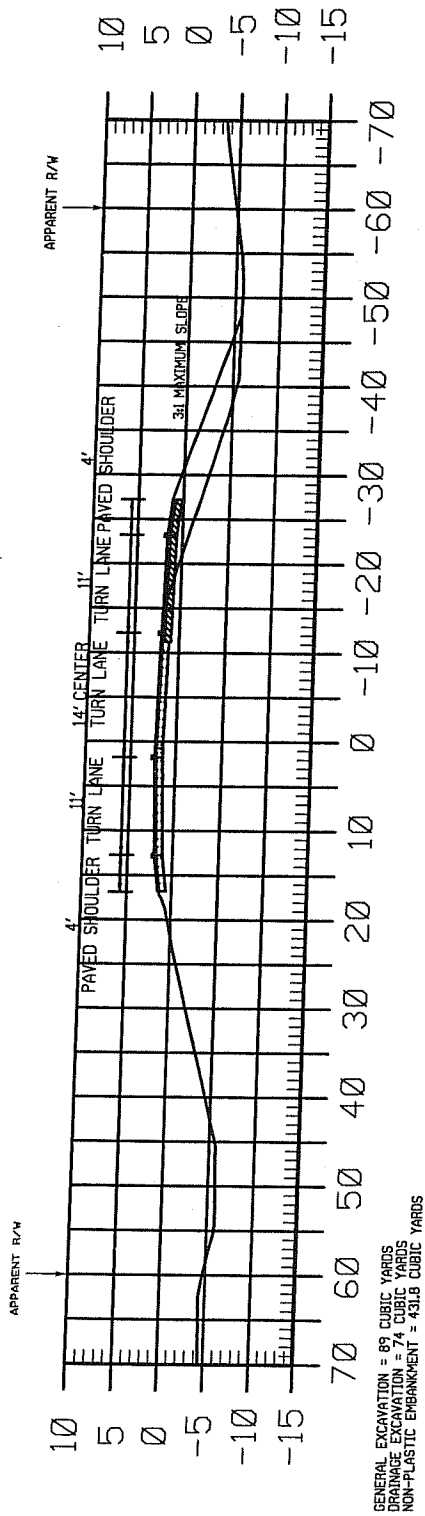


150+00

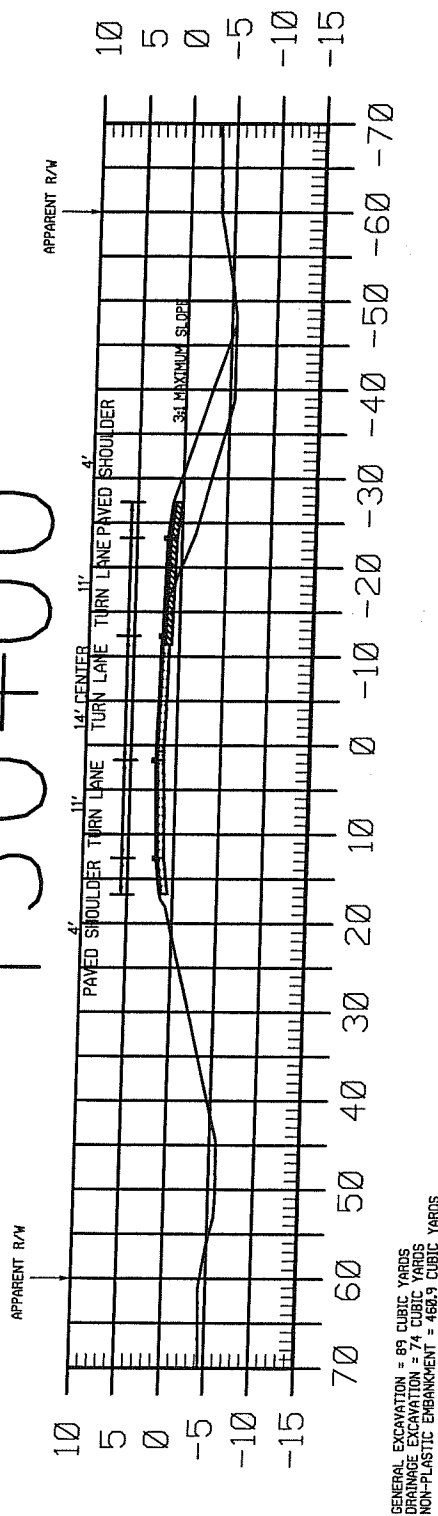

151+00


NTS

DISTRICT DESIGN		CROSS SECTIONS		WOODLAND HWY. IMPROVEMENTS (LA 23 TO PLANTERS CANAL) - PHASE I		SHEET NO. 68	
NO. DATE		REVISION DESCRIPTION		BY SHEET		DESIGNED CHECKED	
DATE		DATE		DATE		DATE	
PARISH		FEDERAL PROJECT		STATE PROJECT		PROJECT	
PLAQUEMINES		838-03-0023		838-03-0023		838-03-0023	

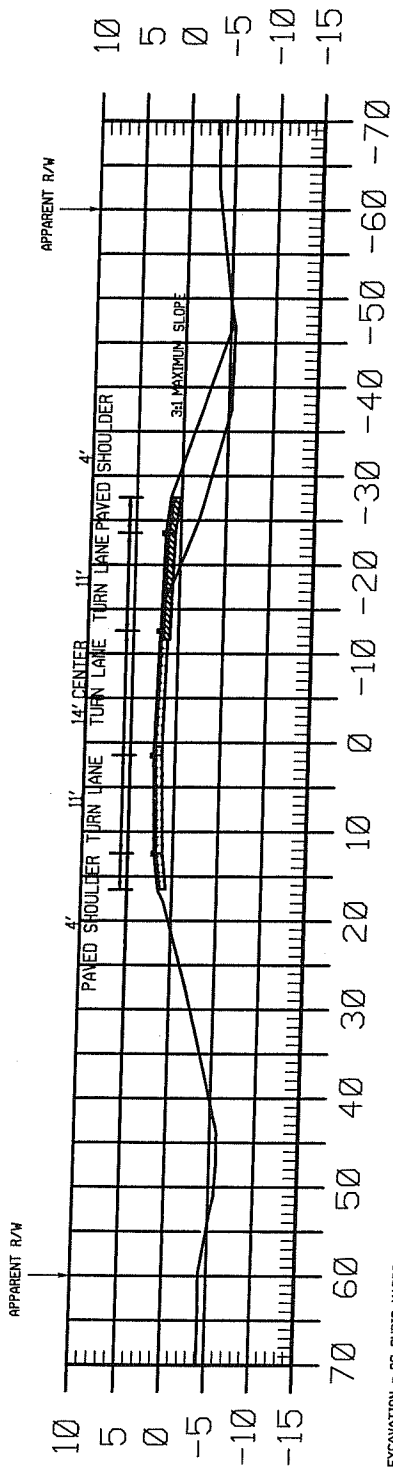

GENERAL EXCAVATION = 89 CUBIC YARDS
 DRAINAGE EXCAVATION = 74 CUBIC YARDS
 NON-PLASTIC EMBANKMENT = 485.1 CUBIC YARDS

152+00

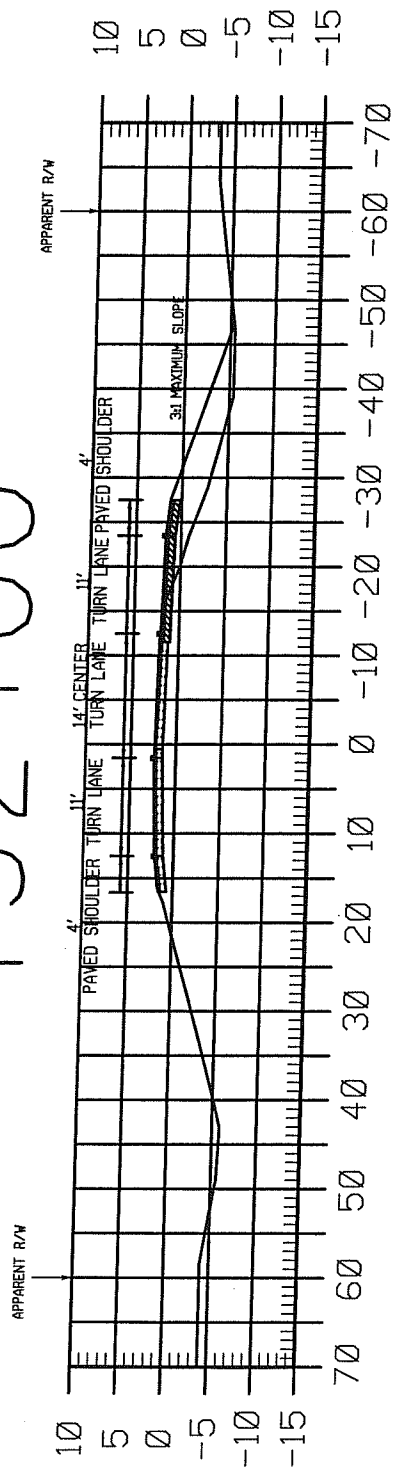


GENERAL EXCAVATION = 89 CUBIC YARDS
 DRAINAGE EXCAVATION = 74 CUBIC YARDS
 NON-PLASTIC EMBANKMENT = 485.8 CUBIC YARDS

153+00

NTS

		WOODLAND HWY. IMPROVEMENTS (LA 23 TO PLANTERS CANAL) - PHASE I		DISTRICT DESIGN 02	
CROSS SECTIONS		NO. DATE		REVISION DESCRIPTION	
DESIGNED	CMS	PARISH	PLAQUEMINES	SHEET NO. 61	
CHECKED	JRM	FEDERAL PROJECT		STATE PROJECT 838-03-0023	
DATE	9/2008	BY		SHEET 61	


APPARENT R/W

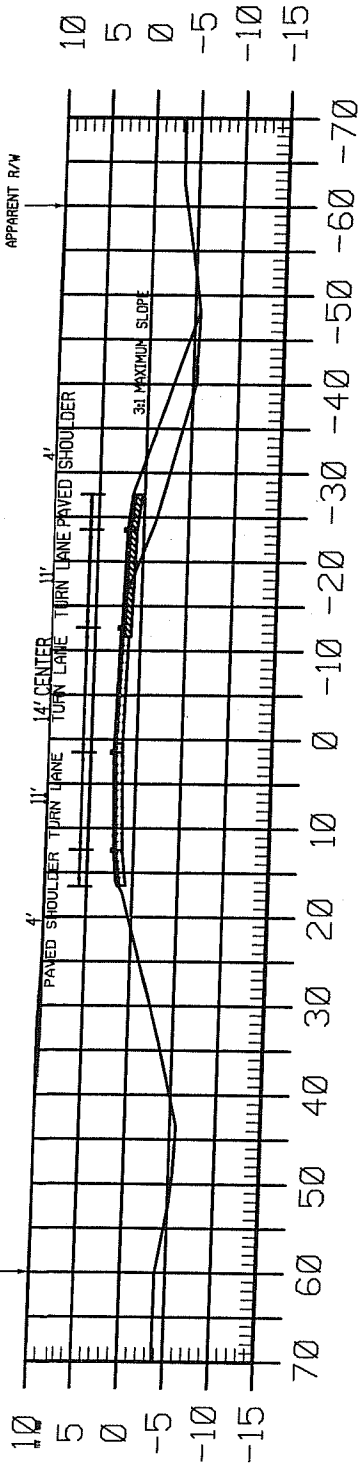

GENERAL EXCAVATION = 89 CUBIC YARDS
DRAINAGE EXCAVATION = 74 CUBIC YARDS
NON-PLASTIC EMBANKMENT = 477.8 CUBIC YARDS


154+00

APPARENT R/W

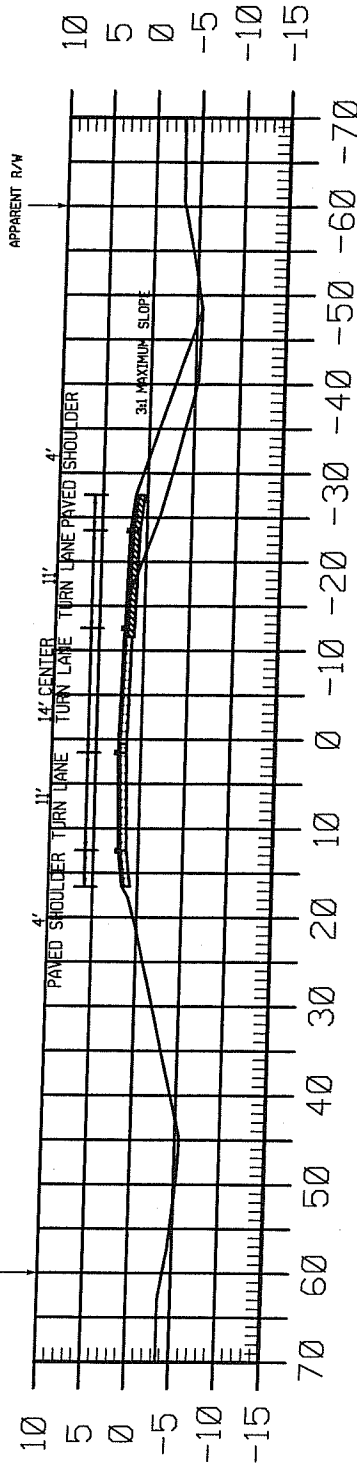

GENERAL EXCAVATION = 89 CUBIC YARDS
DRAINAGE EXCAVATION = 74 CUBIC YARDS
NON-PLASTIC EMBANKMENT = 451.8 CUBIC YARDS

155+00




WOODLAND HWY. IMPROVEMENTS
(LA 23 TO PLANTERS CANAL) - PHASE I



CROSS SECTIONS


NTS

DESIGNED CHECKED JRM	PARISH	PLAQUEMINES	SHEET NO.
DATE 9/2008	FEDERAL PROJECT	STATE PROJECT	62
BY JRM	REVISION DESCRIPTION	PROJECT	838-03-0023

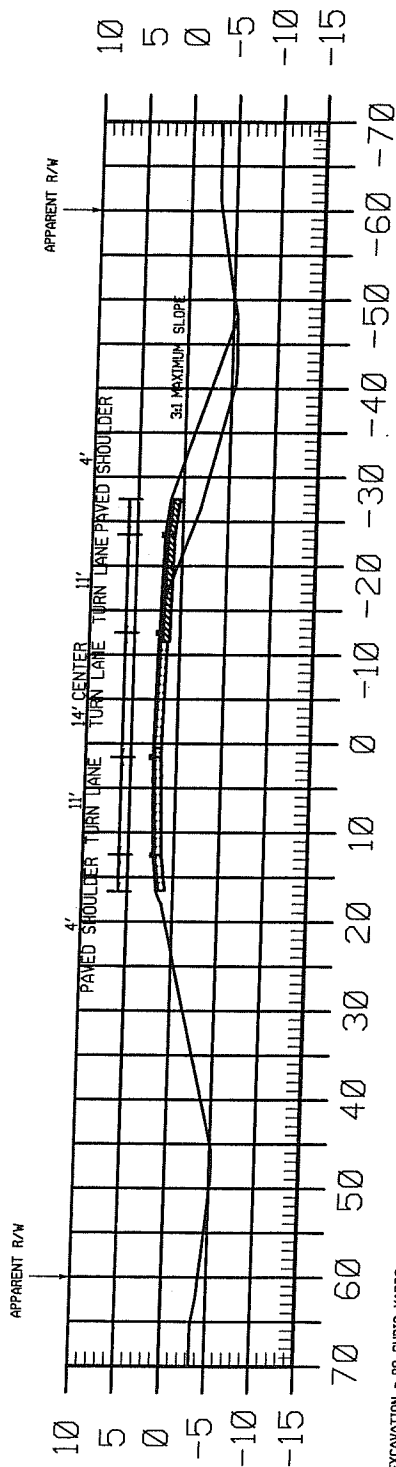


GENERAL EXCAVATION = 89 CUBIC YARDS
DRAINAGE EXCAVATION = 74 CUBIC YARDS
NON-PLASTIC EMBANKMENT = 465.8 CUBIC YARDS

156+00

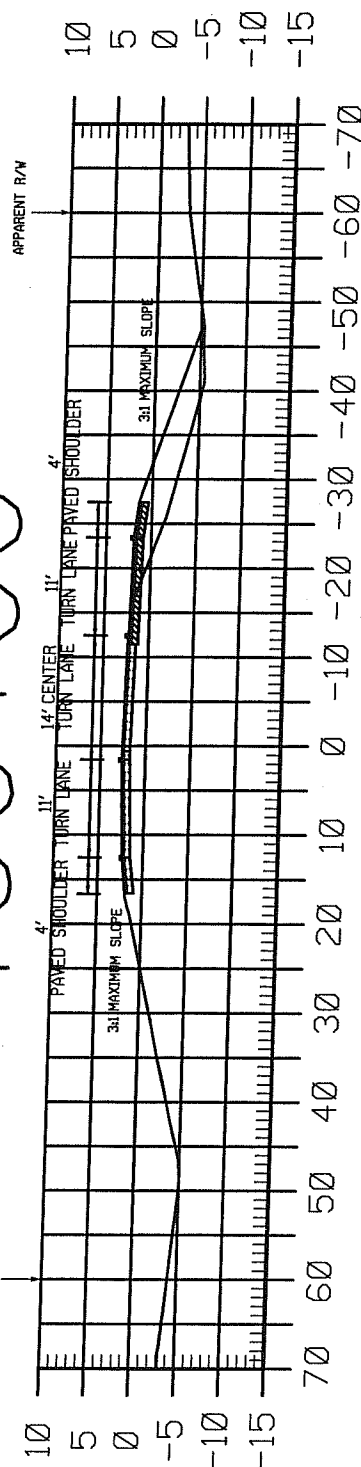

GENERAL EXCAVATION = 89 CUBIC YARDS
DRAINAGE EXCAVATION = 74 CUBIC YARDS
NON-PLASTIC EMBANKMENT = 454.0 CUBIC YARDS

157+00



WOODLAND HWY. IMPROVEMENTS
(LA 23 TO PLANTERS CANAL) - PHASE I



CROSS SECTIONS

DESIGNED	CMS	PARISH	PLAQUEMINES
CHECKED	JRM	FEDERAL PROJECT	
DATE	9/2008	STATE PROJECT	638-03-0023
BY	6v		

NTS


NO. DATE REVISION DESCRIPTION

DATE 9/2008

STATE PROJECT


638-03-0023

SHEET NO. 2v

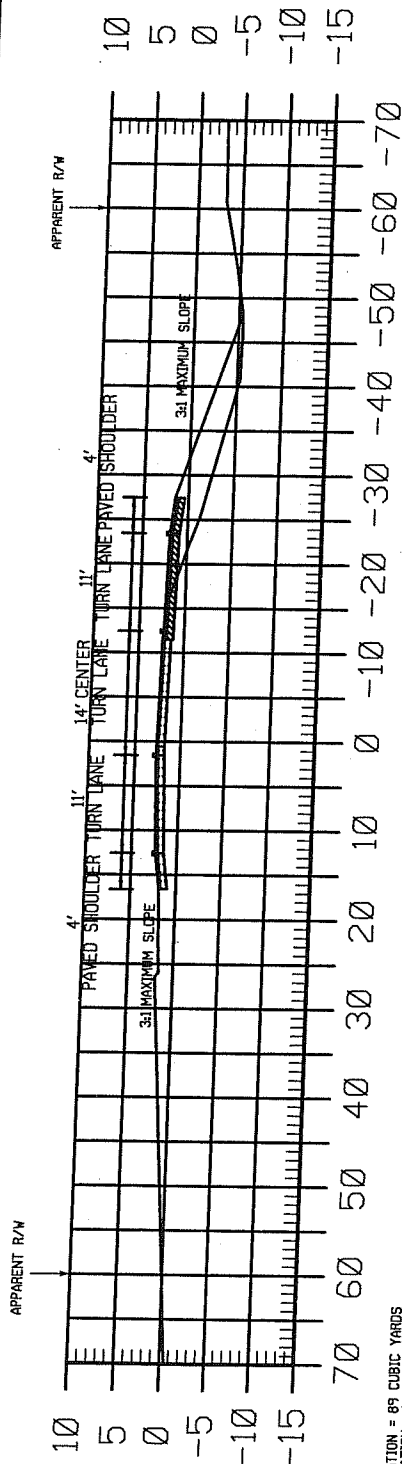


GENERAL EXCAVATION = 89 CUBIC YARDS
DRAINAGE EXCAVATION = 74 CUBIC YARDS
NON-PLASTIC EMBANKMENT = 459.1 CUBIC YARDS

158+00

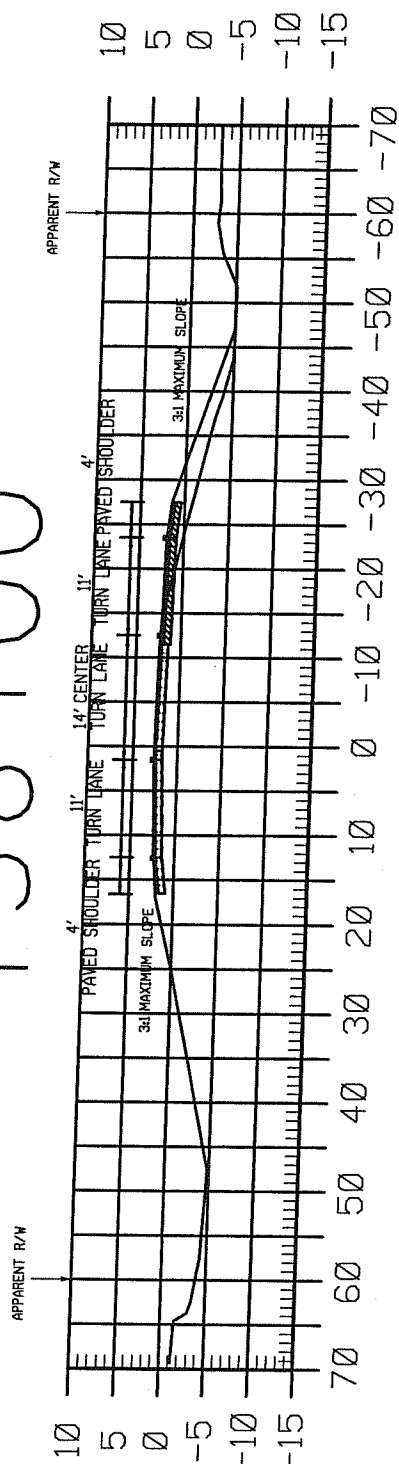

GENERAL EXCAVATION = 89 CUBIC YARDS
DRAINAGE EXCAVATION = 74 CUBIC YARDS
NON-PLASTIC EMBANKMENT = 624.8 CUBIC YARDS

159+00



WOODLAND HWY. IMPROVEMENTS
(LA 23 TO PLANTERS CANAL) - PHASE I




NTS

SHEET NO.		PROJECT	
6w		838-03-0023	
DESIGNED		PARISH	
CMG JRM		PLAQUEMINES	
CHECKED		FEDERAL PROJECT	
CMG JRM			
DATE		BY	
9/20/08			
REVISION DESCRIPTION		SHEET	
		6w	

SUMMARY OF EXCAVATION AND EMBANKMENT			
STATION #	GENERAL EXCAVATION (CUBIC YARD)	DRAINAGE EXCAVATION (CUBIC YARD)	NON-PLASTIC EMBANKMENT (CUBIC YARD)
112+00	89	74	427.3
113+00	89	74	400.5
114+00	89	74	429.3
115+00	89	74	384.9
116+00	89	74	411.1
117+00	89	74	454.4
118+00	89	74	404.2
119+00	89	74	386.7
120+00	89	74	369.9
121+00	89	74	339.2
122+00	89	74	341.5
123+00	89	74	115.7
124+00	89	74	344.3
125+00	89	74	297.5
126+00	89	74	337.2
127+00	89	74	353.5
128+00	89	74	389.1
129+00	89	74	414
130+00	89	74	439.6
131+00	89	74	393.2
132+00	89	74	360.6
133+00	89	74	343.6
134+00	89	74	308.6
135+00	89	74	343.2
136+00	89	74	349.1
137+00	89	74	377.2
138+00	89	74	355.2
139+00	89	74	339.9
140+00	89	74	354.8
141+00	89	74	398.5
142+00	89	74	442
143+00	89	74	422.1
144+00	89	74	419.9
145+00	89	74	410
146+00	89	74	413.2
147+00	89	74	409
148+00	89	74	411.9
149+00	89	74	404
150+00	89	74	431.8
151+00	89	74	460.9
152+00	89	74	489.1
153+00	89	74	465.8
154+00	89	74	447.6
155+00	89	74	451.8
156+00	89	74	465.6
157+00	89	74	459
158+00	89	74	450.1
159+00	89	74	624.8
***	445	373	957.6
TOTAL	4717	3925	20000

*** ADDITIONAL QUANTITY TO BE USED AS DIRECTED BY PROJECT ENGINEER


SHEET NO. 6x		PLAQUEMINES	
PARISH		FEDERAL PROJECT	
STATE PROJECT		838-03-0023	
DESIGNED	CAS	CHECKED	CAS
DATE	9/2008	DATE	9/2008
BY	SHEET	BY	SHEET
REVISION DESCRIPTION			
NO. DATE			
			
WOODLAND HWY. IMPROVEMENTS (LA 23 TO PLANTERS CANAL) - PHASE I			
SUMMARY OF EXCAVATION AND EMBANKMENT			
			
DISTRICT 02 DESIGN			

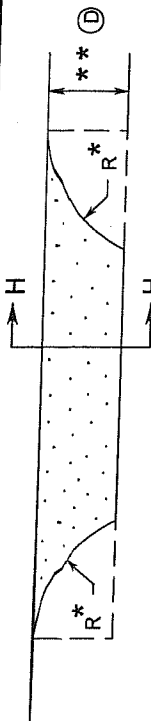


DRIVEWAY OR TURNOUT DETAIL (ITEM 502-01-A).

DETAIL OF APRON AT TURNOUT (TYPICAL)


- * MATCH EXISTING RADIUS
- ** TO BE DETERMINED IN FIELD BY PROJECT ENGINEER.

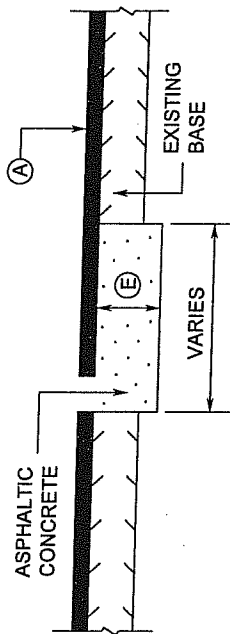

PATCHING DETAIL

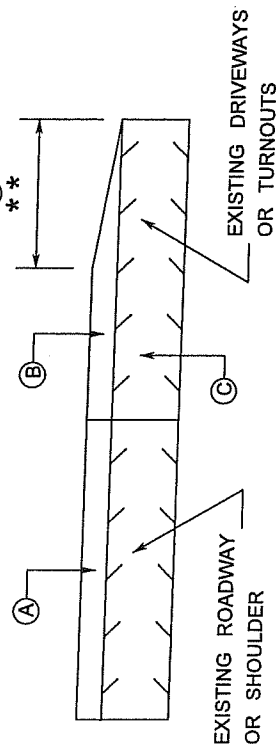

SECTION H-H





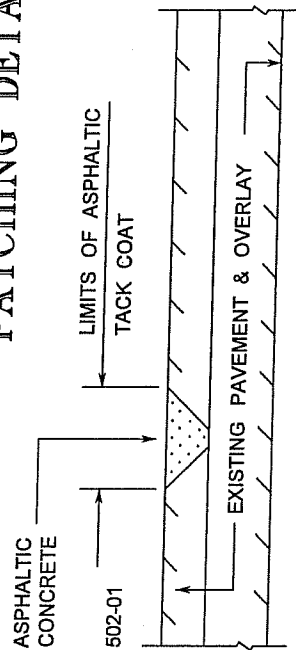


JOINT REPAIR DETAIL

- Ⓐ ASPHALTIC CONCRETE (COURSES AND TYPES AS SHOWN ON TYPICAL SECTION).
- Ⓑ ASPHALTIC CONCRETE, PAY AS 502-01, CONTRACTORS OPTIONS ARE:
1. MATCH ROADWAY TYPICAL SECTION.
- Ⓒ EXISTING PAVED DRIVEWAY OR TURNOUT TO REMAIN UNLESS EXISTING MATERIAL IS AGGREGATE. REPLACE AGGREGATE DRIVEWAY WITH 3.0" ASPHALTIC CONCRETE. TOTAL MINIMUM THICKNESS OF NEW PAVED DRIVEWAY OR TURNOUT INCLUDING OVERLAY MATERIAL IS 3.0".
- Ⓓ AS DETERMINED BY THE PROJECT ENGINEER.
- Ⓔ 12" MIN. (PATCHING SHALL EXTEND TO BOTTOM OF EXISTING BASE) (ROADWAY).
6" MIN. (PATCHING SHALL EXTEND TO BOTTOM OF EXISTING BASE) (SHOULDER).

NOTE: USE DETAILS APPLICABLE TO THIS PROJECT



				WOODLAND HWY. IMPROVEMENTS (LA 23 TO PLANTERS CANAL) - PHASE I		DRIVEWAYS AND TURNOUTS		SHEET NO. 7	
DISTRICT 82 DESIGN		NO. DATE		REVISION DESCRIPTION		BY SHEET		638-03-0023	
DESIGNED CHECKED JRM		PARISH FEDERAL PROJECT		PLAQUEMINES		DATE 9/2008		STATE PROJECT	

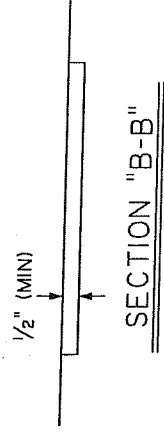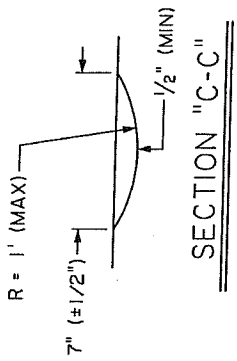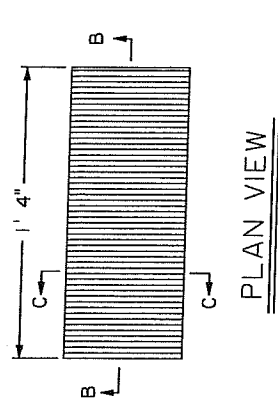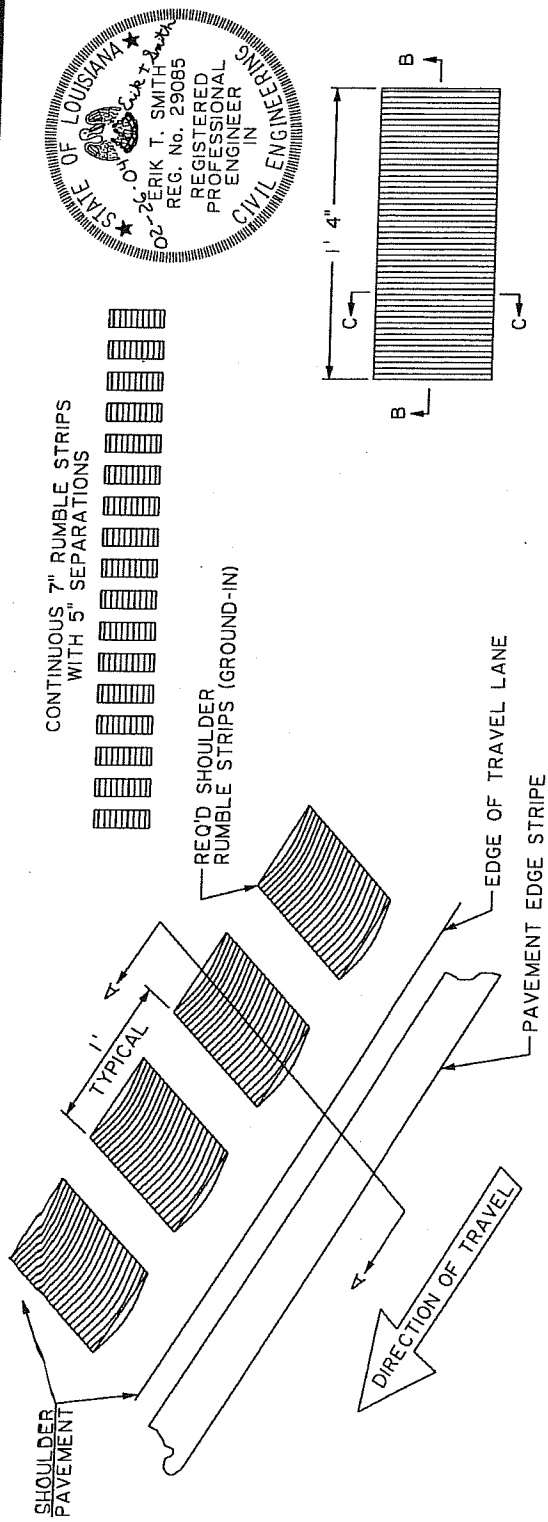

- NOTES:
1. SHOULDER RUMBLE STRIPS (GROUND-IN) SHALL BE GROUND INTO THE HMA SHOULDER IN A MANNER APPROVED BY THE PROJECT ENGINEER.
 2. SEE SUMMARY OF ESTIMATED QUANTITIES FOR PAY ITEM.
 3. SEE TYPICAL SECTIONS AND DETAILS FOR INFORMATION ON PAVEMENT AND SHOULDER.
 4. DETAIL NOT TO SCALE.


DETAIL FOR
SHOULDER
RUMBLE STRIPS
(GROUND-IN)
(SHEET 1 of 2)

DISTRICT 2 DESIGN		WOODLAND HWY. IMPROVEMENTS (LA 23 TO PLANTERS CANAL) - PHASE 1		SHEET NO. 70	
RUMBLE STRIPS DETAIL SHEET		REVISION DESCRIPTION		PROJECT 838-03-0023	
DESIGNED CHECKED DATE	DESIGNED CHECKED DATE	PARISH FEDERAL PROJECT	PLAQUEMINES	BY	DATE
					9/2008
					70

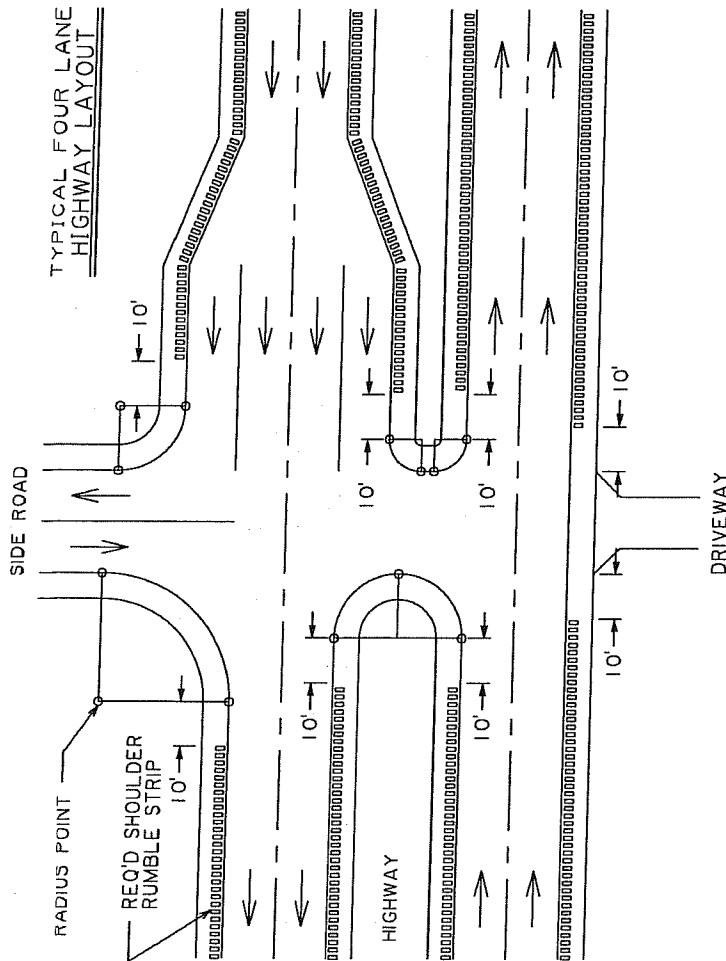


- NOTES:
1. SHOULDER RUMBLE STRIPS SHALL BE INSTALLED IN A MANNER APPROVED BY THE PROJECT ENGINEER.
 2. SHOULDER RUMBLE STRIPS SHALL REMAIN PERPENDICULAR TO EDGE OF TRAVEL LANE AT ALL TIMES.
 3. LOCATION AND LAYOUT OF SHOULDER RUMBLE STRIPS MAY BE ADJUSTED BY THE PROJECT ENGINEER.
 4. DETAIL NOT TO SCALE.

TYPICAL INTERSTATE LAYOUT

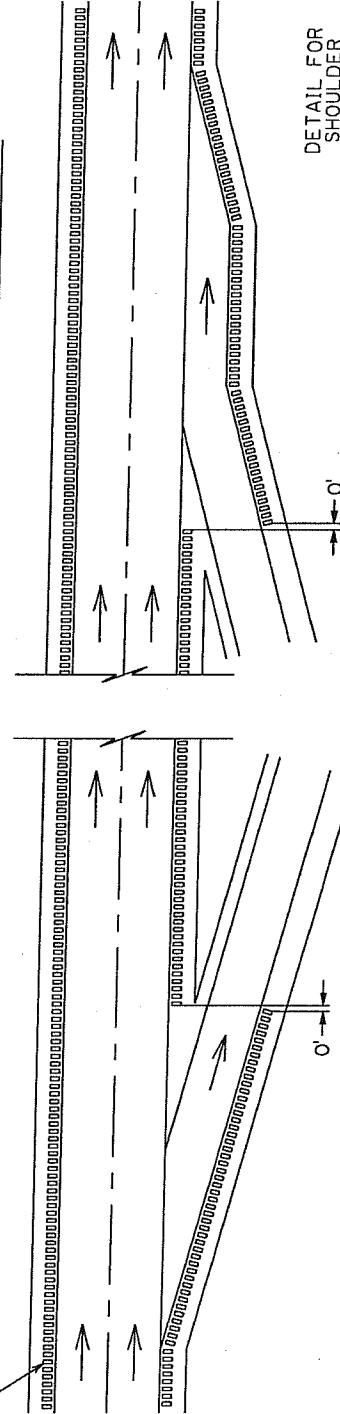

DETAIL FOR SHOULDER RUMBLE STRIPS (LAYOUT)
(SHEET 2 of 2)


		WOODLAND HWY. IMPROVEMENTS (LA 23 TO PLANTERS CANAL) - PHASE I		RUMBLE STRIPS DETAIL SHEETS		DISTRICT 8 DESIGN	
NO. DATE		REVISION DESCRIPTION		BY		DATE	
DESIGNED CHECKED DATE		CHECKED DATE		CHECKED DATE		CHECKED DATE	
PARISH		FEDERAL PROJECT		STATE PROJECT		PROJECT	
SHEET NO.		PLAQUEMINES		838-03-0023		7B	



- NOTES:
1. REQUIRED EMBANKMENT WIDENING SHALL HAVE AN ASPHALTIC CONCRETE OVERLAY 4 INCHES THICK AND EMBANKMENT SHALL PROVIDE SLOPES NO STEEPER THAN 10:1.
 2. GUARD RAIL ON NORTHBOUND APPROACH LEFT SIDE IS A DESIGN EXCEPTION. INSTALL END TREATMENT WITH MANUFACTURERS REQUIRED END FLARE.
 3. FOR INSTALLATION OF ITEM 704-07-A TO BRIDGE SEE "NEW JERSEY BARRIER RAIL RETROFIT" DETAIL IN THE BACK OF THESE PLANS.
 4. FOR ADDITIONAL GUARD RAIL INFORMATION SEE STANDARD PLAN GR-200.

GUARDRAIL DESIGN CRITERIA														
ROUTE		HWY. CLASS		DESIGN SPEED		ADT		LC		LR		A:B		
LA-406		URBAN ARTERIAL		55		9300		22		360		12:1		
GUARDRAIL LAYOUT REQUIREMENTS (ft), AND QUANTITIES														
STRUC. No.		SIDE		L2	X	Y	Z	202-02-H	502-01-A	704-03	704-07-A	704-08-B	704-11-A	729-16-C
8380303111		N.B. APPROACH RT.		8	68.75	9.9	19.9	103	28.0	18.75	12.5	25.00	1	1
8380303111		N.B. APPROACH LT.		20	n/a	n/a	n/a	66	22.0	0.00	12.5	18.75	1	1
8380303111		S.B. APPROACH RT		8	68.75	9.9	19.9	103	28.0	18.75	12.5	25.00	1	1
8380303111		S.B. APPROACH LT.		20	62.5	11	21	78	22.0	12.50	12.5	25.00	1	1
						TOTALS		350	100.0	50.0	50.0	93.8	4	4

[illegible]

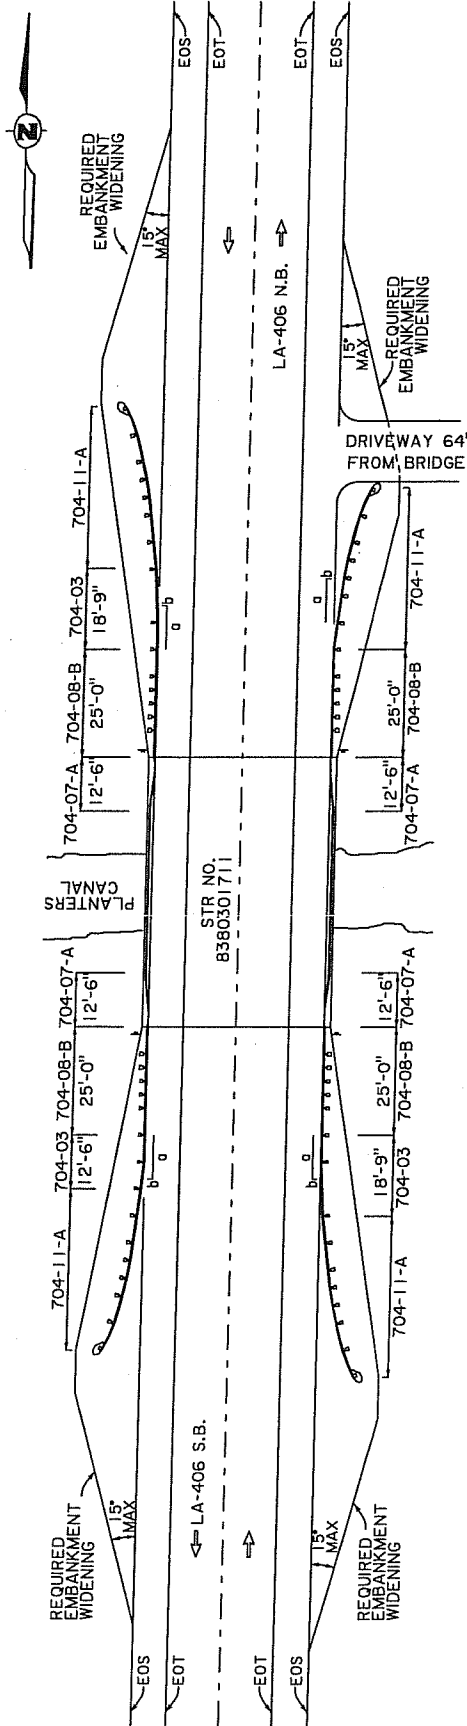


NOTES:

1. REQUIRED EMBANKMENT WIDENING SHALL HAVE AN ASPHALTIC CONCRETE OVERLAY 4 INCHES THICK AND EMBANKMENT SHALL PROVIDE SLOPES NO STEEPER THAN 10:1.
2. GUARD RAIL ON SOUTHBOUND APPROACH LEFT SIDE IS A DESIGN EXCEPTION. INSTALL END TREATMENT WITH MANUFACTURERS REQUIRED END FLARE.
3. FOR INSTALLATION OF ITEM 704-07-A TO BRIDGE SEE "NEW JERSEY BARRIER RAIL RETROFIT" DETAIL IN THE BACK OF THESE PLANS.
4. FOR ADDITIONAL GUARD RAIL INFORMATION SEE STANDARD PLAN GR-200.

GUARDRAIL DESIGN CRITERIA												
ROUTE	HWY. CLASS	DESIGN SPEED		ADT		LC		LR		A:B		
LA-406	URBAN ARTERIAL	55		9300		22		360		12:1		
GUARDRAIL LAYOUT REQUIREMENTS (ft), AND QUANTITIES												
STRUC. No.	SIDE	L2	X	Y	Z	202-02+1502-01-A	704-03	704-07-A	704-08-B	704-11-A	729-16-C	
838030171	N.B. APPROACH RT.	8	68.75	9.9	19.9	103	22.0	18.75	12.5	25.00	1	
838030171	N.B. APPROACH LT.	20	62.5	11.0	21.0	78	22.0	12.5	12.5	25.00	1	
838030171	S.B. APPROACH RT	8	n/a	n/a	n/a	103	22.0	0.00	12.5	25.00	1	
838030171	S.B. APPROACH LT.	20	62.5	11.0	21.0	78	22.0	12.50	12.5	25.00	1	
				TOTALS		362	88.0	43.8	50.0	100.0	4	
											4	

		WOODLAND HWY. IMPROVEMENTS (LA 23 TO PLANTERS CANAL) PHASE I				NO. DATE _____		REVISION DESCRIPTION _____		BY SHEET _____		DATE 09/2008 7d		STATE PROJECT 838-03-0023		PARISH PLAQUEMINES FEDERAL PROJECT		SHEET NO. 7d	
--	--	---	--	--	--	-------------------	--	-------------------------------	--	-------------------	--	--------------------	--	------------------------------	--	---------------------------------------	--	--------------	--

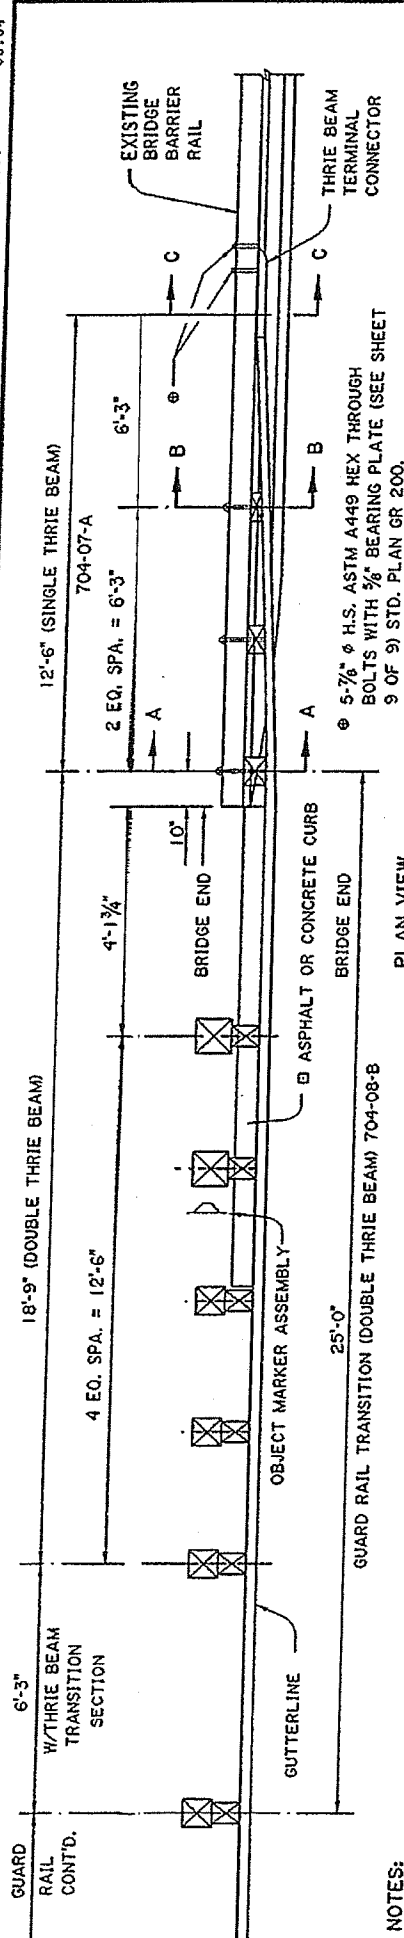


NOTES:

FOR ADDITIONAL INFORMATION ON GUARD RAIL, SEE STD. PLAN GR-200, SHEET 3 OF 10
W6 X 9 STEEL POST WITH TIMBER BLOCKS MAY BE SUBSTITUTED. NO MIXING WILL BE ALLOWED.
FOR CURB & TRANSITION INFORMATION, SEE SHEET 3 OF 10, GR-200.
ALL HARDWARE AND TIMBER USED FOR CONNECTING THE SINGLE THRIE BEAM TO THE EXISTING BRIDGE RAIL SHALL BE PAID FOR UNDER ITEM 704-07-A, GUARD RAIL BRIDGE ATTACHMENTS (SINGLE THRIE BEAM), PER LIN. FT.
ANY DAMAGE DONE TO THE EXISTING STRUCTURE DURING INSTALLATION OF THE GUARD RAIL SHALL BE REPAIRED AT THE CONTRACTORS EXPENSE AND TO THE SATISFACTION OF THE PROJECT ENGINEER.
GALV. STEEL OGEE WASHER MAY BE USED IN LIEU OF THE STEEL BEARING PLATE.
ALL H.S. BOLTS SHALL BE ASTM A449. ALL 5/8" ϕ BOLTS SHALL BE ASTM A307.

PLAN VIEW

- ϕ 2 - 5/8" ϕ BUTTON HEAD BOLTS WITH 5/8" BEARING PLATE, NUTS, & WASHERS
- ϕ 6" X 8" X 1'-10 1/2" TREATED TIMBER BLOCK (CUT & SHAPE IN THE FIELD TO FIT).

NOTE: THE GUARD RAIL SHALL NOT PROTRUDE BEYOND THE GUTTERLINE.

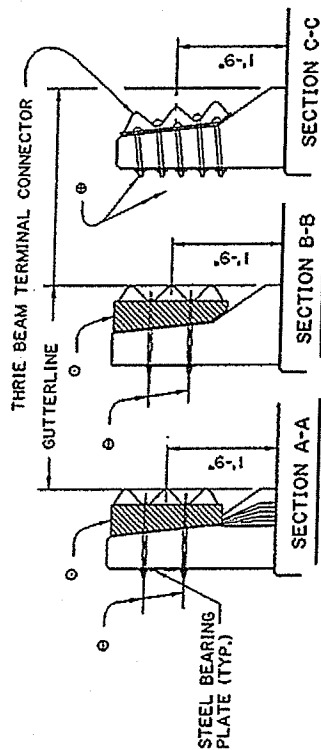


PROCEDURE FOR INSTALLING GUARD RAIL

- A 25'-0" SECTION OF GUARD RAIL (WITH NO SPLICE) SHALL BE INSTALLED SYMMETRICALLY WITH RESPECT TO THE FIRST POST ON EACH END OF THE STRUCTURE.
- THE BOLT HOLES SHALL BE FIELD DRILLED THRU THE GUARD RAIL, SHIM BLOCKS AND THE BARRIER RAIL AT THE SAME TIME.




Paul B. Fossier, Jr.
PAUL B. FOSSIER, JR.
REG. NO. 21028
MECHANICAL ENGINEERING
STATE OF LOUISIANA

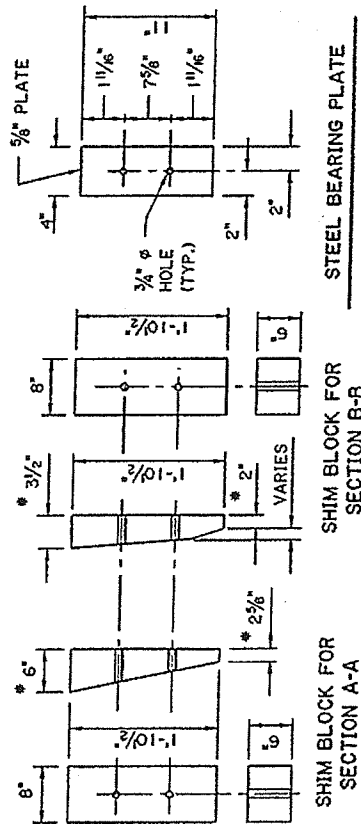

* DIMENSIONS ARE ASSUMED. ADJUST IN THE FIELD AS REQUIRED.
HOLES SHALL BE DRILLED IN THE FIELD. SEE NOTE NO. 2.

BRIDGE AND		NEW JERSEY BARRIER RAIL RETROFIT		STATE OF LOUISIANA		ADD CURB & REVISE TRANSITION UPDATED TO 2000 SPECIFICATIONS & BOLTS		DESIGNED CHECKED DATE SHEET		PARISH FEDERAL PROJECT STATE PROJECT		PLAQUEMINES		SHEET NUMBER 78			
STANDARD DETAIL		FOR STRUCTURES MORE THAN 60 FEET		NO.		DATE		BY		P.B.F.		P.B.F.		JUNE, 2000		838-03-0023	
2		11-12-04		1		4-30-01		1		J. BENTON		P. FOSSIER		JUNE, 2000		838-03-0023	

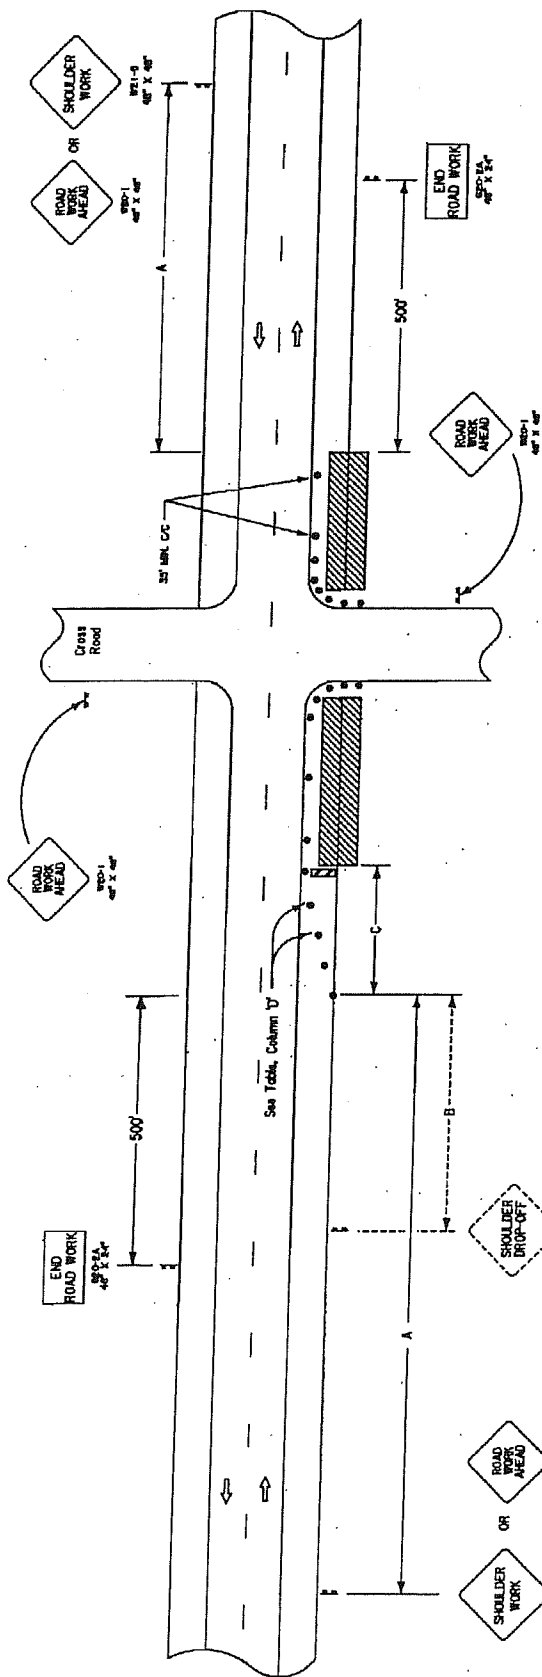

SPEED LIMIT	Spacing	Shoulder Closure Taper		
		Minimum Taper Length	Maximum Device Spacing	Device Spacing
35 mph	500'	250'	100'	25'
45 mph	1000'	350'	200'	45'
≥ 55 mph	1500'	500'	250'	50'

If horizontal curve radius is less than 300', device spacing shall be 25'.

NOTES

THIS SHEET SHALL BE USED WITH THE TEMPORARY TRAFFIC CONTROL GENERAL NOTES SHEET (TC-01).

- THIS LAYOUT REPRESENTS TRAFFIC CONTROLS REQUIRED FOR WORKERS AND EQUIPMENT OPERATING WITHIN THE CLEAR ZONE FOR MORE THAN 1 HOUR, LESS THAN 1 HOUR, SEE FIG. TA-1 OF THE MUTCD. PORTABLE SIGNS MAY BE USED FOR WORK LASTING LESS THAN 3 DAYS.
- NO SIGNS OR BARRICADES ARE REQUIRED FOR EQUIPMENT OPERATING OR WORK IN PROGRESS OUTSIDE THE CLEAR ZONE.
- SIGNS AND BARRICADES SHALL BE COVERED OR REMOVED DURING NONWORKING HOURS UNLESS A DROP-OFF OR PHYSICAL OBSTRUCTION REMAINS WITHIN THE CLEAR ZONE.
- TRAFFIC CONES MAY BE USED AS CHANNELIZING DEVICES ALONG THE WORK AREA DURING DAYLIGHT HOURS ONLY.

6. SHOULDER DROP-OFFS

- WHEN A SHOULDER DROP-OFF IS GREATER THAN 2' BUT LESS THAN 6' EXISTS, A "SHOULDER DROP-OFF" SIGN WILL FOLLOW THE "SHOULDER WORK" SIGN. WHEN THE DROP-OFF EXCEEDS 6', THE "SHOULDER DROP-OFF" SIGN SHALL BE REPLACED BY A "NO SHOULDER" SIGN.
- IF THE SPEED LIMIT IS GREATER THAN 45 MPH AND THE DROP-OFF IS 10' OR GREATER WITHIN 2' OF THE TRAVEL LANE DURING NONWORKING HOURS, A PORTABLE BARRIER SHALL BE USED.
- A TEMPORARY EDGE LINE OR CHANNELIZING DEVICE SHALL BE PLACED AT THE PAVEMENT EDGE ADJACENT TO THE DROP-OFF DURING NONWORKING HOURS WHEN THE DROP-OFF IS GREATER THAN 2'.
- SPEED LIMIT IN THE ABOVE TABLE REFERS TO THE LEGALLY ESTABLISHED SPEED LIMIT BEFORE CONSTRUCTION. IF WORKERS ARE PRESENT WITHIN 2' OF TRAVEL LANE, SPEED LIMIT MAY NEED TO BE REDUCED.
- WHEN A WORK AREA HAS BEEN ESTABLISHED ON ONE SIDE OF THE ROADWAY ONLY, THERE SHALL BE NO CONFLICTING OPERATIONS OR PARKING ON THE OPPOSITE SHOULDER WITHIN 500 FEET OF THE WORK AREA.
- ANY SIGNS IN CONFLICT WITH CONSTRUCTION SIGNING SHALL BE REMOVED OR COVERED.
- MINIMUM CONSTRUCTION SIGNING: ANY ADDITIONAL SIGNS SHOWN IN THE "MAJORS OF TRAFFIC CONTROL DEVICES" AND REQUIRED BY THE PROJECT ENGINEER SHALL BE INSTALLED UNDER ITEM 713-01.

LEGEND

- Traffic Sign
- Channelizing Device
- Work Area
- Type III Barricades

12. TYPE III BARRICADES SHALL BE PLACED IN THE CLOSED LANE AT A 1000' INTERVAL. WHEN THE WORK IS ON GOING AND THE LANE MUST REMAIN CLOSED, TYPE III BARRICADES SHALL BE REQUIRED BEFORE EACH OR GROUP OF UNFILLED HOLES OR HOLES FILLED WITH TEMPORARY MATERIAL, OR WHERE UNCURED CONCRETE EXISTS.




TRAFFIC CONTROL LAYOUT
FOR WORK LESS THAN 18'
FROM THE TRAVELED LANE

TC-01

DESIGNED	CHECKED	DATE	BY
DETAILED	CHECKED	DATE	BY
PARISH	FEDERAL PROJECT	STATE PROJECT	838-03-0023
PLAQUEMINES			

SHEET NO. 8a

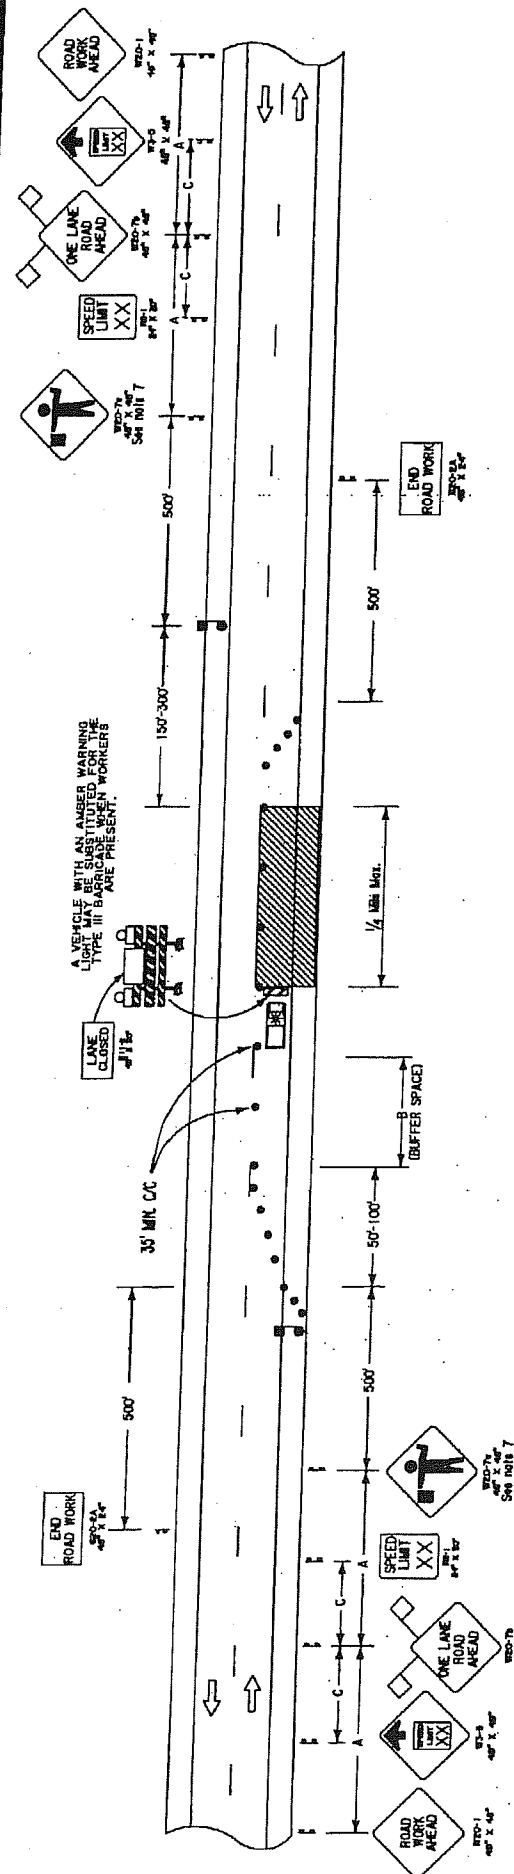

SPEED LIMIT (See note 5)	Spacing		
	"A"	"B"	"C"
35 mph	500'	250'	N/A
45 mph	1000'	350'	500'
55 mph	1500'	450'	800'

SIGN SPACING TO BE ADJUSTED
FOR HORIZONTAL & VERTICAL CURVES.

NOTES

THIS SHEET SHALL BE USED WITH THE "TEMPORARY TRAFFIC CONTROL GENERAL NOTES SHEET (TC-001)".

1. CONDITIONS REPRESENTED ARE FOR WORK WHICH REQUIRES CLOSING TRAFFIC LANES DURING DAYLIGHT HOURS ONLY. PORTABLE SIGNS MAY BE USED FOR WORK LASTING LESS THAN 3 DAYS.

2. WHEN A WORK AREA HAS BEEN ESTABLISHED ON ONE SIDE OF THE ROADWAY ONLY, THERE SHALL BE NO PARKING ON THE OPPOSITE SHOULDER WITHIN 500 FEET OF THE WORK AREA.

3. CHANNELIZING DEVICES MAY BE PLACED UP TO 2' BEYOND CENTERLINE ONLY AT SPECIFIC LOCATIONS WHERE ACTUAL WORK ACTIVITY IS TAKING PLACE. A 10' MINIMUM TRAVELED LANE SHOULD BE MAINTAINED WHERE PRACTICAL. CHANNELIZING DEVICES SHALL BE RETURNED TO THE CENTERLINE WHEN THE WORK ACTIVITY HAS PASSED.

4. SPACING OF CHANNELIZING DEVICES IN THE TAPER SHOULD BE NO MORE THAN 20'. A MINIMUM OF 5 CHANNELIZING DEVICES ARE TO BE USED IN THE TAPER.

5. SPEED LIMIT REFERS TO THE LEGALLY ESTABLISHED SPEED LIMIT BEFORE CONSTRUCTION.

6. TO PREVENT VEHICLES FROM ENTERING THE WORK AREA AGAINST THE FLOW OF TRAFFIC, AN ADDITIONAL FLAGGER SHALL BE STATIONED AT EACH INTERSECTION, MAJOR DRIVEWAY, RAILROAD CROSSING OR CROSSING WITHIN THE WORK AREA.

7. VISUAL OR RADIO CONTACT SHALL BE REQUIRED BETWEEN FLAGGERS AT ALL TIMES. THE FLAGGER SHALL BE VISIBLE FROM FLAGGER SIGN.

8. ANY SIGNS IN CONFLICT WITH CONSTRUCTION SIGNING SHALL BE REMOVED OR COVERED BY THE CONTRACTOR.

9. MINIMUM CONSTRUCTION SIGNING. ANY ADDITIONAL SIGNS SHOWN IN THE MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES AND REQUIRED BY THE PROJECT ENGINEER SHALL BE INSTALLED UNDER ITEM 713-01.

10. TYPE III BARRICADES SHALL BE PLACED IN THE CLOSED LANE AT A 1000' INTERVAL WHERE NO ACTIVE WORK IS ON GOING. BARRICADES MUST REMAIN CLOSED. TYPE III BARRICADES ARE ALSO REQUIRED BEFORE EACH HOIST OR CRANE OPERATION. TYPE III BARRICADES ON HOLES FILLED WITH TEMPORARY MATERIAL, OR WHERE UNCURED CONCRETE EXISTS.

11. NEITHER WORK ACTIVITY NOR STORAGE OF EQUIPMENT, VEHICLES, OR MATERIALS SHALL OCCUR WITHIN THE BUFFER SPACE.




TRAFFIC CONTROL LAYOUT FOR LANE CLOSURE LESS THAN 1/4 MILE IN LENGTH

TC-02

DESIGNED CHECKED	DATE	BY	REVISION DESCRIPTION
DETAILED CHECKED	DATE	BY	REVISION DESCRIPTION
PARISH	PLAQUEMINES	STATE PROJECT	838-03-0023
FEDERAL PROJECT			
SHEET NO.	8b		

- * REMOVE OR COVER WHEN NO LONGER APPLICABLE.
- ** REPLACE WITH "ROAD WORK 1/2 MILE" WHEN NO LONGER APPLICABLE.

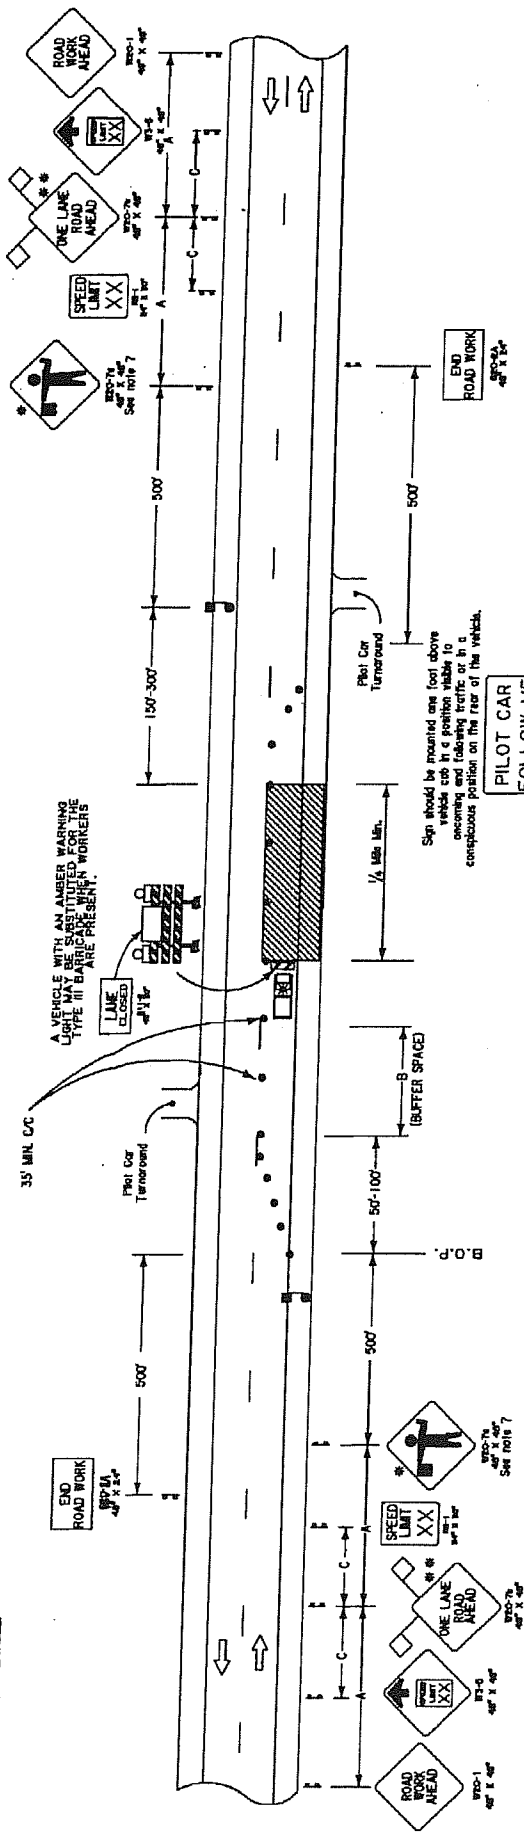

NOTES

THIS SHEET SHALL BE USED WITH THE "TEMPORARY TRAFFIC CONTROL, GENERAL NOTES SHEET TITC-001".

1. WHEN A WORK AREA HAS BEEN ESTABLISHED ON ONE SIDE OF THE ROADWAY ONLY, THERE SHALL BE NO PARKING ON THE OPPOSITE SHOULDER WITHIN 500 FEET OF THE WORK AREA.
2. CHANNELIZING DEVICES MAY BE PLACED UP TO 2' BEYOND CENTERLINE ONLY AT SPECIFIC LOCATIONS WHERE ACTUAL WORK ACTIVITY IS TAKING PLACE. A 10' MINIMUM TRAVELED SHOULDER SHOULD BE MAINTAINED WHERE PRACTICAL. WORK ACTIVITY HAS PASSED.
3. SPACING OF CHANNELIZING DEVICES IN THE TAPER SHOULD BE NO MORE THAN 80' A MINIMUM OF 5 CHANNELIZING DEVICES ARE TO BE USED IN THE TAPER.
4. SPEED LIMIT REFERS TO THE LEGALLY ESTABLISHED SPEED LIMIT BEFORE CONSTRUCTION.
5. TO PREVENT VEHICLES FROM ENTERING THE WORK AREA AGAINST THE FLOW OF TRAFFIC, AN ADDITIONAL FLAGGER SHALL BE STATIONED AT EACH INTERSECTION, MAJOR DRIVEWAY, RAILROAD CROSSING OR CROSSING WITHIN THE WORK AREA.
6. WITH THE APPROVAL OF THE ENGINEER, THE LENGTH OF THE WORK AREA MAY, FOR A SHORT DURATION, BE CHANGED TO AS MUCH AS ONE-HALF MILE MAXIMUM TO IMPROVE THE SIGHT DISTANCE TO THE FLAGGER. VISUAL OR RADIO CONTACT SHALL BE REQUIRED BETWEEN THE FLAGGERS AT ALL TIMES.
7. FOR PROJECTS IN RURAL AREAS THE DISTANCE BETWEEN FLAGGERS SHALL NOT EXCEED 2.5 MILES FOR A.D.T. HAVING LESS THAN 1,000 DAILY TRAFFIC OR LESS THAN 2,500 AND 2.0 MILES FOR A.D.T. FROM 1,000 TO 5,000. THE DISTANCE BETWEEN FLAGGERS SHALL NOT EXCEED 1.5 MILES FOR A.D.T. GREATER THAN 5,000 VEHICLES.

PILLOT CAR
IF USED, A PILOT CAR SHALL BE USED TO GUIDE A QUEUE OF VEHICLES THROUGH THE TEMPORARY TRAFFIC CONTROL ZONE OR CLOSURE. THE PILOT CAR SHALL BE USED IN RESTRICTED VISIBILITY OPERATIONS SUCH AS LANE CLOSURE, STABILIZATION, CHP SEALS, OR OPERATIONS IN HILLY OR CURVED AREAS WHERE FLAGGERS CANNOT SEE EACH OTHER (REQUIRE A CLEAR LINE OF SIGHT). PILOT CARS ARE NOT REQUIRED IN CONFINED OPERATIONS SUCH AS TAPER OR OTHER LIMITED LANE CLOSURE UNLESS THERE ARE MULTIPLE CROSSINGS OR MULTIPLE CONTINUOUS LANE CLOSURES. THE OPERATION OF THE PILOT VEHICLE SHALL BE COORDINATED WITH FLAGGING OPERATIONS OR OTHER CONTROLS AT EACH END OF THE ONE-LANE SECTION.

SPEED LIMIT (See note 4)	Spacing		
	"A"	"B"	"C"
35 mph	500'	250'	N/A
45 mph	1000'	500'	500'
55 mph	1500'	750'	800'



- LEGEND
- Traffic Sign
 - Flagger
 - Channelizing Device
 - Type II Barricade
 - Work Area
 - Type B Light

TRAFFIC ENGINEERING		TRAFFIC CONTROL FOR LANE CLOSURE GREATER THAN 1/4 MILE IN LENGTH (SUITABLE FOR MOVING OPERATIONS)		TC-03	NO.	DATE	REVISION DESCRIPTION	BY	SHEET
DESIGNED	CHECKED	PARISH	PLAQUEMINES	STATE PROJECT	838-03-0023				
DETAILED	CHECKED	FEDERAL PROJECT							
DATE	01/15/2011	DATE	01/15/2011	DATE	01/15/2011				



THIS SHEET SHALL BE USED WITH THE "TEMPORARY TRAFFIC CONTROL GENERAL NOTES SHEET (TC-001)".

1. THIS LAYOUT REPRESENTS TRAFFIC CONTROLS REQUIRED FOR WORKERS AND EQUIPMENT OPERATING OUTSIDE OF CLEAR ZONE. IF THE OPERATION RESULTS IN EQUIPMENT OR OTHER VEHICLES BEING PARKED WITHIN THE CLEAR ZONE, BUT NOT WITHIN THE ROADWAY EACH VEHICLE SHALL HAVE AN AMBER LIGHT.
2. WHEN A WORK AREA HAS BEEN ESTABLISHED ON ONE SIDE OF THE ROADWAY ONLY, THERE SHALL BE NO PARKING ON THE OPPOSITE SHOULDER WITHIN 500 FEET OF THE WORK AREA.
3. SPEED LIMIT REFERS TO THE LEGALLY ESTABLISHED SPEED LIMIT BEFORE CONSTRUCTION.
4. AN ADDITIONAL "ROAD WORK AHEAD" SIGN SHALL BE PLACED AT EACH PUBLIC ROAD INTERSECTING THE PROJECT WITHIN THE WORK AREA.
5. ANY SIGNS IN CONFLICT WITH CONSTRUCTION SIGNING SHALL BE REMOVED OR COVERED.
6. MINIMUM CONSTRUCTION SIGNING: ANY ADDITIONAL SIGNS SHOWN IN THE "MINIMUM ON UNIFORM TRAFFIC CONTROL DEVICES" AND REQUIRED BY THE PROJECT ENGINEER SHALL BE INSTALLED UNDER ITEM 713-9.


DEPT FROM

SPEED LIMIT	Spacing
35 mph	'K'
45 mph	500'
55 mph	1000'
	1500'



 TRAFFIC CONTROL FOR WORK GREATER THAN 15' FROM THE TRAVELED LANE		NO. DATE BY	REVISION DESCRIPTION		DESIGNED CHECKED	E. CORRELLS J. COL VLR	PARISH	PLAQUEMINES	SHEET NO.	8d							
TC-05					DETAILED CHECKED	D. BOWLAND J. COL VLR	FEDERAL PROJECT										
					DATE SHEET	D. BOWLAND J. COL VLR	STATE PROJECT	838-03-0023									

For use when immediate work area is less than 250' from nearest
 crossroad travel lane, but work does not interfere with crossroad
 travel lanes.

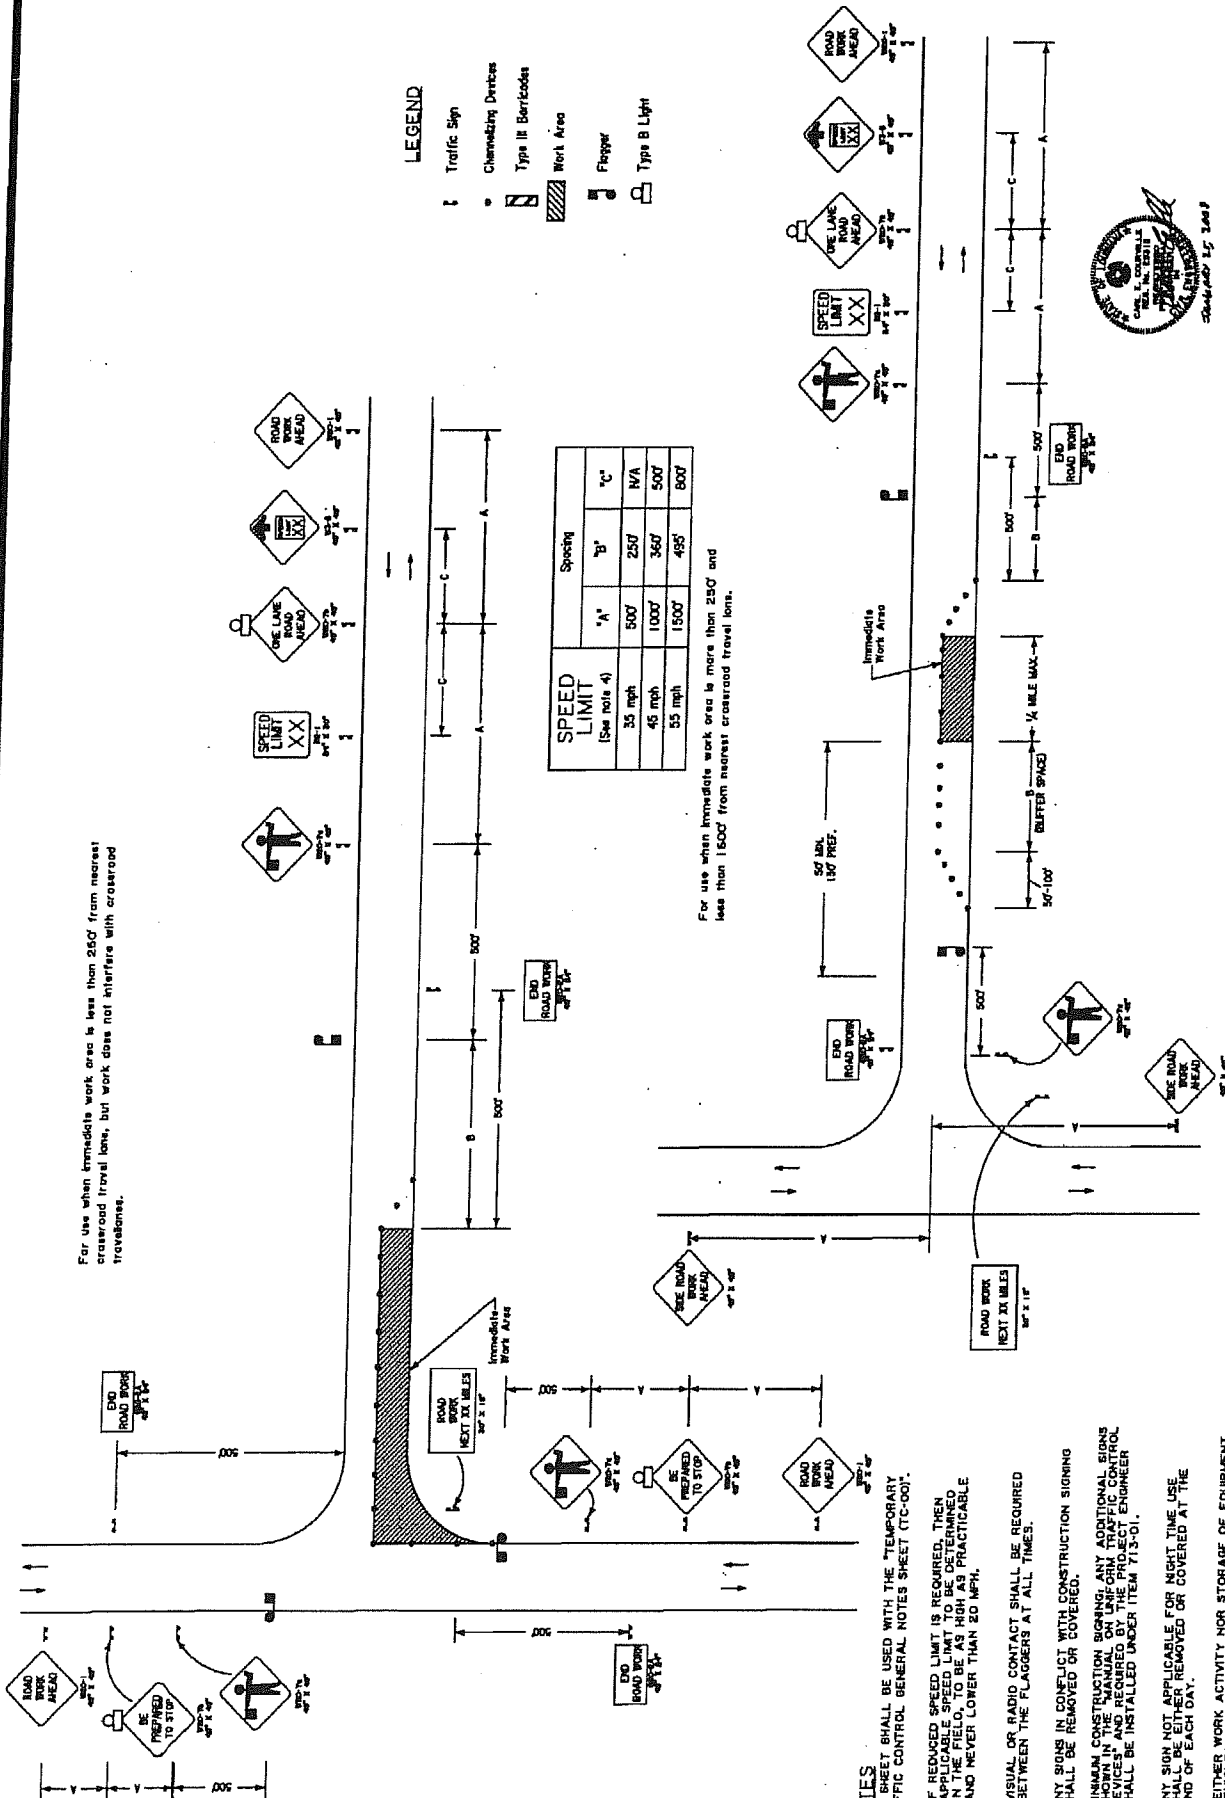

SHEET NO. 8e	
TRAFFIC ENGINEERING	PLAQUEMINES
TC-15	PARISH
TRAFFIC CONTROL LAYOUT FOR LANE CLOSURES ON TWO LANE HIGHWAYS DURING OVERLAYS AND MOVING OPERATIONS	FEDERAL PROJECT
NO. DATE	STATE PROJECT 838-03-0023
REVISION DESCRIPTION	DATE SHEET
BY	DATE SHEET

**STATE OF LOUISIANA
DEPARTMENT OF TRANSPORTATION AND
DEVELOPMENT**



**CONSTRUCTION PROPOSAL
INFORMATION
FOR**

**STATE PROJECT NO. 838-03-0023
WOODLAND HWY. IMPROVEMENTS
(LA 23 to PLANTERS CANAL) – PHASE 1
ROUTE LA 406
PLAQUEMINES PARISH**

BID BOND

A Bid Bond is required when the bidder's total bid amount as calculated by the Department in accordance with Subsection 103.01 is greater than \$50,000. *(See Section 102 of the Project Specifications.)*

_____, as Principal (Bidder)
and _____, as Surety,
are bound unto the State of Louisiana, Department of Transportation and Development, (hereinafter called the Department) in the sum of five percent (5%) of the bidder's total bid amount as calculated by the Department for payment, of which the Principal and Surety bind themselves, their heirs, executors, administrators, successors and assigns, as solidary obligors.

Signed and sealed this _____ day of _____, 20_____.

The condition of this obligation is such that, whereas the Principal has submitted a bid to the Department on a contract for the construction of **STATE PROJECT NO. 838-03-0023, WOODLAND HWY. IMPROVEMENTS (LA 23 to PLANTERS CANAL) – PHASE 1, located in PLAQUEMINES PARISH, ROUTE LA 406**, if the bid is accepted and the Principal, within the specified time, enters into the contract in writing and gives bond with Surety acceptable to the Department for payment and performance of said contract, this obligation shall be void; otherwise to remain in effect.

Principal (Bidder or First Partner to Joint Venture)
By _____
Authorized Officer-Owner-Partner

Typed or Printed Name

If a Joint Venture, Second Partner
By _____
Authorized Officer-Owner-Partner

Typed or Printed Name

Surety
By _____ (Seal)
Agent or Attorney-in-Fact

Typed or Printed Name

To receive a copy of the contract and subsequent correspondence / communication from LA DOTD, with respect to the bid bonds, the following information must be provided:

Bonding Agency or Company Name

Address

Agent or Representative

Phone Number / Fax Number

LOUISIANA DEPARTMENT OF TRANSPORTATION AND DEVELOPMENT
SCHEDULE OF ITEMS

LEAD PROJECT: 838-03-0023
OTHER PROJECTS:

DATE: 10/29/08 07:34 PAGE: 1

ITEM NUMBER	APPROXIMATE QUANTITY	UNIT OF MEASURE	PAY ITEM UNIT PRICE (IN WORDS, INK OR TYPED)
202-02-C	400	SQUARE YARD	REMOVAL OF PORTLAND CEMENT CONCRETE PAVEMENT DOLLARS CENTS
202-02-E	100.0	LINEAR FOOT	REMOVAL OF CONCRETE CURBS DOLLARS CENTS
202-02-G	2,350.0	SQUARE YARD	REMOVAL OF SURFACING & STABILIZED BASE DOLLARS CENTS
202-02-H	712	LINEAR FOOT	REMOVAL OF GUARD RAIL DOLLARS CENTS
202-02-I	50	EACH	REMOVAL OF SMALL PLANTS (LESS THAN 3 FT. TALL) DOLLARS CENTS
203-01	4,717	CUBIC YARD	GENERAL EXCAVATION DOLLARS CENTS

LOUISIANA DEPARTMENT OF TRANSPORTATION AND DEVELOPMENT
SCHEDULE OF ITEMS

LEAD PROJECT: 838-03-0023
OTHER PROJECTS:

DATE: 10/29/08 07:34 PAGE: 2

ITEM NUMBER	APPROXIMATE QUANTITY	UNIT OF MEASURE	PAY ITEM UNIT PRICE (IN WORDS, INK OR TYPED)
203-02	3,925	CUBIC YARD	DRAINAGE EXCAVATION _____ DOLLARS _____ CENTS
203-04	20,000	CUBIC YARD	NONPLASTIC EMBANKMENT _____ DOLLARS _____ CENTS
203-07	2,000	CUBIC YARD	BORROW (VEHICULAR MEASUREMENT) _____ DOLLARS _____ CENTS
203-07-B	2,500	CUBIC YARD	BORROW (VEHICULAR MEAS.) (PLASTIC SOILS) _____ DOLLARS _____ CENTS
302-02-F	8,900.0	SQUARE YARD	CLASS II BASE COURSE (12" THICK) _____ DOLLARS _____ CENTS
401-02	100	CUBIC YARD	AGGREGATE SURFACE COURSE (ADJUSTED VEHICULAR MEASUREMENT) _____ DOLLARS _____ CENTS

LOUISIANA DEPARTMENT OF TRANSPORTATION AND DEVELOPMENT
SCHEDULE OF ITEMS

LEAD PROJECT: 838-03-0023
OTHER PROJECTS:

DATE: 10/29/08 07:34 PAGE: 3

ITEM NUMBER	APPROXIMATE QUANTITY	UNIT OF MEASURE	PAY ITEM UNIT PRICE (IN WORDS, INK OR TYPED)
502-01	6,177.6	TON	SUPERPAVE ASPHALTIC CONCRETE _____ DOLLARS _____ CENTS
502-01-A	316.3	TON	SUPERPAVE ASPHALTIC CONCRETE, DRIVES, TURNOUTS AND MISCELLANEOUS _____ DOLLARS _____ CENTS
701-01-I	80	LINEAR FOOT	CROSS DRAIN PIPE (24" CMP) _____ DOLLARS _____ CENTS
701-05-M	180	LINEAR FOOT	SIDE DRAIN PIPE (36") _____ DOLLARS _____ CENTS
702-03-B	7	EACH	CATCH BASINS (CB-02) _____ DOLLARS _____ CENTS
704-03	93.8	LINEAR FOOT	BLOCKED OUT GUARD RAIL _____ DOLLARS _____ CENTS

LOUISIANA DEPARTMENT OF TRANSPORTATION AND DEVELOPMENT
SCHEDULE OF ITEMS

LEAD PROJECT: 838-03-0023
OTHER PROJECTS:

DATE: 10/29/08 07:34 PAGE: 4

ITEM NUMBER	APPROXIMATE QUANTITY	UNIT OF MEASURE	PAY ITEM UNIT PRICE (IN WORDS, INK OR TYPED)
704-07-A	100.0	LINEAR FOOT	GUARD RAIL BRIDGE ATTACHMENTS (SINGLE THRIE BEAM) _____ DOLLARS _____ CENTS
704-08-B	193.8	LINEAR FOOT	GUARD RAIL TRANSITIONS (DOUBLE THRIE BEAM) _____ DOLLARS _____ CENTS
704-11-A	8	EACH	GUARD RAIL END TREATMENT (FLARED) _____ DOLLARS _____ CENTS
707-01	100.0	LINEAR FOOT	CONCRETE CURB _____ DOLLARS _____ CENTS
711-04	300	SQUARE YARD	GEOTEXTILE FABRIC _____ DOLLARS _____ CENTS
713-01	LUMP	LUMP SUM	TEMPORARY SIGNS & BARRICADES _____ DOLLARS _____ CENTS

LOUISIANA DEPARTMENT OF TRANSPORTATION AND DEVELOPMENT
SCHEDULE OF ITEMS

LEAD PROJECT: 838-03-0023
OTHER PROJECTS:

DATE: 10/29/08 07:34 PAGE: 5

ITEM NUMBER	APPROXIMATE QUANTITY	UNIT OF MEASURE	PAY ITEM UNIT PRICE (IN WORDS, INK OR TYPED)
713-02-E	1,195	LINEAR FOOT	TEMPORARY PAVEMENT MARKINGS (24" WIDTH) DOLLARS CENTS
713-03-A	7.576	MILE	TEMPORARY PAVEMENT MARKINGS (BROKEN LINE) (4" WIDTH) (4' LENGTH) DOLLARS CENTS
713-03-B	4.720	MILE	TEMPORARY PAVEMENT MARKINGS (BROKEN LINE) (4" WIDTH) (10' LENGTH) DOLLARS CENTS
713-04-A	9.976	MILE	TEMPORARY PAVEMENT MARKINGS (SOLID LINE) (4" WIDTH) DOLLARS CENTS
717-01	120	POUND	SEEDING DOLLARS CENTS
718-01	4,000	POUND	FERTILIZER DOLLARS CENTS

LOUISIANA DEPARTMENT OF TRANSPORTATION AND DEVELOPMENT
SCHEDULE OF ITEMS

LEAD PROJECT: 838-03-0023
OTHER PROJECTS:

DATE: 10/29/08 07:34 PAGE: 6

ITEM NUMBER	APPROXIMATE QUANTITY	UNIT OF MEASURE	PAY ITEM UNIT PRICE (IN WORDS, INK OR TYPED)
726-01	80.0	CUBIC YARD	BEDDING MATERIAL _____ DOLLARS _____ CENTS
727-01	LUMP	LUMP SUM	MOBILIZATION _____ DOLLARS _____ CENTS
729-16-C	8	EACH	OBJECT MARKER ASSEMBLY (Type 3) _____ DOLLARS _____ CENTS
731-02	704	EACH	REFLECTORIZED RAISED PAVEMENT MARKERS _____ DOLLARS _____ CENTS
732-01-E	598	LINEAR FOOT	PLASTIC PAVEMENT STRIPING (24" WIDTH) _____ DOLLARS _____ CENTS
732-02-A	4.988	MILE	PLASTIC PAVEMENT STRIPING (SOLID LINE) (4" WIDTH) _____ DOLLARS _____ CENTS

LOUISIANA DEPARTMENT OF TRANSPORTATION AND DEVELOPMENT
SCHEDULE OF ITEMS

LEAD PROJECT: 838-03-0023
OTHER PROJECTS:

DATE: 10/29/08 07:34 PAGE: 7

ITEM NUMBER	APPROXIMATE QUANTITY	UNIT OF MEASURE	PAY ITEM UNIT PRICE (IN WORDS, INK OR TYPED)
732-03-A	2.360	MILE	PLASTIC PAVEMENT STRIPING (BROKEN LINE) (4" WIDTH) DOLLARS CENTS
732-04-A	24	EACH	PLASTIC PAVEMENT LEGENDS & SYMBOLS (ARROW) DOLLARS CENTS
735-01	2	EACH	MAILBOXES DOLLARS CENTS
735-02	2	EACH	MAILBOX SUPPORTS (SINGLE) DOLLARS CENTS
740-01	LUMP	LUMP SUM	CONSTRUCTION LAYOUT DOLLARS CENTS
S-001	200	LIN. FT.	CLEANING EXISTING CULVERTS (16 TO 48 INCHES) DOLLARS CENTS

LOUISIANA DEPARTMENT OF TRANSPORTATION AND DEVELOPMENT
SCHEDULE OF ITEMS

LEAD PROJECT: 838-03-0023
OTHER PROJECTS:

DATE: 10/29/08 07:34 PAGE: 8

ITEM NUMBER	APPROXIMATE QUANTITY	UNIT OF MEASURE	PAY ITEM UNIT PRICE (IN WORDS, INK OR TYPED)
S-002	1	EACH	RELOCATION OF EXISTING LANDSCAPE LIGHTING DOLLARS CENTS
S-003	360	LIN. FT.	FULL DEPTH SAW CUT OF EXISTING PAVEMENT DOLLARS CENTS
S-004	LUMP	LUMP SUM	SURFACE PREPARATION DOLLARS CENTS
S-005	23,500	SQUARE YARD	GEOTEXTILE FABRIC DOLLARS CENTS
S-006	2.75	MILE	RUMBLE STRIPS (GROUND-IN) DOLLARS CENTS

CONSTRUCTION PROPOSAL SIGNATURE AND EXECUTION FORM

THIS FORM, THE SCHEDULE OF ITEMS, AND THE PROPOSAL GUARANTY MUST BE COMPLETED AS INDICATED AND SUBMITTED TO THE LOUISIANA DEPARTMENT OF TRANSPORTATION AND DEVELOPMENT (DOTD) TO CONSTITUTE A VALID BID

STATE PROJECT NO. 838-03-0023

FEDERAL AID PROJECT NO. N/A

NAME OF PROJECT WOODLAND HWY. IMPROVEMENTS
(LA 23 to PLANTERS CANAL) – PHASE 1

I (WE) HEREBY CERTIFY THAT I (WE) HAVE CAREFULLY EXAMINED THE PROPOSAL, PLANS AND SPECIFICATIONS, INCLUDING ANY AND ALL ADDENDA, AND THE SITE OF THE ABOVE PROJECT AND AM (ARE) FULLY COGNIZANT OF ALL PROPOSAL DOCUMENTS, THE MASTER COPY OF WHICH IS ON FILE AT DOTD HEADQUARTERS IN BATON ROUGE, LA., AND ALL WORK, MATERIALS AND LABOR REQUIRED THEREIN, AND AGREE TO PERFORM ALL WORK, AND SUPPLY ALL NECESSARY MATERIALS AND LABOR REQUIRED FOR SUCCESSFUL AND TIMELY COMPLETION OF THE ABOVE PROJECT AND TO ACCEPT THE SUMMATION OF THE PRODUCTS OF THE UNIT PRICES BID ON THE SCHEDULE OF ITEMS ATTACHED HERETO AND MADE A PART HEREOF MULTIPLIED BY THE ACTUAL QUANTITY OF UNIT OF MEASURE PERFORMED FOR EACH ITEM, AS AUDITED BY DOTD, AS FULL AND FINAL PAYMENT FOR ALL WORK, LABOR AND MATERIALS NECESSARY TO COMPLETE THE ABOVE PROJECT, SUBJECT TO INCREASE ONLY FOR PLAN CHANGES (CHANGE ORDERS) APPROVED BY THE DOTD CHIEF ENGINEER OR HIS DESIGNEE. THIS BID IS SUBMITTED IN ACCORDANCE WITH THE GENERAL BIDDING REQUIREMENTS IN THE CONSTRUCTION PROPOSAL AND ALL SPECIAL PROVISIONS, PLANS, SUPPLEMENTAL SPECIFICATIONS, AND THE LOUISIANA STANDARD SPECIFICATIONS FOR ROADS AND BRIDGES (2006 EDITION). I (WE) UNDERSTAND THAT THE SUMMATION OF THE PRODUCTS OF THE UNIT PRICES BID ON THE SCHEDULE OF ITEMS MULTIPLIED BY THE ESTIMATED QUANTITY OF UNIT OF MEASURE FOR EACH ITEM, ALONG WITH ANY OTHER FACTORS SPECIFIED TO BE APPLICABLE SUCH AS CONSTRUCTION TIME AND/OR LANE RENTAL, SHALL BE THE BASIS FOR THE COMPARISON OF BIDS. I (WE) UNDERSTAND THAT THE SCHEDULE OF ITEMS MUST CONTAIN UNIT PRICES WRITTEN OUT IN WORDS AND THAT THE SCHEDULE OF ITEMS SUBMITTED AS PART OF THIS BID IS ON THE FORM SUPPLIED BY DOTD IN THE BID PROPOSAL. MY (OUR) PROPOSAL GUARANTY IN THE AMOUNT SPECIFIED FOR THE PROJECT IS ATTACHED HERETO AS EVIDENCE OF MY (OUR) GOOD FAITH TO BE FORFEITED IF THIS BID IS ACCEPTED BY DOTD AND I (WE) FAIL TO COMPLY WITH ANY REQUIREMENT NECESSARY FOR AWARD AND EXECUTION OF THE CONTRACT, AS WELL AS, SIGN AND DELIVER THE CONTRACT AND PAYMENT/PERFORMANCE/RETAINAGE BOND AS REQUIRED IN THE SPECIFICATIONS.

NONCOLLUSION DECLARATION (APPLICABLE TO FEDERAL-AID PROJECTS)

I (WE) DECLARE UNDER PENALTY OF PERJURY UNDER THE LAWS OF THE UNITED STATES AND THE STATE OF LOUISIANA THAT I (WE) HAVE NOT DIRECTLY OR INDIRECTLY, ENTERED INTO ANY AGREEMENT, PARTICIPATED IN ANY COLLUSION, OR OTHERWISE TAKEN ANY ACTION IN RESTRAINT OF FREE COMPETITIVE BIDDING IN CONNECTION WITH THE CONTRACT FOR THIS PROJECT NOR VIOLATED LA. R.S. 48:254.

BIDDER'S DBE GOAL STATEMENT (APPLICABLE TO DBE GOAL PROJECTS)

IF THIS PROJECT IS DESIGNATED BY SPECIAL PROVISION AS A DISADVANTAGED BUSINESS ENTERPRISE (DBE) GOAL PROJECT IN ACCORDANCE WITH THE DBE PROVISIONS OF THIS CONTRACT, THE BIDDER ASSURES DOTD THAT HE/SHE WILL MEET OR EXCEED THE DBE CONTRACT GOAL, OR IF THE BIDDER CANNOT MEET THE REQUIRED DBE GOAL, THE BIDDER ASSURES DOTD THAT HE/SHE HAS MADE AND CAN DOCUMENT GOOD FAITH EFFORTS MADE TOWARDS MEETING THE GOAL REQUIREMENT IN ACCORDANCE WITH THE CONTRACT AND DBE PROGRAM MANUAL INCORPORATED HEREIN BY REFERENCE.

THE APPARENT LOW BIDDER SHALL COMPLETE AND SUBMIT TO THE DOTD COMPLIANCE PROGRAMS OFFICE, FORM CS-6AAA AND ATTACHMENT(S) AND, IF NECESSARY, DOCUMENTATION OF GOOD FAITH EFFORTS MADE BY THE BIDDER TOWARD MEETING THE GOAL, WITHIN TEN BUSINESS DAYS AFTER THE OPENING OF BIDS FOR THIS PROJECT. RESPONSIVENESS OF INFORMATION SUPPLIED IN THIS SECTION OF THIS CONSTRUCTION PROPOSAL SIGNATURE AND EXECUTION FORM IS GOVERNED BY THE DBE REQUIREMENTS INCLUDED WITHIN THE SPECIFICATIONS AND DBE PROGRAM MANUAL.

CERTIFICATION OF EMPLOYMENT OF LOUISIANA RESIDENTS TRANSPORTATION INFRASTRUCTURE MODEL FOR ECONOMIC DEVELOPMENT (TIME) PROJECTS (APPLICABLE TO TIME PROJECTS)

IF THIS PROJECT IS DESIGNATED BY SPECIAL PROVISION AS A TRANSPORTATION INFRASTRUCTURE MODEL FOR ECONOMIC DEVELOPMENT (TIME) PROJECT AS DEFINED IN ACT NO. 16 OF THE 1989 FIRST EXTRAORDINARY SESSION OF THE LEGISLATURE WHICH ENACTED PART V OF CHAPTER 7 OF SUBTITLE II OF TITLE 47 OF THE LOUISIANA REVISED STATUTES OF 1950, COMPRISED OF R.S. 47:820.1 THROUGH 820.6.

THE BIDDER CERTIFIES THAT AT LEAST 80 PERCENT OF THE EMPLOYEES EMPLOYED ON THIS TIME PROJECT WILL BE LOUISIANA RESIDENTS IN ACCORDANCE WITH LOUISIANA R.S. 47:820.3.

NON PARTICIPATION IN PAYMENT ADJUSTMENT (ASPHALT CEMENT AND FUELS) STATEMENT

IF THIS PROJECT IS DESIGNATED BY SPECIAL PROVISION AS BEING SUBJECT TO PAYMENT ADJUSTMENT FOR ASPHALT CEMENT AND/OR FUELS, THE BIDDER HAS THE OPTION OF REQUESTING EXCLUSION FROM SAID PAYMENT ADJUSTMENT PROVISIONS THAT ARE ESTABLISHED BY SPECIAL PROVISION ELSEWHERE HEREIN.

IF THE BIDDER DESIRES TO BE EXCLUDED FROM THESE PAYMENT ADJUSTMENT PROVISIONS,

THE BIDDER IS REQUIRED TO MARK HERE ☐

FAILURE TO MARK THIS BOX PRIOR TO BID OPENING WILL CONSTITUTE FORFEITURE OF THE BIDDER'S OPTION TO REQUEST EXCLUSION.

CS-14A
08/06

K-1

BIDDER SIGNATURE REQUIREMENTS (APPLICABLE TO ALL PROJECTS)

THIS BID FOR THE CAPTIONED PROJECT IS SUBMITTED BY:

(Name of Principal (Individual, Firm, Corporation, or Joint Venture))

(If Joint Venture, Name of First Partner)

(Louisiana Contractor's License Number of Bidder or First Partner to Joint Venture)

(Business Street Address)

(Business Mailing Address, if different)

(Area Code and Telephone Number of Business)

(Telephone Number and Name of Contact Person)

(Telecopier Number, if any)

(If Joint Venture, Name of Second Partner)

(Louisiana Contractor's License Number of Second Partner to Joint Venture)

(Business Street Address)

(Business Mailing Address, if different)

(Area Code and Telephone Number of Business)

(Telephone Number and Name of Contact Person)

(Telecopier Number, if any)

ACTING ON BEHALF OF THE BIDDER, THIS IS TO ATTEST THAT THE UNDERSIGNED DULY AUTHORIZED REPRESENTATIVE OF THE ABOVE CAPTIONED FIRM, CORPORATION OR BUSINESS, BY SUBMISSION OF THIS BID, AGREES AND CERTIFIES THE TRUTH AND ACCURACY OF ALL PROVISIONS OF THIS PROPOSAL, INCLUSIVE OF THE REQUIREMENTS, STATEMENTS, DECLARATIONS AND CERTIFICATIONS ABOVE AND IN THE SCHEDULE OF ITEMS AND PROPOSAL GUARANTY. EXECUTION AND SIGNATURE OF THIS FORM AND SUBMISSION OF THE SCHEDULE OF ITEMS AND PROPOSAL GUARANTY SHALL CONSTITUTE AN IRREVOCABLE AND LEGALLY BINDING OFFER BY THE BIDDER.

(Signature)

(Printed Name)

(Title)

(Date of Signature)

(Signature)

(Printed Name)

(Title)

(Date of Signature)

CONTRACTOR'S TOTAL BASE BID \$ _____

IT IS AGREED THAT THIS TOTAL, DETERMINED BY THE BIDDER, IS FOR PURPOSES OF OPENING AND READING BIDS ONLY, AND THAT THE LOW BID FOR THIS PROJECT WILL BE DETERMINED FROM THE EXTENSION AND TOTAL OF THE BID ITEMS BY DOTD.